

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



**Field device integration (FDI) –  
Part 103-4: Profiles – PROFINET**

**Intégration des appareils de terrain (FDI) –  
Partie 103-4: Profils – PROFINET**

IECNORM.COM : Click to view the full PDF of IEC 62769-103-4:2020



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

#### IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

#### IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

#### IEC Glossary - [std.iec.ch/glossary](http://std.iec.ch/glossary)

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

### A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

### A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

#### Recherche de publications IEC -

[webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

#### Service Clients - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: [sales@iec.ch](mailto:sales@iec.ch).

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

#### Glossaire IEC - [std.iec.ch/glossary](http://std.iec.ch/glossary)

67 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



**Field device integration (FDI) –  
Part 103-4: Profiles – PROFINET**

**Intégration des appareils de terrain (FDI) –  
Partie 103-4: Profils – PROFINET**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

ICS 25.040.40; 35.100.05

ISBN 978-2-8322-8139-0

**Warning! Make sure that you obtained this publication from an authorized distributor.  
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## CONTENTS

|                                                               |    |
|---------------------------------------------------------------|----|
| FOREWORD .....                                                | 4  |
| 1 Scope .....                                                 | 6  |
| 2 Normative references .....                                  | 6  |
| 3 Terms, definitions, abbreviated terms and conventions ..... | 7  |
| 3.1 Terms and definitions .....                               | 7  |
| 3.2 Abbreviated terms .....                                   | 7  |
| 3.3 Conventions .....                                         | 7  |
| 3.3.1 EDDL syntax .....                                       | 7  |
| 3.3.2 XML syntax .....                                        | 7  |
| 3.3.3 Capitalizations .....                                   | 7  |
| 4 Profile for PROFINET .....                                  | 8  |
| 4.1 General .....                                             | 8  |
| 4.2 Catalog profile .....                                     | 8  |
| 4.2.1 Protocol support file .....                             | 8  |
| 4.2.2 CommunicationProfile definition .....                   | 9  |
| 4.2.3 Profile device .....                                    | 9  |
| 4.2.4 Protocol version information .....                      | 9  |
| 4.3 Associating a Package with a device .....                 | 10 |
| 4.3.1 Device type identification mapping .....                | 10 |
| 4.3.2 Device type revision mapping .....                      | 11 |
| 4.4 Information Model mapping .....                           | 12 |
| 4.4.1 ProtocolType definition .....                           | 12 |
| 4.4.2 DeviceType mapping .....                                | 12 |
| 4.4.3 FunctionalGroup identification definition .....         | 13 |
| 4.5 Topology elements .....                                   | 13 |
| 4.5.1 ConnectionPoint definition .....                        | 13 |
| 4.5.2 Communication Device definition .....                   | 15 |
| 4.5.3 Communication service provider definition .....         | 16 |
| 4.5.4 Network definition .....                                | 17 |
| 4.6 Methods .....                                             | 17 |
| 4.6.1 Methods for FDI Communication Servers .....             | 17 |
| 4.6.2 Methods for Gateways .....                              | 21 |
| Annex A (normative) Topology scan schema .....                | 28 |
| A.1 General .....                                             | 28 |
| A.2 Network .....                                             | 28 |
| A.3 ProfinetNetworkT .....                                    | 28 |
| A.4 ProfinetConnectionPointT .....                            | 28 |
| A.5 ProfinetIdentificationT .....                             | 29 |
| A.6 MACT .....                                                | 30 |
| A.7 IPv4T .....                                               | 30 |
| A.8 IPv6T .....                                               | 30 |
| A.9 DNSNameT .....                                            | 30 |
| A.10 Hex4DigitT .....                                         | 30 |
| Annex B (normative) Transfer service parameters .....         | 31 |
| B.1 General .....                                             | 31 |
| B.2 sendData .....                                            | 31 |

|     |                          |    |
|-----|--------------------------|----|
| B.3 | receiveData .....        | 31 |
| B.4 | TransferSendDataT.....   | 31 |
| B.5 | TransferResultDataT..... | 32 |
| B.6 | OperationT.....          | 32 |
|     | Bibliography.....        | 33 |

|                                         |    |
|-----------------------------------------|----|
| Figure 1 – Version mapping problem..... | 11 |
|-----------------------------------------|----|

|                                                                    |    |
|--------------------------------------------------------------------|----|
| Table 1 – ProtocolSupportFile for FDI Device Packages .....        | 8  |
| Table 2 – ProtocolSupportFile for FDI Communication Packages ..... | 9  |
| Table 3 – Catalog values for profile devices.....                  | 9  |
| Table 4 – Version mapping examples.....                            | 10 |
| Table 5 – Device identification information mapping.....           | 11 |
| Table 6 – Protocol type Profinet_IO .....                          | 12 |
| Table 7 – DeviceType Property mapping.....                         | 13 |
| Table 8 – PROFINET identification type definition.....             | 13 |
| Table 9 – ConnectionPoint type for Profinet_IO .....               | 14 |
| Table 10 – Method Connect arguments.....                           | 18 |
| Table 11 – Method Disconnect arguments .....                       | 18 |
| Table 12 – Method Transfer arguments.....                          | 19 |
| Table 13 – Method SetAddress arguments.....                        | 20 |
| Table 14 – Method Connect arguments.....                           | 22 |
| Table 15 – Method Transfer arguments.....                          | 23 |
| Table 16 – Method SetAddress arguments.....                        | 25 |
| Table A.1 – Elements of ProfinetNetworkT .....                     | 28 |
| Table A.2 – Attributes of ProfinetConnectionPointT.....            | 29 |
| Table A.3 – Elements of ProfinetConnectionPointT .....             | 29 |
| Table A.4 – Attributes of ProfinetIdentificationT .....            | 29 |
| Table B.1 – Attributes of TransferSendDataT.....                   | 32 |
| Table B.2 – Attributes of TransferResultDataT .....                | 32 |

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**FIELD DEVICE INTEGRATION (FDI) –****Part 103-4: Profiles – PROFINET****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62769-103-4 has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

This second edition cancels and replaces the first edition published in 2015. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) support for generic protocol extension for faster adoption of other technologies;
- b) support for Package Developers to build EDDs targeted for today’s EDD bases system under a single development tool.

The text of this International Standard is based on the following documents:

| CDV         | Report on voting            |
|-------------|-----------------------------|
| 65E/623/CDV | 65E/686A/RVC<br>65E/686/RVC |

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 62769 series, published under the general title *Field Device Integration (FDI)*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## FIELD DEVICE INTEGRATION (FDI) –

### Part 103-4: Profiles – PROFINET

#### 1 Scope

This part of IEC 62769 specifies an FDI profile of IEC 62769 for IEC 61784-2\_CP 3/4, IEC 61784-2\_CP3/5 and IEC 61784-2\_CP3/6 (PROFINET<sup>1</sup>).

#### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61158-5-10, *Industrial communication networks - Fieldbus specifications - Part 5-10: Application layer service definition - Type 10 elements*

IEC 61784-2, *Industrial communication networks - Profiles - Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC/IEEE 8802-3*

IEC 61804 (all parts), *Function blocks (FB) for process control and Electronic Device Description Language (EDDL)*

IEC 62541-100:2015, *OPC Unified Architecture - Part 100: Device Interface*

IEC 62769-2, *Field Device Integration (FDI) - Part 2: FDI Client*

IEC 62769-4, *Field Device Integration (FDI) - Part 4: FDI Packages*

IEC 62769-5, *Field Device Integration (FDI) - Part 5: FDI Information Model*

IEC 62769-6, *Field Device Integration (FDI) - Part 6: FDI Technology Mapping*

IEC 62769-7, *Field Device Integration (FDI) - Part 7: FDI Communication Devices*

PI Order No.: 2.122:2008, *Specification for PROFIBUS – Device Description and Device Integration – Volume 1: GSD, V5.1, July 2008: GSD*; available at <www.PROFIBUS.com>

PI Order No.: 2.352:2014, *GSDML Specification for PROFINET IO*; available at <www.profibus.com>

<sup>1</sup> PROFINET is the trade name of the non-profit consortium PROFIBUS & PROFINET International. This information is given for the convenience of users of this document and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance does not require use of the trade name. Use of the trade name requires permission of the trade name holder.

### 3 Terms, definitions, abbreviated terms and conventions

#### 3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61158-5-10, IEC 61784-2, IEC 61804 (all parts), IEC 62541-100, IEC 62769-2, IEC 62769-4, IEC 62769-5, IEC 62769-6, IEC 62769-7 and PI Order No.: 2.352:2014 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

#### 3.2 Abbreviated terms

For the purposes of this document, the following abbreviated terms and acronyms apply:

|       |                                                                          |
|-------|--------------------------------------------------------------------------|
| DCP   | Discovery and basic configuration protocol (according to IEC 61158-5-10) |
| DNS   | Domain name system                                                       |
| EDD   | Electronic Device Description                                            |
| EDDL  | Electronic Device Description Language (see IEC 61804)                   |
| GSD   | General station description (see PI Order No.: 2.122:2008)               |
| GSDML | GSD markup language (see PI Order No.: 2.352:2014)                       |
| IP    | Internet protocol (IETF RFC 791)                                         |
| UIP   | User Interface plug-in                                                   |
| UUID  | Universal unique identifier (see ISO/IEC 11578)                          |
| XML   | Extensible markup language (see REC-xml-20081126)                        |

#### 3.3 Conventions

##### 3.3.1 EDDL syntax

This part of IEC 62769 specifies content for the EDD component that is part of FDI Communication Packages. The specification content using EDDL syntax uses the font `Courier New`. The EDDL syntax is used for method signature, variable, data structure and component declarations.

##### 3.3.2 XML syntax

XML syntax examples use the font `Courier New`. The XML syntax is used to describe XML document schema.

Example: `<xs:simpleType name="ExampleType">`

##### 3.3.3 Capitalizations

IEC 62769 (all parts) uses capitalized terms to emphasize that these terms have an FDI specific meaning.

Some of these terms using an acronym as a prefix for example

- FDI Client, or
- FDI Server.

Some of these terms are compound terms such as:

- Communication Servers, or
- Profile for Package.

Parameter names or attributes are concatenated to a single term, where the original terms starting in this term with a capital letter such as:

- ProtocolSupportFile, or
- ProtocolType.

Parameter names or attributes can also be constructed by using an underscore character to concatenate two or more terms such as:

- PROFILE\_ID, or
- Profinet\_PA\_Network.

## 4 Profile for PROFINET

### 4.1 General

This profile document to the FDI specification in IEC 62769 specifies the protocol specifics needed for FDI Packages describing Communication Servers, Gateways and Devices.

For Communication Servers this document defines also protocol specifics as these need to be considered in the Communication Servers hosted Information Model.

### 4.2 Catalog profile

#### 4.2.1 Protocol support file

##### 4.2.1.1 FDI Device Package

A GSD file is a mandatory Attachment for FDI Device Packages representing PROFINET IO devices.

Protocol specific attachments are mentioned in the Package Catalog as defined in IEC 62769-5. A communication feature list mark-up language (GSDML) file according to PI Order No.: 2.352:2014 is a mandatory attachment for FDI Device Packages representing PROFINET devices. Table 1 specifies the parameters of ProtocolSupportFile in the FDI Device Package.

**Table 1 – ProtocolSupportFile for FDI Device Packages**

| Parameter           | Description                                                      |
|---------------------|------------------------------------------------------------------|
| Content Type        | text/xml                                                         |
| Root Namespace      | Empty                                                            |
| Source Relationship | http://fdi-cooperation.com/2010/relationship/attachment-protocol |
| Filename            | According to PI Order No.: 2.352:2014                            |

##### 4.2.1.2 FDI Communication Package

A GSDML file as specified in ISO 15745 4:2003/AMD1:2006, is an optional attachment for FDI Communication Packages representing PROFINET IO devices. Table 2 specifies the parameters of ProtocolSupportFile for FDI Communication Packages.

**Table 2 – ProtocolSupportFile for FDI Communication Packages**

| Parameter           | Description                                                      |
|---------------------|------------------------------------------------------------------|
| Content Type        | text/xml                                                         |
| Root Namespace      | Empty                                                            |
| Source Relationship | http://fdi-cooperation.com/2010/relationship/attachment-protocol |
| Filename            | According to PI Order No.: 2.352:2014                            |

#### 4.2.2 CommunicationProfile definition

IEC 62769-4 defines a CommunicationProfileT string for the Catalog XML schema. The PROFINET specific value shall be "profinet\_io".

#### 4.2.3 Profile device

A Profile Package shall provide the catalog values for profile devices, enabling the FDI Server to leverage a generic device description, if a specific one is not available. The definitions in Table 3 focus on catalog content that is vendor independent.

**Table 3 – Catalog values for profile devices**

| Element      | Attribute | Content                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
|--------------|-----------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PackageType  | —         | Profile                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
| Manufacturer | —         | Empty                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| DeviceModel  | —         | <p>Allowed profile identifier values (PROFILE_ID) are provided by PROFIBUS &amp; PROFINET International (PI). PI provides and maintains a XML file (Profile_ID_Table) containing the assignment of PROFILE_ID to profiles.</p> <p>It is available at &lt;http://www.profibus.com/IM/Profile_ID_Table.xml&gt;</p> <p>The file can be downloaded by any engineering or service tool whenever it's connected to the Internet.</p> <p>NOTE More information is provided in PI Order No.: 3.502 (I&amp;M Profile) and related profile definitions referred therein.</p> <p>The string format shall be hexadecimal starting with 0x, e.g. '0x3D00'.</p> |

#### 4.2.4 Protocol version information

IEC 62769-4 defines an element type named InterfaceT for the Catalog XML schema. The element type InterfaceT contains an element named Version which is supposed to provide version information about the applied communication protocol profile. The value has to follow the IEC 62769-4 defined version information schema defined in the element type VersionT. Table 4 describes how to apply the currently known protocol versions defined by the non-profit consortium PROFIBUS & PROFINET International. The general rule is to apply the value "0" for parts of the version information according to IEC 62769-4 that are not used in currently known protocol versions.

**Table 4 – Version mapping examples**

| Protocol / Version                                                                                                                                                                                                              | InterfaceT Version value |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|
| PROFINET Version 2.3                                                                                                                                                                                                            | 2.3.0                    |
| NOTE 1 This Table is just an example since this document cannot foresee how future protocol versions will be defined.                                                                                                           |                          |
| NOTE 2 The currently known PROFINET protocol revision information provides major and minor version information. Leading zeros are not considered in version value evaluation since only the actual decimal values are relevant. |                          |

### 4.3 Associating a Package with a device

#### 4.3.1 Device type identification mapping

The purpose of a device type identification mapping is to enable FDI host systems to compare the scan result against the topology representation in the Information Model. FDI host systems shall also be enabled to determine the FDI Device Package that fits for a device entry contained in the scan result. This will enable the user of an FDI host system to synchronize the Information Model with the actual installation.

The communication server implemented scan service (defined in 4.6.1.7) provides a scan result through an XML document (schema defined in Annex A).

The Gateway implemented scan service (defined in 4.6.2.7) provides a scan result by means of the Information Model that contains data structures created from EDD content as specified in 4.6.2.7.

Common for both ways of presenting the scan result is that scan results contain device type identification and device instance identification.

FDI host systems comparing the actual network topology configuration against the topology representation in the Information Model shall be enabled to handle the following situations:

- The physical Device instance identified at a specific device address is not logically present in the Information model (as Instance): Enable the FDI Host system to find the appropriate FDI Device package according to the device catalogue information.
- The physical Device instance identified by the device address is logically present in the Information Model (as Instance): Enable the FDI Host system to compare the device type information presented in the scan result (see the identification in Clause A.5 and 4.6.2.7) and the device type specific information of the Instance present in the Information Model.

The FDI Device package contains device type identification information that can be compared to the scan result based on the Catalog Schema in IEC 62769-4 which defines the XML element (simple) type “DeviceModel” and “Manufacturer”. Both types are used in (complex) element types “Protocol” and “RegDeviceType”.

As a result of the FDI Package deployment the FDI Package information is then present in the Information Model as specified FunctionalGroup Identification containing VendorID and DeviceID (see 4.4.3).

The mapping between different device identification data sources is described in Table 5. Since scan results provided by the Communication Server or Gateway can convey data that is produced by the device (firmware) the device type identification mapping shall be supported by providing corresponding data in the FDI Device Package contained Catalog and Information Model.

**Table 5 – Device identification information mapping**


| FDI Device Package                     | Information Model                                              | Communication Server provided scan result                                   | Gateway provided scan result                              |
|----------------------------------------|----------------------------------------------------------------|-----------------------------------------------------------------------------|-----------------------------------------------------------|
| Catalog specified type<br>Manufacturer | FunctionalGroup:<br>Identification<br>Browse Name:<br>VendorID | Element (path):<br>ConnectionPoint/Identification<br>Attribute:<br>VendorID | COLLECTION<br>ConnectionPoint.<br>Identification.VendorID |
| Catalog specified type<br>DeviceModel  | FunctionalGroup:<br>Identification<br>Browse Name:<br>DeviceID | Element (path):<br>ConnectionPoint/Identification<br>Attribute:<br>DeviceID | COLLECTION<br>ConnectionPoint.<br>Identification.DeviceID |

### 4.3.2 Device type revision mapping

IEC 62769-4 envisions a concept that allows determining the compatibility between an FDI Device Package and a Device. IEC 62769-4 specifies a life cycle management process bearing on a single version information provided for the entire device.

PROFINET IO related specifications, for example PI Order No.: 2.352:2011 (GSDML) and PI Order No.: 3.502 (I&M), split the device revision into software and hardware related information. These specifications do not outline any rules whether the GSD, GSDML or I&M specified **HARDWARE\_REVISION** is independent from **SOFTWARE\_REVISION**.

The goal of 4.3.2 is to describe the translation rules between the PROFINET IO related specifications describing their way of providing version information and the IEC 62769-4 specified way of containing version information that can be compared against the version read from the device. The purpose is to determine compatibility between an FDI Device Package and a Device (Figure 1 depicts the problem).

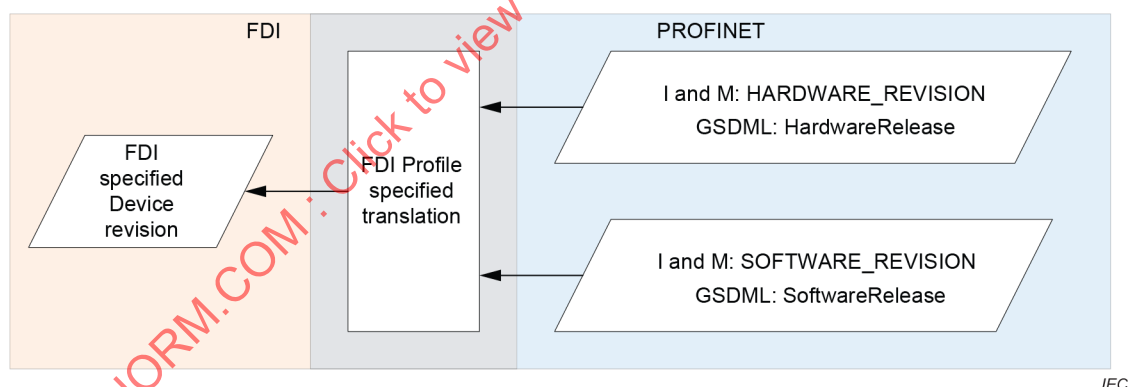**Figure 1 – Version mapping problem**

The firmware of a device implements the data exchange interface which shall be described by means of the FDI Device Package content (EDD). A device firmware that implements the GSD, GSDML or I&M profile enables reading the values **SOFTWARE\_REVISION** and **HARDWARE\_REVISION**. The access to these values shall be described in the FDI Device Package contained EDD.

Firmware modifications that affect the firmware implemented data exchange interface shall be reflected in the FDI Device Package. Such firmware and device description modification shall be visible in the **SOFTWARE\_REVISION**.

Hardware related modifications shall be captured in the **HARDWARE\_REVISION** value. Hardware related modifications do not necessarily require always a firmware update. Thus **HARDWARE\_REVISION** cannot be used to determine compatibility between a device and the

FDI Device Package. But if a hardware modification requires firmware modifications both `HARDWARE_REVISION` and `SOFTWARE_REVISION` shall be changed.

IEC 62769-4 specifies the Catalog schema and an element `DeviceVersion` which is used in the element type declaration `ListOfSupportedDeviceVersions`. The value of `DeviceVersion` shall be compared to the device provided `SOFTWARE_REVISION` in order to determine the compatibility between an FDI Device Package and a Device.

The data format for the `SOFTWARE_REVISION` is a string while the `DeviceVersion` expects three numbers for major, minor, and revision. Therefore the following rules apply: If the string has the format `<integer>.<integer>.<integer>` this is transferred to major, minor, and revision (in the same order). `<integer>` references to simple integer number in the string such as '1' or '12', not to other representations such as hexadecimal format (e.g. 0x001A). If `<integer>.<integer>` is provided, this is transferred to major and minor and '0' is used for revision. If only an `<integer>` is provided, this is transferred to major and '0' is used for minor and revision. A leading character or a leading character and whitespace shall be ignored. For a string in any other format the revision number shall not be considered to select the correct FDI package.

## 4.4 Information Model mapping

### 4.4.1 ProtocolType definition

This document refers to IEC 61158 specified protocols as these are relevant to support the device management related use cases supported through FDI specifications. The scope is limited to data transport from the Information Model to the device.

For example, the device address management is based on services specified in IEC 61158 (all parts). But since the address management service is encapsulated by the IEC 62769-7 specified `SetAddress` service the details of IEC 61158 specified services do not need to be known.

The protocol type `Profinet_IO` shall be used to identify the PROFINET IO communication. The type `Profinet_IO` is a subtype of the abstract type `ProtocolType` (IEC 62541-100). Table 6 specifies the attributes and their values of the Protocol type `Profinet_IO`.

**Table 6 – Protocol type Profinet\_IO**

| Attribute                                             | Value       |            |          |                |               |
|-------------------------------------------------------|-------------|------------|----------|----------------|---------------|
| BrowseName                                            | Profinet_IO |            |          |                |               |
| IsAbstract                                            | False       |            |          |                |               |
| References                                            | NodeClass   | BrowseName | DataType | TypeDefinition | ModellingRule |
| Subtype of the ProtocolType defined in IEC 62541-100. |             |            |          |                |               |

### 4.4.2 DeviceType mapping

The properties mapping of the `DeviceType` node is defined in Table 7.

**Table 7 – DeviceType Property mapping**

| Property         | PROFINET Mapping                                                                       |
|------------------|----------------------------------------------------------------------------------------|
| SerialNumber     | SERIAL_NUMBER (see Table 8)                                                            |
| RevisionCounter  | REV_COUNTER (see Table 8)                                                              |
| Manufacturer     | String taken from FDI package catalog (ManufacturerName from PackageT)                 |
| Model            | String taken from FDI package catalog (Name of DeviceTypeT, which is a localized name) |
| DeviceRevision   | Not supported                                                                          |
| DeviceManual     | Not supported                                                                          |
| SoftwareRevision | SOFTWARE_REVISION (see Table 8)                                                        |
| HardwareRevision | HARDWARE_REVISION (see Table 8)                                                        |

#### 4.4.3 FunctionalGroup identification definition

As defined in IEC 62541-100:2015, 5.3, each device representation in the FDI Server hosted Information Model shall contain a protocol specific FunctionalGroup named Identification. The Parameters of this FunctionalGroup are defined for PROFINET as follows:

**Table 8 – PROFINET identification type definition**

| BrowseName            | DataType   | Mandatory/Optional |
|-----------------------|------------|--------------------|
| VendorID              | UInt16     | Mandatory          |
| DeviceID              | UInt16     | Mandatory          |
| ORDER_ID              | String     | Mandatory          |
| SERIAL_NUMBER         | String     | Mandatory          |
| HARDWARE_REVISION     | UInt16     | Mandatory          |
| SOFTWARE_REVISION     | String     | Mandatory          |
| REV_COUNTER           | UInt16     | Mandatory          |
| PROFILE_ID            | UInt16     | Mandatory          |
| PROFILE_SPECIFIC_TYPE | UInt16     | Mandatory          |
| IM_VERSION            | ByteString | Mandatory          |
| IM_SUPPORTED          | UInt16     | Mandatory          |

The BaseDataVariable instances shall be created from VARIABLE declarations with identifiers that correspond to the browse names listed in Table 8 except the attributes VendorID and DeviceID. The related attribute values shall be taken from the GSD file (4.2.1). The element names VendorID and DeviceID match with the attribute names defined in the GSDML specification.

## 4.5 Topology elements

### 4.5.1 ConnectionPoint definition

In order to support different network topology engineering needs related to different protocol layers used for PROFINET IO the ConnectionPoint type definitions follow the IEC 62769-7 given recommendations about how to handle address information for protocol layers embedded in PROFINET IO.

The ConnectionPoint type ConnectionPoint\_Profinet\_IO shall be used to parameterize PROFINET IO network access points. The ConnectionPoint type Profinet\_IO is a subtype of the

abstract type ConnectionPointType (IEC 62769-5). Table 9 specifies the allowed values of the ConnectionPoint attributes for the protocol type Profinet\_IO.

**Table 9 – ConnectionPoint type for Profinet\_IO**

| Attribute                                                    | Value       |            |           |                |               |
|--------------------------------------------------------------|-------------|------------|-----------|----------------|---------------|
| BrowseName                                                   | Profinet_IO |            |           |                |               |
| IsAbstract                                                   | False       |            |           |                |               |
| References                                                   | NodeClass   | BrowseName | Data Type | TypeDefinition | ModellingRule |
| Subtype of the ConnectionPointType defined in IEC 62541-100. |             |            |           |                |               |
| HasProperty                                                  | Variable    | MAC        | Octet[6]  | PropertyType   | Mandatory     |
| HasProperty                                                  | Variable    | IPv4       | Octet[4]  | PropertyType   | Mandatory     |
| HasProperty                                                  | Variable    | DNSNAME    | String    | PropertyType   | Mandatory     |
| HasProperty                                                  | Variable    | VALID      | Boolean   | PropertyType   | Mandatory     |

The ConnectionPoint type Profinet\_IO shall be described by an EDD element contained in a Communication Device related FDI Package that can drive a PROFINET IO network. Actual ConnectionPoint properties are declared by VARIABLE constructs grouped together in a COLLECTION named ConnectionPoint.

Variable MAC is an array of 6 bytes holding the MAC address. The value is a unique identifier assigned to network interfaces that support IEEE 802.3 specified communication. The value can only be read from the device for example during execution of the scan service.

Variable IPv4 is an array of 4 bytes holding the IP-Address.

NOTE 1 Formatting of an IP-Address results typically in a character string that consists of four “.” separated, 1..3-digit decimal numbers (example 128.12.1.15). The EDDL specification according to IEC 61804-3 and IEC 61804-4 does not support formatting instructions for the OCTECT type. But since semantics of the VARIABLE definitions made in this part of IEC 62769 are defined, it is assumed that system can render VARIABLE values accordingly.

Variable DNSNAME holds the station name. The station name syntax shall follow the Domain Name System (DNS) related specifications.

NOTE 2 The Domain Name System (DNS) is a hierarchical naming system that translates domain names meaningful to humans into the numerical identifiers associated with networking equipment for the purpose of locating and addressing these devices. The specifications of the rules for forming domain names appear in IETF RFC 1035, IETF RFC 1123 and IETF RFC 2181.

The Variable Valid indicates whether the stored address information is valid.

```

COMPONENT ConnectionPoint_PROFINET_IO
{
    LABEL "PROFINET IO Connection point";
    CAN_DELETE FALSE;
    PROTOCOL PROFINET;
}

VARIABLE MAC
{
    LABEL "MAC address";
    HELP "Unique network visible device identifier";
    CLASS DEVICE;
    TYPE OCTET(6);
    HANDLING READ;
    CLASS LOCAL;
}

VARIABLE IPv4
{

```

```

    LABEL "IP Address";
    HELP "IP v4 address";
    CLASS DEVICE;
    TYPE OCTET(4);
    HANDLING READ & WRITE;
    CLASS LOCAL;
}

VARIABLE DNS_Name
{
    LABEL "DNS Name";
    HELP "Station name";
    CLASS DEVICE;
    TYPE BITSTRING(256);
    HANDLING READ & WRITE;
    CLASS LOCAL;
}

COLLECTION ConnectionPoint
{
    LABEL "PROFINET Connection Point data";
    MEMBERS
    {
        CONNECTION_POINT_MAC, MAC;
        CONNECTION_POINT_IPV4, IPV4;
        CONNECTION_POINT_DNS_NAME, DNS_Name;
    }
}

```

#### 4.5.2 Communication Device definition

According to IEC 62769-7 each FDI Communication Package shall contain an EDD element describing the device. The following EDDL source code is an example describing a Communication Server.

```

COMPONENT PROFINET_Communication_Server
{
    LABEL "PROFINET communication server";
    PRODUCT_URI "urn:PROFIBUS International: PROFINET Communication Server";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMPONENT;
    COMPONENT_RELATIONS
    {
        PROFINET_Communication_Device_Setup
    }
}

COMPONENT_RELATION PROFINET_Communication_Device_Setup
{
    LABEL "Relation between Device and communication device";
    RELATION_TYPE CHILD_COMPONENT;
    COMPONENTS
    {
        PROFINET_Communication_Device{AUTO_CREATE 1;}
    }
    MINIMUM_NUMBER 1;
    MAXIMUM_NUMBER 2;
}

```

According to IEC 62769-7, each FDI Communication Package shall contain at least one EDD element describing at least one communication device component. The following EDDL source code example shows how to describe a PROFINET IO communication device:

```

COMPONENT PROFINET_Communication_Device
{
    LABEL "PROFINET communication device";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMPONENT;
    COMPONENT_RELATIONS

```

```

{
    Profinet_Service_Provider_Relation
}

COMPONENT_RELATION Profinet_Service_Provider_Relation
{
    LABEL " Relation to communication service provider ";
    RELATION_TYPE CHILD_COMPONENT;
    COMPONENTS
    {
        PROFINET_Service_Provider{AUTO_CREATE 1;}
    }
    MINIMUM_NUMBER 1;
    MAXIMUM_NUMBER 2;
}

```

In an actual communication device, the value “Profinet\_Service\_Provider” needs to be adapted according to the identifier of the COMPONENT declaration that describes the communication service provider.

#### 4.5.3 Communication service provider definition

According to IEC 62769-7, each FDI Communication Package shall contain at least one EDD element describing at least one communication service provider component. The following EDDL source code example shows how to describe a PROFINET IO communication service provider component.

The component reference (ConnectionPoint\_PROFINET\_IO) corresponds to the related connection point definitions given in 4.5. The attribute BYTE\_ORDER value is to be set according to the protocol.

```

COMPONENT PROFINET_Service_Provider
{
    LABEL "PROFINET communication service provider";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMMUNICATION_SERVICE_PROVIDER;
    COMPONENT_RELATIONS
    {
        PROFINET_Service_Provider_Connection_Point_Relation
    }
    BYTE_ORDER BIG_ENDIAN;
}

COMPONENT_RELATION PROFINET_Service_Provider_Connection_Point_Relation
{
    LABEL "Relation between communication service provider and connection point";
    RELATION_TYPE CHILD_COMPONENT;
    ADDRESSING {DNS_Name}
    COMPONENTS
    {
        ConnectionPoint_PROFINET_IO{ AUTO_CREATE 1;}
    }
    MINIMUM_NUMBER 1;
    MAXIMUM_NUMBER 1;
}

```

#### 4.5.4 Network definition

According to IEC 62769-7, each FDI Communication Package shall contain at least one EDD element describing network configuration constraints using the component construct.

```
COMPONENT Network_PROFINET
{
    LABEL "PROFINET IO Network";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMPONENT;
    COMPONENT_RELATIONS
    {
        PROFINET_IO_Network_Connection_Point_Relation
    }
}

COMPONENT_RELATION PROFINET_IO_Network_Connection_Point_Relation
{
    LABEL "Relation between network and connection point";
    RELATION_TYPE CHILD_COMPONENT;
    ADDRESSING {DNS_Name}
    COMPONENTS
    {
        ConnectionPoint_PROFINET_IO
    }
}
```

#### 4.6 Methods

##### 4.6.1 Methods for FDI Communication Servers

###### 4.6.1.1 General

The Communication Server contained Information Model shall implement services according to the method signatures described in 4.6.1.

###### 4.6.1.2 Connect

**Signature:**

```
Connect (
    [in]   ByteString      CommunicationRelationId,
    [in]   String          DNSNAME,
    [in]   UInt16          DeviceID,
    [in]   UInt16          VendorID,
    [out]  Int32            ServiceError);
```

Table 10 provides the description of the arguments.

**Table 10 – Method Connect arguments**

| Argument                | Description                                                                                                                                                                                                                                                                    |
|-------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | The argument value contains the nodeId of the ConnectionPoint representing the connection between a device and a physical network which is directly connected to the communication server hardware. The nodeId allows finding the direct parent-child relation.                |
| DNSNAME                 | The argument name shall match with the corresponding attribute name defined for the ConnectionPoint which is described by a corresponding EDD element specified in 4.5. The argument value holds the device's network address.                                                 |
| DeviceId                | The argument value holds the manufacturer defined device identification number. (See GSDML "Attributes of element DeviceIdentity".)                                                                                                                                            |
| VendorId                | The argument value holds the PNO defined manufacturer identification number. (See GSDML "Attributes of element DeviceIdentity".)                                                                                                                                               |
| ServiceError            | 0: OK/execution finished, connection established successfully<br>-1: Connect Failed/canceled by caller<br>-3: Connect Failed/device not found<br>-4: Connect Failed/invalid device address<br>-5: Connect Failed/invalid DeviceId<br>-6: Connect Failed/invalid ManufacturerId |

Remarks: The ConnectionPoint defined for PROFINET IO holds more address attribute values than used for the connect service. The reason is that any exchange of record data with the device requires that address assignment is completed. Once address assignment is done, the DNSNAME is sufficient to address the device. The MAC address could be used for device type and instance verification purpose but this has been already done during the address assignment.

#### 4.6.1.3 Disconnect

##### Signature:

```

Disconnect (
    [in]   ByteString      CommunicationRelationId,
    [out]  Int32            ServiceError)

```

Table 11 provides the description of the arguments.

**Table 11 – Method Disconnect arguments**

| Argument                | Description                                                                                                                                                                                                                                                     |
|-------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | The argument value contains the nodeId of the ConnectionPoint representing the connection between a device and a physical network which is directly connected to the communication server hardware. The nodeId allows to find the direct parent-child relation. |
| ServiceError            | 0: OK/disconnect finished successfully<br>-1: Disconnect Failed/no existing communication relation<br>-2: Disconnect Failed/invalid communication relation identifier                                                                                           |

#### 4.6.1.4 Transfer

##### Signature

```

Transfer (
    [in]   ByteString   CommunicationRelationId,
    [in]   String       OPERATION,
    [in]   UInt16       SLOT,
    [in]   UInt16       SUBSLOT,
    [in]   UInt16       INDEX,
    [in]   UInt32       API,
    [in]   ByteString   REQUEST,
    [out]  ByteString   REPLY,
    [out]  ByteString   RESPONSE_CODES
    [out]  Int32        ServiceError);

```

Table 12 provides the description of the arguments.

**Table 12 – Method Transfer arguments**

| Argument                | Description                                                                                                                                                                                                                                                                                             |
|-------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | The argument value contains the nodeId of the ConnectionPoint representing the connection between a device and a physical network within the Information Model.                                                                                                                                         |
| OPERATION               | The argument value indicates the data transfer direction. Allowed values are "READ" and "WRITE".                                                                                                                                                                                                        |
| SLOT                    | The argument name shall match with the corresponding COMMAND – attribute name SLOT. The argument value shall come from the attribute value of COMMAND – attribute SLOT of the corresponding COMMAND that shall be processed.                                                                            |
| SUBSLOT                 | The argument name shall match with the corresponding COMMAND – attribute name SUBSLOT. The argument value shall come from the attribute value of COMMAND – attribute SUBSLOT of the corresponding COMMAND that shall be processed.                                                                      |
| INDEX                   | The argument name shall match with the corresponding COMMAND – attribute name INDEX. The argument value shall come from attribute value of COMMAND – attribute INDEX of the corresponding COMMAND that shall be processed.                                                                              |
| API                     | The argument is not supported by current COMMAND description. The default value for this argument is 0.                                                                                                                                                                                                 |
| REQUEST                 | The argument name shall match with the corresponding COMMAND sub-element name REQUEST. The byte stream submitted through the argument is created from definitions provided by the REQUEST element of the corresponding COMMAND that shall be processed.                                                 |
| REPLY                   | The argument name shall match with corresponding COMMAND sub-element name REPLY. The byte stream returned by this argument applies to definitions provided by the REPLY element of the corresponding COMMAND that shall be processed.                                                                   |
| RESPONSE_CODES          | The argument name shall match with the COMMAND sub-element name RESPONSE_CODES. The argument value conveys the PROFINET specific communication service response bytes.                                                                                                                                  |
| ServiceError            | 0: OK/execution finished<br>-1: Transfer Failed/canceled by caller<br>-3: Transfer Failed/no existing communication relation<br>-4: Transfer Failed/invalid communication relation identifier<br>-5: Transfer Failed/invalid sendData content<br>-6: Transfer Failed/invalid receiveData formatProfinet |

#### 4.6.1.5 GetPublishedData

This method is not supported by PROFINET IO.

#### 4.6.1.6 SetAddress

##### Signature

```
SetAddress (
    [in]  byte[6]  MAC,
    [in]  byte[4]  IP,
    [in]  String   DNSNAME,
    [in]  byte[4]  SubnetMask,
    [in]  byte[4]  Gateway,
    [out] Int32     ServiceError);
```

Table 13 provides the description of the arguments.

**Table 13 – Method SetAddress arguments**

| Argument     | Description                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
|--------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| MAC          | The argument value holds the unique identifier of a device. The argument name matches with the name of Topology elements<br>ConnectionPoint property MAC is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |
| IP           | The argument value holds the new IP address for a device. The argument name matches with the name of the Topology elements<br>ConnectionPoint property IP is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| DNSNAME      | The argument value holds the new DNSNAME (station name) for a device. The argument name matches with the name of the Topology elements<br>ConnectionPoint property DNSNAME is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| SubnetMask   | The argument value holds the new SubnetMask (station name) for a device. The argument name matches with the name of the Topology elements<br>ConnectionPoint property SubnetMask is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| Gateway      | The argument value holds the new Gateway (station name) for a device. The argument name matches with the name of the Topology elements<br>ConnectionPoint property Gateway is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| ServiceError | 0: OK/execution finished successfully<br>-1: SetAddress Failed/canceled by caller<br>-3: SetAddress Failed/not initialized<br>-4: SetAddress Failed/not connected to a network<br>-5: SetAddress Failed/no device found responding to MAC<br>-6: SetAddress Failed/duplicate address error<br>-7: SetAddress Failed/device did not accept new address<br>-8: SetAddress Failed/invalid argument MAC<br>-9: SetAddress Failed/invalid argument IP<br>-10: SetAddress Failed/invalid argument DNSNAME<br>-11: SetAddress Failed/invalid argument SubnetMask<br>-12: SetAddress Failed/invalid argument Gateway<br>-13: SetAddress Failed/not possible in status connected |

The service SetAddress corresponds with the IEC 61158-5-10 specified DCP ASE service set.

#### 4.6.1.7 Scan

The method signature specified in IEC 62769-7 applies. The corresponding topologyScanResult schema is specified in Annex A. The scan service maps to the PROFINET IO DCP ASE specified service Identify according to IEC 61158-5-10.

#### 4.6.1.8 ResetScan

The method signature specified in IEC 62769-7 applies.

### 4.6.2 Methods for Gateways

#### 4.6.2.1 General

The methods signatures defined in 4.6.2 shall apply. The methods shall be implemented in the EDD element (IEC 62769-4) contained in a Gateway related FDI Package containing the communication device definitions.

#### 4.6.2.2 Connect

Subclause 4.6.2.2 describes the PROFINET Gateway specific implementation of the service Connect specified in IEC 62769-7.

```

METHOD BeginConnect(
    DD_STRING      CommunicationRelationId,
    DD_STRING      DNSNAME,
    unsigned int    DeviceID,
    unsigned int    VendorID,
    unsigned long   ServiceID,
    unsigned long   &DelayForNextCall,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD EndConnect(
    DD_STRING      CommunicationRelationId,
    unsigned long   ServiceID,
    unsigned long   &DelayForNextCall,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD CancelConnect(
    DD_STRING      CommunicationRelationId,
    unsigned long   ServiceID,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

```

Table 14 provides the description of the arguments.

**Table 14 – Method Connect arguments**

| Argument                | Description                                                                                                                                                                                                                                                                                                                                                                                             |
|-------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | The argument value contains the nodeId of the ConnectionPoint representing the connection between a device and a physical network which is directly connected to the communication server hardware. The nodeId allows finding the direct parent-child relation.                                                                                                                                         |
| DNSNAME                 | The argument name shall match with the corresponding attribute name defined for the ConnectionPoint which is described by a corresponding EDD element specified in 4.5. The argument value holds the device's network address.                                                                                                                                                                          |
| DeviceID                | The argument value holds the manufacturer defined device identification number (see GSDML "Attributes of element DeviceIdentity").                                                                                                                                                                                                                                                                      |
| VendorID                | The argument value holds the PNO defined manufacturer identification number (see GSDML "Attributes of element DeviceIdentity").                                                                                                                                                                                                                                                                         |
| ServiceId               | The service transaction code establishes the relation between the service request and the corresponding response.                                                                                                                                                                                                                                                                                       |
| DelayForNextCall        | The value specifies a delay time in ms to limit the EndConnect invocation cycle that shall not be faster than specified in the argument value.                                                                                                                                                                                                                                                          |
| ServiceError            | 1: OK/function started asynchronously, result has to be polled with EndConnect<br>0: OK/execution finished, connection established successfully<br>-1: Connect Failed / canceled by caller<br>-2: Call Failed/unknown ServiceId<br>-3: Connect Failed/device not found<br>-4: Connect Failed/invalid device address<br>-5: Connect Failed/invalid DeviceId<br>-6: Connect Failed/invalid ManufacturerId |

#### 4.6.2.3 Disconnect

Subclause 4.6.2.3 describes the PROFINET specific implementation of the service Disconnect specified in IEC 62769-7.

```

METHOD Disconnect(
    DD_STRING      CommunicationRelationId,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

```

All the arguments of the Disconnect method are described in Table 11.

#### 4.6.2.4 Transfer

Subclause 4.6.2.4 describes the PROFINET specific implementation of the service Transfer specified in IEC 62769-7.

```

METHOD BeginTransfer(
    DD_STRING      CommunicationRelationId,
    DD_STRING      OPERATION,
    unsigned short  SLOT,
    unsigned short  SUBSLOT,
    unsigned short  INDEX,
    unsigned long   API,
    DD_STRING      REQUEST,
    DD_STRING      &REPLY,
    DD_STRING      &RESPONSE_CODES,
    unsigned long   ServiceId,
    unsigned long   &DelayForNextCall,
    long           &ServiceError)

```

```

{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD EndTransfer(
    DD_STRING    CommunicationRelationId,
    DD_STRING    &REPLY,
    DD_STRING    &RESPONSE_CODES,
    unsigned long ServiceId,
    unsigned long &DelayForNextCall,
    long         &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD CancelTransfer(
    DD_STRING    CommunicationRelationId,
    unsigned long ServiceId,
    long         &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

```

Table 15 provides the description of the arguments.

**Table 15 – Method Transfer arguments**

| Argument                | Description                                                                                                                                                                                                                                             |
|-------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | The argument value contains the nodeId of the ConnectionPoint representing the connection between a device and a physical network within the Information Model.                                                                                         |
| OPERATION               | The argument value indicates data transfer direction. Allowed values are "READ" and "WRITE".                                                                                                                                                            |
| SLOT                    | The argument name shall match with the corresponding COMMAND – attribute name SLOT. The argument value shall come from the attribute value of COMMAND – attribute SLOT of the corresponding COMMAND that shall be processed.                            |
| SUBSLOT                 | The argument name shall match with the corresponding COMMAND – attribute name SUBSLOT. The argument value shall come from the attribute value of COMMAND – attribute SUBSLOT of the corresponding COMMAND that shall be processed.                      |
| API                     | The argument is not supported by the current COMMAND description. The default value for this argument is 0.                                                                                                                                             |
| INDEX                   | The argument name shall match with the corresponding COMMAND – attribute name INDEX. The argument value shall come from the attribute value of COMMAND – attribute INDEX of the corresponding COMMAND that shall be processed.                          |
| REQUEST                 | The argument name shall match with the corresponding COMMAND sub-element name REQUEST. The byte stream submitted through the argument is created from definitions provided by the REQUEST element of the corresponding COMMAND that shall be processed. |
| REPLY                   | The argument name shall match with the corresponding COMMAND sub-element name REPLY. The byte stream returned by this argument applies to definitions provided by the REPLY element of the corresponding COMMAND that shall be processed.               |
| RESPONSE_CODES          | The argument name shall match with the COMMAND sub-element name RESPONSE_CODES. The argument value conveys the PROFINET specific communication service response bytes.                                                                                  |
| ServiceId               | The service transaction code establishes the relation between the service request and the corresponding response.                                                                                                                                       |
| DelayForNextCall        | The value specifies a delay time in ms to limit the EndTransfer invocation cycle that shall not be faster than specified in the argument value.                                                                                                         |

| Argument     | Description                                                                                                                                                                                                                                                                                                                                                                                                                       |
|--------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| ServiceError | 1: OK/function started asynchronously, result has to be polled with EndTransfer<br>0: OK/execution finished<br>-1: Transfer Failed/canceled by caller<br>-2: Call Failed/unknown service ID<br>-3: Transfer Failed/no existing communication relation.<br>-4: Transfer Failed/invalid communication relation identifier<br>-5: Transfer Failed/invalid sendData content<br>-6: Transfer Failed/invalid receiveData formatProfinet |

#### 4.6.2.5 GetPublishedData

This method is not supported in PROFINET.

#### 4.6.2.6 SetAddress

Subclause 4.6.2.6 describes the PROFINET specific implementation of the service SetAddress specified in IEC 62769-7.

```

METHOD BeginSetAddress (
    DD_STRING    MAC,
    DD_STRING    IP,
    DD_STRING    DNSNAME,
    DD_STRING    SubnetMask,
    DD_STRING    Gateway,
    unsigned long ServiceId,
    unsigned long &DelayForNextCall,
    long         &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD EndSetAddress (
    unsigned long ServiceId,
    unsigned long &DelayForNextCall,
    long         &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD CancelSetAddress (
    unsigned long ServiceId,
    long         &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}
    
```

Table 16 provides the description of the arguments.

**Table 16 – Method SetAddress arguments**

| Argument         | Description                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |
|------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| MAC              | The argument value holds the unique identifier of a device. The argument name matches with the name of Topology elements.<br>ConnectionPoint property MAC is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
| IP               | The argument value holds the new IP address for a device. The argument name matches with the name of Topology elements.<br>ConnectionPoint property IP is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| DNSNAME          | The argument value holds the new DNSNAME (station name) for a device. The argument name matches with the name of Topology elements<br>ConnectionPoint property DNSNAME is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| SubnetMask       | The argument value holds the new SubnetMask (station name) for a device. The argument name matches with the name of Topology elements<br>ConnectionPoint property SubnetMask is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
| Gateway          | The argument value holds the new Gateway (station name) for a device. The argument name matches with the name of Topology elements<br>ConnectionPoint property Gateway is defined in Table 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| ServiceId        | The service transaction code establishes the relation between the service request and the corresponding response.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| DelayForNextCall | The value specifies a delay time in ms to limit the EndTransfer invocation cycle that shall not be faster than specified in the argument value.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |
| ServiceError     | 1: OK/function started asynchronously, result has to be polled with EndSetAddress<br>0: OK/execution finished successfully<br>-1: SetAddress Failed/canceled by caller<br>-2: Call Failed / unknown service ID<br>-3: SetAddress Failed/not initialized<br>-4: SetAddress Failed/not connected to a network<br>-5: SetAddress Failed/no device found responding to MAC<br>-6: SetAddress Failed/duplicate address error<br>-7: SetAddress Failed/device did not accept new address<br>-8: SetAddress Failed/invalid argument MAC<br>-9: SetAddress Failed/invalid argument IP<br>-10: SetAddress Failed/invalid argument DNSNAME<br>-11: SetAddress Failed/invalid argument SubnetMask<br>-12: SetAddress Failed/invalid argument Gateway<br>-13: SetAddress Failed/not possible in status connected |

**4.6.2.7 Scan**

The method signature specified in IEC 62769-7 applies. The PROFINET gateway business logic shall create the scan result following IEC 62769-7. The following definitions shall be present in the COMPONENT declaration that holds the definitions for a communication device. The data structure corresponds to the data structure defined in the XML schema described in Annex A. The SCAN\_LIST attribute inside COMPONENT declaration shall refer to LIST TopologyScanResult.

```

VARIABLE mDNSName
{
    LABEL "Device station name";
    TYPE BITSTRING(256);
    CLASS LOCAL;
}

```

```

VARIABLE mMAC
{
    LABEL "Device MAC Address";
    TYPE OCTET(6);
    CLASS LOCAL;
}

VARIABLE mIPv4
{
    LABEL "Device IP Address";
    TYPE OCTET(4);
    CLASS LOCAL;
}

VARIABLE mSubnetMask
{
    LABEL "Subnet mask";
    TYPE OCTET(4);
    CLASS LOCAL;
}

VARIABLE mGateway
{
    LABEL "Gateway IP Address";
    TYPE OCTET(4);
    CLASS LOCAL;
}

VARIABLE mVendorID
{
    LABEL "Manufacturer identification";
    TYPE UNSIGNED_INTEGER(4);
    CLASS LOCAL;
}

VARIABLE mDeviceID
{
    LABEL "Manufacturer's Device identification";
    TYPE UNSIGNED_INTEGER(4);
    CLASS LOCAL;
}

COLLECTION ProfinetIdentificationType
{
    MEMBERS
    {
        VendorID, mVendorID;
        DeviceID, mDeviceID;
    }
}

COLLECTION ConnectionPoint
{
    MEMBERS
    {
        MAC, mMAC;
        IPv4, mIPv4;
        DNSName, mDNSName;
        SubnetMask, mSubnetMask;
        Gateway, mGateway;
        Identification, ProfinetIdentificationType;
    }
}

LIST Network
{
    TYPE ConnectionPoint;
}

```

}

#### **4.6.2.8 ScanNext**

The method signature specified in IEC 62769-7 applies. The PROFIBUS gateway business logic shall create the scan result following IEC 62769-7. Method ScanNext stores the result into data structures described for the method Scan (4.6.2.7).

IECNORM.COM : Click to view the full PDF of IEC 62769-103-4:2020

## Annex A (normative)

### Topology scan schema

#### A.1 General

The topology scan result schema specified in Annex A describes the PROFINET specific format Method Scan argument `topologyScanResult`. The XML document content and structure shall correspond to the Information Model designed concept to describe a topology in order to enable generic matching between physical devices connected to the network and the FDI Server hosted Information Model.

#### A.2 Network

The subsequent element is used to return the scan result corresponding to the Information Model described in IEC 62769-5.

The XML schema for a Network element is:

```
<xs:element name="Network" type="PI:ProfinetNetworkT"/>
```

#### A.3 ProfinetNetworkT

The XML schema for a ProfinetNetworkT type is:

```
<xs:complexType name="ProfinetNetworkT">
  <xs:sequence maxOccurs="unbounded">
    <xs:element name="ConnectionPoint"
      type="PI:ProfinetConnectionPointT"/>
  </xs:sequence>
</xs:complexType>
```

The elements of a ProfinetNetworkT type are described in Table A.1.

**Table A.1 – Elements of ProfinetNetworkT**

| Element         | Description                                                                                                                                      |
|-----------------|--------------------------------------------------------------------------------------------------------------------------------------------------|
| ConnectionPoint | The ConnectionPoint element holds the address and identification of the network connected device that has been found during bus scan operations. |

#### A.4 ProfinetConnectionPointT

The XML schema for a ProfinetConnectionPointT type is:

```
<xs:complexType name="ProfinetConnectionPointT">
  <xs:sequence>
    <xs:element name="Identification"
      type="PI:ProfinetIdentificationT"/>
  </xs:sequence>
  <xs:attribute name="MAC" type="PI:MACT" use="required"/>
  <xs:attribute name="IPv4" type="PI:IPv4T" use="optional"/>
  <xs:attribute name="DNSName" type="PI:DNSNameT" use="optional"/>
</xs:complexType>
```

```

<xs:attribute name="SubnetMask" type="PI:IPv4T" use="optional"/>
<xs:attribute name="Gateway" type="PI:IPv4T" use="optional"/>
</xs:complexType>

```

The attributes of a ProfinetConnectionPointT type are described in Table A.2.

**Table A.2 – Attributes of ProfinetConnectionPointT**

| Attribute  | Description                                                                          |
|------------|--------------------------------------------------------------------------------------|
| MAC        | The attribute value holds the devices MAC address.                                   |
| IPv4       | The attribute value holds the IP/V4 address.                                         |
| DNSname    | The attribute holds the station name formatted after the "Domain Name System" (DNS). |
| SubnetMask | The attribute value holds the IP/V4 subnet mask.                                     |
| Gateway    | The attribute value holds the IP/V4 address of the gateway.                          |

The elements of a ProfinetConnectionPointT type are described in Table A.3.

**Table A.3 – Elements of ProfinetConnectionPointT**

| Element        | Description                                                                                                                                                 |
|----------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Identification | The Identification element holds the device type identification information of the network connected device that has been found during bus scan operations. |

## A.5 ProfinetIdentificationT

This type declaration corresponds partially to the "FunctionalGroup Identification".

The XML schema for a ProfinetIdentificationT type is:

```

<xs:complexType name="ProfinetIdentificationT">
  <xs:attribute name="VendorID" type="PI:Hex4DigitT" use="required"/>
  <xs:attribute name="DeviceID" type="PI:Hex4DigitT" use="required"/>
</xs:complexType>

```

The attributes of a ProfinetIdentificationT type are described in Table A.4.

**Table A.4 – Attributes of ProfinetIdentificationT**

| Attribute | Description                                                                                                                                                                                                      |
|-----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| VendorID  | The attribute value contains the vendor specific part of the device identification number (DeviceIdentNumber) as defined in IEC 61158-5-10. The attribute corresponds to the GSDML defined attribute "VendorID". |
| DeviceID  | The attribute value contains the device specific part of the device identification number (DeviceIdentNumber). The attribute corresponds to the GSDML defined attribute "DeviceID".                              |

## A.6 MACT

The XML schema for a MACT type is:

```
<xs:simpleType name="MACT">
  <xs:restriction base="xs:string">
    <xs:pattern value="([0-9a-fA-F][0-9a-fA-F]){5}([0-9a-fA-F][0-9a-fA-F])"/>
  </xs:restriction>
</xs:simpleType>
```

## A.7 IPv4T

The XML schema for an IPv4T type is:

```
<xs:simpleType name="IPv4T">
  <xs:restriction base="xs:string">
    <xs:pattern value="((25[0-5]|2[0-4][0-9]|[01]?[0-9]?[0-9])\.){3}(25[0-5]|2[0-4][0-9]|[01]?[0-9]?[0-9])"/>
  </xs:restriction>
</xs:simpleType>
```

## A.8 IPv6T

The XML schema for an IPv6T type is:

```
<xs:simpleType name="IPv6T">
  <xs:restriction base="xs:string">
    <xs:pattern value="([A-Fa-f0-9]{1,4}){7}[A-Fa-f0-9]{1,4})"/>
  </xs:restriction>
</xs:simpleType>
```

## A.9 DNSNameT

The XML schema for a DNSNameT type is:

```
<xs:simpleType name="DNSNameT">
  <xs:restriction base="xs:string">
    <xs:pattern value="[0-9a-zA-Z]([0-9a-zA-Z\-\_]{0,61}[0-9a-zA-Z\-\_]?)?(\.[0-9a-zA-Z]([0-9a-zA-Z\-\_]{0,61}[0-9a-zA-Z\-\_]?)?)*"/>
  </xs:restriction>
</xs:simpleType>
```

## A.10 Hex4DigitT

The XML schema for a Hex4DigitT type is:

```
<xs:simpleType name="Hex4DigitT">
  <xs:restriction base="xs:string">
    <xs:pattern value="[0][x][0-9a-fA-F]{1,4}"/>
  </xs:restriction>
</xs:simpleType>
```

## Annex B (normative)

### Transfer service parameters

#### B.1 General

Direct Access Services specified in IEC 62769-2 enable the User Interface Plug-in (UIP) to directly exchange data with the device. Direct data exchange means that data exchanged between a device and a UIP is not reflected in the Information Model. The IEC 62769-6 defined interface IDirectAccess corresponds to the IEC 62769-2 specified Direct Access Services. Interface IDirectAccess defined functions BeginTransfer and EndTransfer need to convey protocol specific information. The protocol specifics shall be captured in an XML document. The following specifies the XML document schema.

#### B.2 sendData

The element described in the following contains data to be submitted through the IDirectAccess function BeginTransfer defined argument sendData.

The XML schema for a sendData element is:

```
<xs:element name="sendData" type="PI:TransferSendDataT"/>
```

#### B.3 receiveData

The element described in the following contains data that is returned through the IDirectAccess function EndTransfer defined return value.

The XML schema for a receiveData element is:

```
<xs:element name="receiveData" type="PI:TransferResultDataT"/>
```

#### B.4 TransferSendDataT

A complex type that defines the service parameter data format that shall be applied to Transfer defined argument sendData.

The XML schema for a TransferSendDataT type is:

```
<xs:complexType name="TransferSendDataT">
  <xs:attribute name="OPERATION" type="PI:OperationT"
    use="required"/>
  <xs:attribute name="SLOT" type="xs:unsignedShort" use="required"/>
  <xs:attribute name="SUBSLOT" type="xs:unsignedShort"
    use="required"/>
  <xs:attribute name="INDEX" type="xs:unsignedShort" use="required"/>
  <xs:attribute name="API" type="xs:unsignedInt" use="required"/>
  <xs:attribute name="REQUEST" type="xs:hexBinary" use="required"/>
</xs:complexType>
```

The attributes of a TransferSendDataT type are described in Table B.1.

**Table B.1 – Attributes of TransferSendDataT**

| Attribute | Description                                                          |
|-----------|----------------------------------------------------------------------|
| OPERATION | The attribute corresponds to the Transfer method argument OPERATION. |
| SLOT      | The attribute corresponds to the Transfer method argument SLOT.      |
| SUBSLOT   | The attribute corresponds to the Transfer method argument SUBSLOT.   |
| INDEX     | The attribute corresponds to the Transfer method argument INDEX.     |
| API       | The attribute corresponds to the Transfer method argument API.       |
| REQUEST   | The attribute corresponds to the Transfer method argument REQUEST.   |

## B.5 TransferResultDataT

A complex type that defines the service parameter data format that shall be applied to Transfer defined receivedData return value.

The XML schema for a TransferResultDataT type is:

```
<xs:complexType name="TransferResultDataT">
  <xs:attribute name="REPLY" type="xs:hexBinary" use="required"/>
  <xs:attribute name="RESPONSE_CODES" type="xs:hexBinary"
    use="required"/>
</xs:complexType>
```

The attributes of a TransferResultDataT type are described in Table B.2.

**Table B.2 – Attributes of TransferResultDataT**

| Attribute      | Description                                                               |
|----------------|---------------------------------------------------------------------------|
| REPLY          | The attribute corresponds to the Transfer method argument REPLY.          |
| RESPONSE_CODES | The attribute corresponds to the Transfer method argument RESPONSE_CODES. |

## B.6 OperationT

A simple type that defines possible service operations.

The XML schema for an OperationT enumeration type is:

```
<xs:simpleType name="OperationT">
  <xs:restriction base="xs:string">
    <xs:enumeration value="READ"/>
    <xs:enumeration value="WRITE"/>
  </xs:restriction>
</xs:simpleType>
```

## Bibliography

IEC 61784-1, *Industrial communication networks - Profiles Part 1: Fieldbus profiles*

IEC 61804-4, *Function blocks (FB) for process control and electronic device description language (EDDL) - Part 4: EDD interpretation*

ISO/IEC 11578, *Information technology – Open Systems Interconnection – Remote Procedure Call (RPC)*

ISO 15745-4:2003, *Industrial automation systems and integration — Open systems application integration framework — Part 4: Reference description for Ethernet-based control systems*

IEEE Std 802.3, *IEEE Standard for Ethernet*

PI Order No.: 2.352:2011, *GSDML Specification for PROFINET IO*, available at <www.profinet.com> [viewed 2018-11-27]

PI Order No.: 3.502:2009, *Profile Guidelines – Part 1: Identification & Maintenance Function*, available at <www.profinet.com> [viewed 2018-11-27]

IETF RFC 791: *Internet Protocol*, available at <www.rfc-editor.org> [viewed 2018-11-27]

IETF RFC 1035: *Domain names – implementation and specification*, available at <www.rfc-editor.org> [viewed 2018-11-27]

IETF RFC 1123: *Requirements for Internet Hosts – Application and Support*, available at <www.rfc-editor.org> [viewed 2018-11-27]

IETF RFC 2181: *Clarifications to the DNS Specification*, available at <www.rfc-editor.org> [viewed 2018-11-27]

---

## SOMMAIRE

|                                                                   |    |
|-------------------------------------------------------------------|----|
| AVANT-PROPOS .....                                                | 36 |
| 1 Domaine d'application .....                                     | 38 |
| 2 Références normatives .....                                     | 38 |
| 3 Termes, définitions, abréviations et conventions .....          | 39 |
| 3.1 Termes et définitions .....                                   | 39 |
| 3.2 Abréviations .....                                            | 39 |
| 3.3 Conventions .....                                             | 39 |
| 3.3.1 Syntaxe EDDL .....                                          | 39 |
| 3.3.2 Syntaxe XML .....                                           | 39 |
| 3.3.3 Majuscules .....                                            | 39 |
| 4 Profil pour PROFINET .....                                      | 40 |
| 4.1 Généralités .....                                             | 40 |
| 4.2 Profil de catalogue .....                                     | 40 |
| 4.2.1 Fichier de prise en charge de protocole .....               | 40 |
| 4.2.2 Définition de CommunicationProfile .....                    | 41 |
| 4.2.3 Appareil de profil .....                                    | 41 |
| 4.2.4 Informations relatives à la version de protocole .....      | 41 |
| 4.3 Association d'un Paquetage avec un appareil .....             | 42 |
| 4.3.1 Mapping d'identification du type d'appareil .....           | 42 |
| 4.3.2 Mapping des révisions de type d'appareil .....              | 43 |
| 4.4 Mapping du Modèle d'Information .....                         | 44 |
| 4.4.1 Définition de ProtocolType .....                            | 44 |
| 4.4.2 Mapping de DeviceType .....                                 | 45 |
| 4.4.3 Définition du FunctionalGroup «Identification» .....        | 45 |
| 4.5 Eléments de topologie .....                                   | 46 |
| 4.5.1 Définition de ConnectionPoint .....                         | 46 |
| 4.5.2 Définition de l'Appareil de Communication .....             | 47 |
| 4.5.3 Définition du fournisseur de service de communication ..... | 48 |
| 4.5.4 Définition du Réseau .....                                  | 49 |
| 4.6 Méthodes .....                                                | 49 |
| 4.6.1 Méthodes pour les Serveurs de Communication FDI .....       | 49 |
| 4.6.2 Méthodes pour les Passerelles .....                         | 53 |
| Annexe A (normative) Schéma de balayage de la topologie .....     | 60 |
| A.1 Généralités .....                                             | 60 |
| A.2 Network .....                                                 | 60 |
| A.3 ProfinetNetworkT .....                                        | 60 |
| A.4 ProfinetConnectionPointT .....                                | 60 |
| A.5 ProfinetIdentificationT .....                                 | 61 |
| A.6 MACT .....                                                    | 62 |
| A.7 IPv4T .....                                                   | 62 |
| A.8 IPv6T .....                                                   | 62 |
| A.9 DNSNameT .....                                                | 62 |
| A.10 Hex4DigitT .....                                             | 62 |
| Annexe B (normative) Paramètres du service Transfer .....         | 63 |
| B.1 Généralités .....                                             | 63 |
| B.2 sendData .....                                                | 63 |

|     |                          |    |
|-----|--------------------------|----|
| B.3 | receiveData .....        | 63 |
| B.4 | TransferSendDataT.....   | 63 |
| B.5 | TransferResultDataT..... | 64 |
| B.6 | OperationT.....          | 64 |
|     | Bibliographie.....       | 65 |

|                                                  |    |
|--------------------------------------------------|----|
| Figure 1 – Problème de mapping des versions..... | 43 |
|--------------------------------------------------|----|

|                                                                               |    |
|-------------------------------------------------------------------------------|----|
| Tableau 1 – ProtocolSupportFile pour les Paquetages d'Appareils FDI .....     | 40 |
| Tableau 2 – ProtocolSupportFile pour les Paquetages de Communication FDI..... | 41 |
| Tableau 3 – Valeurs de catalogue pour les appareils de profil.....            | 41 |
| Tableau 4 – Exemples de mapping de versions .....                             | 42 |
| Tableau 5 – Mapping des informations d'identification d'appareils .....       | 43 |
| Tableau 6 – Type de protocole Profinet_IO .....                               | 45 |
| Tableau 7 – Mapping des propriétés DeviceType .....                           | 45 |
| Tableau 8 – Définition du type d'identification PROFINET .....                | 45 |
| Tableau 9 – Type de ConnectionPoint pour Profinet_IO .....                    | 46 |
| Tableau 10 – Arguments de la Méthode Connect .....                            | 50 |
| Tableau 11 – Arguments de la Méthode Disconnect.....                          | 51 |
| Tableau 12 – Arguments de la Méthode Transfer .....                           | 51 |
| Tableau 13 – Arguments de la Méthode SetAddress .....                         | 52 |
| Tableau 14 – Arguments de la Méthode Connect .....                            | 54 |
| Tableau 15 – Arguments de la Méthode Transfer .....                           | 55 |
| Tableau 16 – Arguments de la Méthode SetAddress .....                         | 57 |
| Tableau A.1 – Eléments de ProfinetNetworkT .....                              | 60 |
| Tableau A.2 – Attributs de ProfinetConnectionPointT .....                     | 61 |
| Tableau A.3 – Eléments de ProfinetConnectionPointT .....                      | 61 |
| Tableau A.4 – Attributs de ProfinetIdentificationT .....                      | 61 |
| Tableau B.1 – Attributs de TransferSendDataT .....                            | 64 |
| Tableau B.2 – Attributs de TransferResultDataT .....                          | 64 |

## COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

### INTÉGRATION DES APPAREILS DE TERRAIN (FDI) –

#### Partie 103-4: Profils – PROFINET

#### AVANT-PROPOS

- 1) La Commission Electrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC. Tous les efforts raisonnables sont entrepris afin que l'IEC s'assure de l'exactitude du contenu technique de ses publications; l'IEC ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de brevets et de ne pas avoir signalé leur existence.

La Norme internationale IEC 62769-103-4 a été établie par le sous-comité 65E: Les dispositifs et leur intégration dans les systèmes de l'entreprise, du comité d'études 65 de l'IEC: Mesure, commande et automation dans les processus industriels.

Cette deuxième édition annule et remplace la première édition parue en 2015. Cette édition constitue une révision technique.

Cette édition inclut les modifications techniques majeures suivantes par rapport à l'édition précédente:

- a) prise en charge d'extensions de protocoles génériques, pour une adoption plus rapide d'autres technologies;
- b) capacité offerte aux Développeurs de Paquetages d'élaborer des EDD ciblant les systèmes actuels de bases EDD, en exploitant un seul outil de développement.

Le texte de cette Norme internationale est issu des documents suivants:

| CDV         | Rapport de vote             |
|-------------|-----------------------------|
| 65E/623/CDV | 65E/686A/RVC<br>65E/686/RVC |

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à l'approbation de la présente Norme internationale.

Ce document a été rédigé selon les Directives ISO/IEC, Partie 2.

Une liste de toutes les parties de la série IEC 62769, publiées sous le titre général *Intégration des appareils de terrain (FDI)*, peut être consultée sur le site web de l'IEC.

Le comité a décidé que le contenu de ce document ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous "<http://webstore.iec.ch>" dans les données relatives au document recherché. A cette date, le document sera

- reconduit,
- supprimé,
- remplacé par une édition révisée, ou
- amendé.

**IMPORTANT – Le logo "colour inside" qui se trouve sur la page de couverture de cette publication indique qu'elle contient des couleurs qui sont considérées comme utiles à une bonne compréhension de son contenu. Les utilisateurs devraient, par conséquent, imprimer cette publication en utilisant une imprimante couleur.**

## INTÉGRATION DES APPAREILS DE TERRAIN (FDI) –

### Partie 103-4: Profils – PROFINET

#### 1 Domaine d'application

La présente partie de l'IEC 62769 spécifie un profil FDI de l'IEC 62769 pour l'IEC 617842\_CP 3/4, l'IEC 61784-2\_CP 3/5 et l'IEC 61784-2\_CP 3/6 (PROFINET<sup>1</sup>).

#### 2 Références normatives

Les documents suivants cités dans le texte constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

IEC 61158-5-10, *Industrial communication networks - Fieldbus specifications - Part 5-10: Application layer service definition - Type 10 elements* (disponible en anglais seulement)

IEC 61784-2, *Industrial communication networks - Profiles - Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC/IEEE 8802-3* (disponible en anglais seulement)

IEC 61804 (toutes les parties), *Blocs fonctionnels (FB) pour les procédés industriels et le langage de description électronique de produit (EDDL)*

IEC 62541-100:2015, *Architecture unifiée OPC - Partie 100: Interface d'appareils*

IEC 62769-2, *Intégration des appareils de terrain (FDI) - Partie 2: Client FDI*

IEC 62769-4, *Intégration des appareils de terrain (FDI) - Partie 4: Paquetages FDI*

IEC 62769-5, *Intégration des appareils de terrain (FDI) - Partie 5: Modèle d'Information FDI*

IEC 62769-6, *Intégration des appareils de terrain (FDI) - Partie 6: Mapping de technologies FDI*

IEC 62769-7, *Intégration des appareils de terrain (FDI) - Partie 7: Appareils de communication FDI*

Spécification PI N° 2.122:2008, *Specification for PROFIBUS – Device Description and Device Integration – Volume 1: GSD Specification, V5.1, juillet 2008*, disponible à l'adresse <www.PROFIBUS.com> (disponible en anglais seulement)

Spécification PI N° 2.352:2014, *GSDML Specification for PROFINET IO*; disponible à l'adresse <www.profibus.com> (disponible en anglais seulement)

<sup>1</sup> PROFINET est l'appellation commerciale du consortium PROFIBUS & PROFINET International, une organisation à but non lucratif. Cette information est donnée à l'intention des utilisateurs du présent document et ne signifie nullement que l'IEC approuve ou recommande l'organisation détentrice de l'appellation commerciale, ni l'un quelconque de ses produits. La conformité n'exige pas l'utilisation de l'appellation commerciale. L'utilisation de l'appellation commerciale exige l'autorisation du détenteur de l'appellation commerciale.

### 3 Termes, définitions, abréviations et conventions

#### 3.1 Termes et définitions

Pour les besoins du présent document, les termes et définitions donnés dans l'IEC 61158-5-10, l'IEC 61784-2, l'IEC 61804 (toutes les parties), l'IEC 62541-100, l'IEC 62769-2, l'IEC 62769-4, l'IEC 62769-5, l'IEC 62769-6, l'IEC 62769-7 et la spécification PI N° 2.352 (2014) s'appliquent.

L'ISO et l'IEC tiennent à jour des bases de données terminologiques destinées à être utilisées en normalisation, consultables aux adresses suivantes:

- IEC Electropedia: disponible à l'adresse <http://www.electropedia.org/>;
- ISO Online browsing platform: disponible à l'adresse <http://www.iso.org/obp>.

#### 3.2 Abréviations

Pour les besoins du présent document, les abréviations et acronymes suivants s'appliquent:

|       |                                                                                                                                    |
|-------|------------------------------------------------------------------------------------------------------------------------------------|
| DCP   | Protocole de découverte et de configuration de base (Discovery and basic Configuration Protocol) (conformément à l'IEC 61158-5-10) |
| DNS   | Système de noms de domaine (Domain Name System)                                                                                    |
| EDD   | Description d'appareil électronique (Electronic Device Description)                                                                |
| EDDL  | Langage de description d'appareil électronique (Electronic Device Description Language, voir l'IEC 61804)                          |
| GSD   | Description de station générale (General Station Description, voir la spécification PI N° 2.122 (2008)).                           |
| GSDML | Langage de balisage GSD (GSD Markup Language, voir la spécification PI N° 2.352 (2014)).                                           |
| IP    | Protocole Internet (Internet Protocol) (IETF RFC 791)                                                                              |
| UIP   | Plugiciel d'interface utilisateur (User Interface Plug-in)                                                                         |
| UUID  | Identificateur universel unique (Universally Unique IDentifier, voir l'ISO/IEC 11578)                                              |
| XML   | Langage de balisage extensible (eXtensible Markup Language, voir REC-xml-20081126)                                                 |

#### 3.3 Conventions

##### 3.3.1 Syntaxe EDDL

La présente partie de l'IEC 62769 spécifie le contenu du composant EDD qui fait partie des Paquetages de Communication FDI. Le contenu de la spécification utilisant la syntaxe EDDL applique une police `Courier New`. La syntaxe EDDL est utilisée pour les déclarations des signatures de méthodes, des variables, des structures de données et des composants.

##### 3.3.2 Syntaxe XML

Les exemples de syntaxe XML utilisent la police `Courier New`. La syntaxe XML est utilisée pour décrire le schéma des documents XML.

Exemple: `<xs:simpleType name="ExampleType">`

##### 3.3.3 Majuscules

L'IEC 62769 (toutes les parties) utilise des termes en majuscules pour souligner que ces termes ont une signification spécifique à la FDI.

Certains de ces termes utilisent un acronyme comme suffixe, par exemple:

- Client FDI, ou
- Serveur FDI.

Certains de ces termes sont des termes composés, par exemple:

- Serveurs de Communication, ou
- Paquetage de Profil.

Les noms de paramètres ou attributs sont concaténés en un seul terme, dans lequel les différents termes d'origine commencent par une lettre majuscule, par exemple:

- ProtocolSupportFile, ou
- ProtocolType.

Les noms de paramètres ou attributs peuvent aussi être construits en utilisant le caractère de soulignement pour concaténer au moins deux termes, par exemple:

- PROFILE\_ID, ou
- Profinet\_PA\_Network.

## 4 Profil pour PROFINET

### 4.1 Généralités

Le présent document de profil, conforme à la spécification FDI de l'IEC 62769, spécifie les spécificités du protocole nécessaires aux Paquetages FDI décrivant des Serveurs de Communication, des Passerelles et des Appareils.

Pour les Serveurs de Communication, le présent document définit également des spécificités de protocole lorsqu'elles ont besoin d'être prises en considération dans le Modèle d'Information hébergé sur les Serveurs de Communication.

### 4.2 Profil de catalogue

#### 4.2.1 Fichier de prise en charge de protocole

##### 4.2.1.1 Paquetage d'Appareil FDI

Un fichier GSD est une Pièce jointe obligatoire pour les Paquetages d'Appareils FDI représentant des appareils PROFINET IO.

Les pièces jointes spécifiques à un protocole sont mentionnées dans le Catalogue de Paquetage défini dans l'IEC 62769-5. Un fichier de langage de balisage contenant la liste des caractéristiques de communication (GSDML) conformément à la spécification PI N° 2.352 (2014) est une pièce jointe obligatoire pour les Paquetages d'Appareils FDI représentant des appareils PROFINET. Le Tableau 1 spécifie les paramètres du ProtocolSupportFile dans le Paquetage d'Appareil FDI.

**Tableau 1 – ProtocolSupportFile pour les Paquetages d'Appareils FDI**

| Paramètre             | Description                                                                                                                                     |
|-----------------------|-------------------------------------------------------------------------------------------------------------------------------------------------|
| Type de contenu       | texte/xml                                                                                                                                       |
| Espace de noms racine | Vide                                                                                                                                            |
| Relation source       | <a href="http://fdi-cooperation.com/2010/relationship/attachment-protocol">http://fdi-cooperation.com/2010/relationship/attachment-protocol</a> |
| Nom de fichier        | Conformément à la spécification PI N° 2.352 (2014)                                                                                              |

#### 4.2.1.2 Paquetage de Communication FDI

Un fichier GSDML tel que spécifié dans l'ISO 15745 4:2003/AMD1:2006 est une pièce jointe facultative pour les Paquetages de Communication FDI représentant des appareils PROFINET IO. Le Tableau 2 spécifie les paramètres de ProtocolSupportFile pour les Paquetages de Communication FDI.

**Tableau 2 – ProtocolSupportFile pour les Paquetages de Communication FDI**

| Paramètre             | Description                                                                                                                                     |
|-----------------------|-------------------------------------------------------------------------------------------------------------------------------------------------|
| Type de contenu       | texte/xml                                                                                                                                       |
| Espace de noms racine | Vide                                                                                                                                            |
| Relation source       | <a href="http://fdi-cooperation.com/2010/relationship/attachment-protocol">http://fdi-cooperation.com/2010/relationship/attachment-protocol</a> |
| Nom de fichier        | Conformément à la spécification PI N° 2.352 (2014)                                                                                              |

#### 4.2.2 Définition de CommunicationProfile

L'IEC 62769-4 définit une chaîne CommunicationProfileT pour le schéma XML Catalog. La valeur spécifique à PROFINET doit être «profinet\_io».

#### 4.2.3 Appareil de profil

Un Paquetage de Profil doit fournir les valeurs de catalogue pour les appareils de profil, permettant au Serveur FDI d'exploiter une description d'appareil générique, si une description spécifique n'est pas disponible. Les définitions du Tableau 3 sont axées sur le contenu du catalogue qui est indépendant du fournisseur.

**Tableau 3 – Valeurs de catalogue pour les appareils de profil**

| Elément      | Attribut | Contenu                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
|--------------|----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PackageType  | —        | Profil                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |
| Manufacturer | —        | Vide                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
| DeviceModel  | —        | <p>Les valeurs d'identificateur de profil autorisées (PROFILE_ID) sont fournies par PROFIBUS &amp; PROFINET International (PI). PI fournit et maintient un fichier XML (Profile_ID_Table) contenant l'assignation des PROFILE_ID aux profils.</p> <p>Il est disponible à l'adresse<br/>&lt;<a href="http://www.profibus.com/IM/Profile_ID_Table.xml">http://www.profibus.com/IM/Profile_ID_Table.xml</a>&gt;</p> <p>Le fichier peut être téléchargé par un quelconque outil technique ou outil de service, dès lors qu'il est connecté à Internet.</p> <p>NOTE De plus amples informations sont fournies dans la spécification PI N° 3.502 (Profil I&amp;M) et dans les définitions de profils connexes référencées dans le présent document.</p> <p>La chaîne doit être au format hexadécimal en commençant par 0x, par exemple «0x3D00».</p> |

#### 4.2.4 Informations relatives à la version de protocole

L'IEC 62769-4 définit un type d'élément nommé InterfaceT pour le schéma XML Catalog. Le type d'élément InterfaceT contient un élément nommé Version qui est censé fournir des informations de version relatives au profil de protocole de communication appliqué. La valeur suit le schéma d'informations de version défini par l'IEC 62769-4, lequel schéma est défini dans le type d'élément VersionT. Le Tableau 4 décrit comment appliquer les versions de protocole actuellement connues qui sont définies par le consortium à but non lucratif PROFIBUS & PROFINET International. La règle générale consiste à appliquer la valeur «0» pour les parties des

informations de version, établies conformément à l'IEC 62769-4, qui ne sont pas utilisées par des versions de protocole actuellement connues.

**Tableau 4 – Exemples de mapping de versions**

| Protocole/version                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | Valeur de l'élément InterfaceT Version |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------|
| PROFINET Version 2.3                                                                                                                                                                                                                                                                                                                                                                                                                                                                 | 2.3.0                                  |
| <p>NOTE 1 Le présent tableau est seulement un exemple, car le présent document ne peut pas prévoir comment les futures versions de protocole seront définies.</p> <p>NOTE 2 Les informations de révision de protocole PROFINET actuellement connues fournissent les informations relatives aux versions majeure et mineure. Les zéros de tête ne sont pas pris en compte dans l'évaluation de la valeur des versions, car seules les valeurs décimales réelles sont pertinentes.</p> |                                        |

### 4.3 Association d'un Paquetage avec un appareil

#### 4.3.1 Mapping d'identification du type d'appareil

Le but du mapping de l'identification de type d'appareil est de permettre aux systèmes Hôtes FDI de comparer le résultat de balayage à la représentation de la topologie dans le Modèle d'Information. Les systèmes Hôtes FDI doivent également être habilités à déterminer le Paquetage d'Appareil FDI qui est adapté à une entrée d'appareil contenue dans le résultat du balayage. Cela permet à l'utilisateur d'un système Hôte FDI de synchroniser le Modèle d'Information avec l'installation réelle.

Le service de balayage mis en œuvre par le serveur de communication (défini en 4.6.1.7) fournit un résultat de balayage par le biais d'un document XML (le schéma est défini à l'Annexe A).

Le service de balayage mis en œuvre par la Passerelle (défini en 4.6.2.7) fournit un résultat de balayage au moyen du Modèle d'Information qui contient des structures de données créées à partir du contenu EDD tel que spécifié en 4.6.2.7.

Les deux manières de présenter le résultat de balayage ont en commun le fait que les résultats de balayage contiennent une identification du type d'appareil et une identification d'instance d'appareil.

Les systèmes Hôtes FDI qui comparent la configuration de la topologie réelle du réseau à la représentation de la topologie dans le Modèle d'Information doivent être habilités à traiter les situations suivantes:

- L'instance d'Appareil physique identifiée à une adresse d'appareil spécifique n'est pas logiquement présente dans le Modèle d'Information (comme Instance): permettre au système Hôte FDI de trouver le Paquetage d'Appareil FDI approprié en fonction des informations du catalogue d'appareil;
- l'instance d'Appareil physique identifiée par l'adresse d'appareil est logiquement présente dans le Modèle d'Information (comme Instance): permettre au système Hôte FDI de comparer les informations de type d'appareil présentées dans le résultat de balayage (voir l'identification à l'Article A.5 et en 4.6.2.7) et les informations spécifiques à un type d'appareil de l'Instance présente dans le Modèle d'Information.

Le Paquetage d'Appareil FDI contient des informations d'identification de type d'appareil qui peuvent être comparées au résultat de balayage basé sur le Schéma Catalog dans l'IEC 62769-4, définissant les types (simples) d'éléments XML «DeviceModel» et «Manufacturer». Ces deux types sont utilisés dans les types d'éléments (complexes) «Protocol» et «RegDeviceType».

A l'issue du déploiement du Paquetage FDI, les informations de Paquetage FDI sont alors présentes dans le Modèle d'Information sous la forme du FunctionalGroup «Identification» spécifié, contenant VendorID et DeviceID (voir 4.4.3).

Le mapping entre différentes sources de données d'identification d'appareils est décrit dans le Tableau 5. Comme les résultats de balayage fournis par le Serveur de Communication ou la Passerelle peuvent acheminer des données qui sont produites par l'appareil (micrologiciel), le mapping d'identification de type d'appareil doit être pris en charge en fournissant les données correspondantes dans le Catalogue et le Modèle d'Information contenus dans le Paquetage d'Appareil FDI.

**Tableau 5 – Mapping des informations d'identification d'appareils**


| Paquetage d'Appareil FDI                   | Modèle d'Information                                                 | Résultat de balayage fourni par le Serveur de Communication                  | Résultat de balayage fourni par la Passerelle             |
|--------------------------------------------|----------------------------------------------------------------------|------------------------------------------------------------------------------|-----------------------------------------------------------|
| Type spécifié dans Catalog<br>Manufacturer | FunctionalGroup:<br>Identification<br>Nom d'exploration:<br>VendorID | Elément (chemin):<br>ConnectionPoint/Identification<br>Attribut:<br>VendorID | COLLECTION<br>ConnectionPoint.<br>Identification.VendorID |
| Type spécifié dans Catalog<br>DeviceModel  | FunctionalGroup:<br>Identification<br>Nom d'exploration:<br>DeviceID | Elément (chemin):<br>ConnectionPoint/Identification<br>Attribut:<br>DeviceID | COLLECTION<br>ConnectionPoint.<br>Identification.DeviceID |

#### 4.3.2 Mapping des révisions de type d'appareil

L'IEC 62769-4 prévoit un concept qui permet de déterminer la compatibilité entre un Paquetage d'Appareil FDI et un Appareil. L'IEC 62769-4 spécifie un processus de gestion du cycle de vie portant sur une seule information de version fournie pour l'appareil complet.

Les spécifications PROFINET IO, par exemple les spécifications PI N° 2.352 (GSDML, 2011)) et 3.502 (I&M), divisent la révision d'appareil en informations relatives au logiciel et en informations relatives au matériel. Ces spécifications ne soulignent aucune règle permettant de savoir si **HARDWARE\_REVISION**, spécifié en GSD, GSDML ou I&M, est indépendant de **SOFTWARE\_REVISION**.

L'objectif de 4.3.2 est de décrire les règles de traduction entre les spécifications PROFINET IO, en décrivant leur manière de fournir les informations de version, et la manière spécifiée par l'IEC 62769-4 en ce qui concerne les informations de version qui peuvent être comparées par rapport à la version lue dans l'appareil. Le but est de déterminer la compatibilité entre un Paquetage d'Appareil FDI et un Appareil (La Figure 1 décrit le problème).

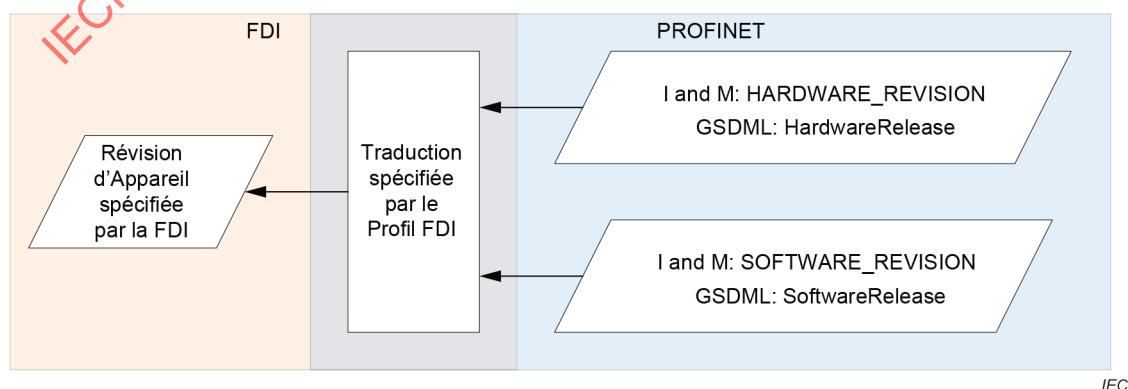

IEC

**Figure 1 – Problème de mapping des versions**

Le micrologiciel d'un appareil met en œuvre l'interface d'échange de données qui doit être décrite au moyen du contenu du Paquetage d'Appareil FDI (EDD). Un micrologiciel d'appareil qui met en œuvre le profil GSD, GSDML ou I&M permet de lire les valeurs SOFTWARE\_REVISION et HARDWARE\_REVISION. L'accès à ces valeurs doit être décrit dans l'EDD contenue dans le Paquetage d'Appareil FDI.

Les modifications de micrologiciel qui affectent l'interface d'échange de données mise en œuvre par le micrologiciel doivent être reflétées dans le Paquetage d'Appareil FDI. De telles modifications de micrologiciel et de description d'appareil doivent être visibles dans l'attribut SOFTWARE\_REVISION.

Les modifications relatives au matériel doivent être collectées dans l'attribut HARDWARE\_REVISION. Les modifications relatives au matériel n'exigent pas nécessairement une mise à jour de micrologiciel. Par conséquent, HARDWARE\_REVISION ne peut pas être utilisé pour déterminer la compatibilité entre un appareil et le Paquetage d'Appareil FDI. Par contre, si une modification du matériel exige des modifications du micrologiciel, HARDWARE\_REVISION et SOFTWARE\_REVISION doivent être modifiés tous les deux.

L'IEC 62769-4 spécifie le schéma Catalog et un élément DeviceVersion qui est utilisé dans la déclaration de type d'élément ListOfSupportedDeviceVersions. La valeur de DeviceVersion doit être comparée à l'attribut SOFTWARE\_REVISION fourni par l'appareil, afin de déterminer la compatibilité entre un Paquetage d'Appareil FDI et un Appareil.

Le format de données pour l'attribut SOFTWARE\_REVISION est une chaîne alors que l'élément DeviceVersion attend trois chiffres (version majeure, version mineure et révision). Par conséquent, les règles suivantes s'appliquent: si la chaîne est au format <entier>.<entier>.<entier>, elle est transférée ainsi: majeure, mineure et révision (dans le même ordre). <entier> désigne un nombre entier simple dans la chaîne, par exemple «1» ou «12», et aucune autre représentation telle qu'un format hexadécimal (par exemple «0x001A»). Si la chaîne est au format <entier>.<entier>, elle est transférée ainsi: majeure, mineure et «0» est utilisé pour la révision. Si la chaîne comporte un seul <entier>, elle est transférée ainsi: majeure et «0» est utilisé pour mineure et la révision. Un caractère de poids fort ou un caractère de poids fort et un espace doivent être ignorés. Dans le cas d'une chaîne figurant dans un autre format, le numéro de révision ne doit pas être pris en compte pour sélectionner le Paquetage FDI adéquat.

## 4.4 Mapping du Modèle d'Information

### 4.4.1 Définition de ProtocolType

Le présent document se réfère à des protocoles spécifiés par l'IEC 61158, car ils sont appropriés pour prendre en charge les cas d'utilisation relatifs à la gestion d'appareil qui sont pris en charge à travers les spécifications FDI. Le domaine d'application est limité au transport de données du Modèle d'Information vers l'appareil.

Par exemple, la gestion des adresses d'appareils est basée sur les services spécifiés dans l'IEC 61158 (toutes les parties). Mais, étant donné que le service de gestion d'adresses est encapsulé par le service SetAddress spécifié par l'IEC 62769-7, les détails des services spécifiés par l'IEC 61158 peuvent ne pas être connus.

Le type de protocole Profinet\_IO doit être utilisé pour identifier la communication PROFINET IO. Le type Profinet\_IO est un sous-type du type abstrait ProtocolType (IEC 62541-100). Le Tableau 6 spécifie les attributs et les valeurs du type de protocole Profinet\_IO.

**Tableau 6 – Type de protocole Profinet\_IO**

| Attribut                                               | Valeur      |            |          |                |               |
|--------------------------------------------------------|-------------|------------|----------|----------------|---------------|
| BrowseName                                             | Profinet_IO |            |          |                |               |
| IsAbstract                                             | False       |            |          |                |               |
| Références                                             | NodeClass   | BrowseName | DataType | TypeDefinition | ModellingRule |
| Sous-type de ProtocolType défini dans l'IEC 62541-100. |             |            |          |                |               |

#### 4.4.2 Mapping de DeviceType

Le mapping des propriétés du nœud DeviceType est défini dans le Tableau 7.

**Tableau 7 – Mapping des propriétés DeviceType**

| Propriété        | Mapping PROFINET                                                                                              |
|------------------|---------------------------------------------------------------------------------------------------------------|
| SerialNumber     | SERIAL_NUMBER (voir Tableau 8)                                                                                |
| RevisionCounter  | REV_COUNTER (voir Tableau 8)                                                                                  |
| Manufacturer     | Chaîne obtenue à partir du catalogue de paquetages FDI (élément ManufacturerName issu de PackageT)            |
| Model            | Chaîne obtenue à partir du catalogue de paquetages FDI (élément Name de DeviceTypeT, qui est un nom localisé) |
| DeviceRevision   | Non prise en charge                                                                                           |
| DeviceManual     | Non prise en charge                                                                                           |
| SoftwareRevision | SOFTWARE_REVISION (voir Tableau 8)                                                                            |
| HardwareRevision | HARDWARE_REVISION (voir Tableau 8)                                                                            |

#### 4.4.3 Définition du FunctionalGroup «Identification»

Comme défini au Paragraphe 5.3 de l'IEC 62541-100:2015, chaque représentation d'appareil dans le Modèle d'Information hébergé sur le Serveur FDI doit contenir un FunctionalGroup spécifique à un protocole, appelé Identification. Les paramètres de ce FunctionalGroup sont définis pour les profils PROFINET comme suit:

**Tableau 8 – Définition du type d'identification PROFINET**

| BrowseName            | DataType   | Obligatoire/facultatif |
|-----------------------|------------|------------------------|
| VendorID              | UInt16     | Obligatoire            |
| DeviceID              | UInt16     | Obligatoire            |
| ORDER_ID              | String     | Obligatoire            |
| SERIAL_NUMBER         | String     | Obligatoire            |
| HARDWARE_REVISION     | UInt16     | Obligatoire            |
| SOFTWARE_REVISION     | String     | Obligatoire            |
| REV_COUNTER           | UInt16     | Obligatoire            |
| PROFILE_ID            | UInt16     | Obligatoire            |
| PROFILE_SPECIFIC_TYPE | UInt16     | Obligatoire            |
| IM_VERSION            | ByteString | Obligatoire            |
| IM_SUPPORTED          | UInt16     | Obligatoire            |

Les instances de BaseDataVariable doivent être créées à partir des déclarations de VARIABLE avec des identificateurs qui correspondent aux noms d'exploration énumérés dans le Tableau 8, à l'exception des attributs VendorID et DeviceID. Les valeurs d'attributs connexes doivent être prises dans le fichier GSD (4.2.1). Les noms d'éléments VendorID et DeviceID concordent avec les noms d'attributs définis dans la spécification GSDML.

## 4.5 Eléments de topologie

### 4.5.1 Définition de ConnectionPoint

Afin de prendre en charge les différents besoins d'ingénierie de topologie réseau relatifs aux différentes couches de protocoles utilisées pour PROFINET IO, la définition des types de ConnectionPoint suit les recommandations données dans l'IEC 62769-7 concernant la manière de traiter les informations d'adresse pour les couches de protocoles imbriquées dans PROFINET IO.

Le type de ConnectionPoint ConnectionPoint\_Profinet\_IO doit être utilisé pour paramétrer les points d'accès réseau PROFINET IO. Le type de ConnectionPoint Profinet\_IO est un sous-type du type abstrait ConnectionPointType (IEC 62769-5). Le Tableau 9 spécifie les valeurs autorisées des attributs ConnectionPoint pour le type de protocole Profinet\_IO.

**Tableau 9 – Type de ConnectionPoint pour Profinet\_IO**

| Attribut                                                      | Valeur      |            |           |                |               |
|---------------------------------------------------------------|-------------|------------|-----------|----------------|---------------|
| BrowseName                                                    | Profinet_IO |            |           |                |               |
| IsAbstract                                                    | False       |            |           |                |               |
| Références                                                    | NodeClass   | BrowseName | Data Type | TypeDefinition | ModellingRule |
| Sous-type de ConnectionPointType défini dans l'IEC 62541-100. |             |            |           |                |               |
| HasProperty                                                   | Variable    | MAC        | Octet[6]  | PropertyType   | Obligatoire   |
| HasProperty                                                   | Variable    | IPv4       | Octet[4]  | PropertyType   | Obligatoire   |
| HasProperty                                                   | Variable    | DNSNAME    | String    | PropertyType   | Obligatoire   |
| HasProperty                                                   | Variable    | VALID      | Boolean   | PropertyType   | Obligatoire   |

Le type de ConnectionPoint Profinet\_IO doit être décrit par un élément EDD contenu dans un Paquetage FDI associé à l'Appareil de Communication, en mesure de piloter un réseau PROFIBUS IO. Les propriétés réelles de ConnectionPoint sont déclarées par les constructions VARIABLE regroupées dans une COLLECTION nommée ConnectionPoint.

La variable MAC est une matrice de 6 octets contenant l'adresse MAC. La valeur est un identificateur unique assigné à des interfaces réseau qui prennent en charge la communication spécifiée par la norme IEEE 802.3. La valeur peut uniquement être lue dans l'appareil, par exemple pendant l'exécution du service de balayage.

La variable IPv4 est une matrice de 4 octets contenant l'adresse IP.

NOTE 1 Le formatage d'une adresse IP donne typiquement une chaîne de caractères composée de quatre nombres décimaux de 1 à 3 chiffres, séparés par un caractère«.» (exemple: 128.12.1.15). La spécification de l'EDDL selon l'IEC 61804-3 et l'IEC 61804-4 ne prend pas en charge les instructions de formatage pour le type OCTET. Mais, étant donné que la sémantique des définitions de VARIABLE données dans la présente partie de l'IEC 62769 est définie, il est pris pour hypothèse que le système peut rendre les valeurs de VARIABLE en conséquence.

La variable DNSNAME contient le nom de station. La syntaxe du nom de station doit suivre les spécifications relatives au système de noms de domaine (DNS).

NOTE 2 Le système de noms de domaine (DNS) est un système de dénomination hiérarchique qui traduit les noms de domaine dont la syntaxe est intelligible pour l'homme en identificateurs numériques associés au matériel de

réseautage dans le but de localiser et d'adresser ces appareils. Les spécifications des règles pour former des noms de domaine apparaissent dans le IETF RFC 1035, le IETF RFC 1123 et le IETF RFC 2181.

La Variable Valid indique si les informations d'adresse stockées sont valides.

```

COMPONENT ConnectionPoint_PROFINET_IO
{
    LABEL "PROFINET IO Connection point";
    CAN_DELETE FALSE;
    PROTOCOL PROFINET;
}

VARIABLE MAC
{
    LABEL "MAC address";
    HELP "Unique network visible device identifier";
    CLASS DEVICE;
    TYPE OCTET(6);
    HANDLING READ;
    CLASS LOCAL;
}

VARIABLE IPv4
{
    LABEL "IP Address";
    HELP "IP v4 address";
    CLASS DEVICE;
    TYPE OCTET(4);
    HANDLING READ & WRITE;
    CLASS LOCAL;
}

VARIABLE DNS_Name
{
    LABEL "DNS Name";
    HELP "Station name";
    CLASS DEVICE;
    TYPE BITSTRING(256);
    HANDLING READ & WRITE;
    CLASS LOCAL;
}

COLLECTION ConnectionPoint
{
    LABEL "PROFINET Connection Point data";
    MEMBERS
    {
        CONNECTION_POINT_MAC, MAC;
        CONNECTION_POINT_IPV4, IPv4;
        CONNECTION_POINT_DNS_NAME, DNS_Name;
    }
}

```

#### 4.5.2 Définition de l'Appareil de Communication

Conformément à l'IEC 62769-7, chaque Paquetage de Communication FDI doit contenir un élément EDD décrivant l'appareil. Le code source EDDL ci-après est un exemple décrivant un Serveur de Communication.

```

COMPONENT PROFINET_Communication_Server
{
    LABEL "PROFINET communication server";
    PRODUCT_URI "urn:PROFIBUS International: PROFINET Communication Server";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMPONENT;
    COMPONENT_RELATIONS
    {
        PROFINET_Communication_Device_Setup
    }
}

```

```

}

COMPONENT_RELATION PROFINET_Communication_Device_Setup
{
    LABEL "Relation between Device and communication device";
    RELATION_TYPE CHILD_COMPONENT;
    COMPONENTS
    {
        PROFINET_Communication_Device{AUTO_CREATE 1;}
    }
    MINIMUM_NUMBER 1;
    MAXIMUM_NUMBER 2;
}

```

Conformément à l'IEC 62769-7, chaque Paquetage de Communication FDI doit contenir au moins un élément EDD qui décrit au moins un composant appareil de communication. Le code source EDDL ci-après montre comment décrire un appareil de communication PROFINET IO.

```

COMPONENT PROFINET_Communication_Device
{
    LABEL "PROFINET communication device";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMPONENT;
    COMPONENT_RELATIONS
    {
        Profinet_Service_Provider_Relation
    }
}

COMPONENT_RELATION Profinet_Service_Provider_Relation
{
    LABEL "Relation to communication service provider ";
    RELATION_TYPE CHILD_COMPONENT;
    COMPONENTS
    {
        PROFINET_Service_Provider{AUTO_CREATE 1;}
    }
    MINIMUM_NUMBER 1;
    MAXIMUM_NUMBER 2;
}

```

Dans un appareil de communication réel, la valeur «Profinet\_Service\_Provider» doit être adaptée en fonction de l'identificateur de la déclaration COMPONENT qui décrit le fournisseur de service de communication.

#### 4.5.3 Définition du fournisseur de service de communication

Conformément à l'IEC 62769-7, chaque Paquetage de Communication FDI doit contenir au moins un élément EDD qui décrit au moins un composant fournisseur de service de communication. Le code source EDDL ci-après montre comment décrire un composant fournisseur de service de communication PROFINET IO.

La référence du composant ConnectionPoint\_Profinet\_IO correspond aux définitions de point de connexion associées, données en 4.5. La valeur de l'attribut BYTE\_ORDER doit être définie en fonction du protocole.

```

COMPONENT PROFINET_Service_Provider
{
    LABEL "PROFINET communication service provider";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMMUNICATION_SERVICE_PROVIDER;
    COMPONENT_RELATIONS
    {
        PROFINET_Service_Provider_Connection_Point_Relation
    }
    BYTE_ORDER BIG_ENDIAN;
}

COMPONENT_RELATION PROFINET_Service_Provider_Connection_Point_Relation
{
    LABEL "Relation between communication service provider and connection point";
    RELATION_TYPE CHILD_COMPONENT;
    ADDRESSING {DNS_Name}
    COMPONENTS
    {
        ConnectionPoint_PROFINET_IO{ AUTO_CREATE 1;}
    }
    MINIMUM_NUMBER 1;
    MAXIMUM_NUMBER 1;
}

```

#### 4.5.4 Définition du Réseau

Conformément à l'IEC 62769-7, chaque Paquetage de Communication FDI doit contenir au moins un élément EDD qui décrit les contraintes de configuration de réseau utilisant la construction «component».

```

COMPONENT Network_PROFINET
{
    LABEL "PROFINET IO Network";
    CAN_DELETE TRUE;
    CLASSIFICATION NETWORK_COMPONENT;
    COMPONENT_RELATIONS
    {
        PROFINET_IO_Network_Connection_Point_Relation
    }
}

COMPONENT_RELATION PROFINET_IO_Network_Connection_Point_Relation
{
    LABEL "Relation between network and connection point";
    RELATION_TYPE CHILD_COMPONENT;
    ADDRESSING {DNS_Name}
    COMPONENTS
    {
        ConnectionPoint_PROFINET_IO
    }
}

```

## 4.6 Méthodes

### 4.6.1 Méthodes pour les Serveurs de Communication FDI

#### 4.6.1.1 Généralités

Le Modèle d'Information contenu dans un Serveur de communication doit mettre en œuvre des services selon les signatures de méthode décrites en 4.6.1.

#### 4.6.1.2 Connect

##### Signature:

```
Connect (
    [in]   ByteString      CommunicationRelationId,
    [in]   String          DNSNAME,
    [in]   UInt16          DeviceID,
    [in]   UInt16          VendorID,
    [out]  Int32            ServiceError);
```

Le Tableau 10 donne la description des arguments.

**Tableau 10 – Arguments de la Méthode Connect**

| Argument                | Description                                                                                                                                                                                                                                                                                                                      |
|-------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | La valeur d'argument contient le nodeld du ConnectionPoint qui représente la connexion entre un appareil et un réseau physique directement connecté au matériel du serveur de communication. Le nodeld permet de trouver la relation directe parent-enfant.                                                                      |
| DNSNAME                 | Le nom d'argument doit concorder avec le nom d'attribut correspondant défini pour le ConnectionPoint qui est décrit par un élément EDD correspondant spécifié en 4.5. La valeur d'argument contient l'adresse réseau de l'appareil.                                                                                              |
| DeviceID                | La valeur d'argument contient le numéro d'identification d'appareil défini par le fabricant (voir GSDML, «Attributs de l'élément DeviceIdentity»).                                                                                                                                                                               |
| VendorID                | La valeur d'argument contient le numéro d'identification du fabricant défini par PROFIBUS Nutzerorganisation, ou PNO (voir GSDML, «Attributs de l'élément DeviceIdentity»).                                                                                                                                                      |
| ServiceError            | 0: OK/exécution terminée, connexion établie avec succès<br>-1: échec de la connexion/annulée par l'appelant<br>-3: échec de la connexion/appareil introuvable<br>-4: échec de la connexion/adresse d'appareil non valide<br>-5: échec de la connexion/DeviceID non valide<br>-6: échec de la connexion/ManufacturerID non valide |

Remarques: le ConnectionPoint défini pour PROFINET IO contient plus de valeurs d'attribut Address qu'il n'en est utilisé pour le service Connect. La raison est qu'un quelconque échange de données d'enregistrement avec l'appareil exige que l'assignation d'adresse soit parachevée. Une fois que l'assignation d'adresse est effectuée, le DNSNAME suffit pour adresser l'appareil. L'adresse MAC pourrait être utilisée à des fins de vérification d'instance et de type d'appareil, mais ces tâches ont déjà été effectuées au cours de l'assignation d'adresse.

#### 4.6.1.3 Disconnect

##### Signature:

```
Disconnect (
    [in]   ByteString      CommunicationRelationId,
    [out]  Int32            ServiceError)
```

Le Tableau 11 donne la description des arguments.

**Tableau 11 – Arguments de la Méthode Disconnect**

| Argument                | Description                                                                                                                                                                                                                                                 |
|-------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | La valeur d'argument contient le nodeld du ConnectionPoint qui représente la connexion entre un appareil et un réseau physique directement connecté au matériel du serveur de communication. Le nodeld permet de trouver la relation directe parent-enfant. |
| ServiceError            | 0: OK/déconnexion effectuée avec succès<br>-1: échec de la déconnexion/aucune relation de communication existante<br>-2: échec de la déconnexion/identifiant de relation de communication non valide                                                        |

#### 4.6.1.4 Transfer

##### Signature

```

Transfer (
    [in]   ByteString   CommunicationRelationId,
    [in]   String       OPERATION,
    [in]   UInt16       SLOT,
    [in]   UInt16       SUBSLOT,
    [in]   UInt16       INDEX,
    [in]   UInt32       API,
    [in]   ByteString   REQUEST,
    [out]  ByteString   REPLY,
    [out]  ByteString   RESPONSE_CODES
    [out]  Int32        ServiceError);

```

Le Tableau 12 donne la description des arguments.

**Tableau 12 – Arguments de la Méthode Transfer**

| Argument                | Description                                                                                                                                                                                                                                                             |
|-------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | La valeur d'argument contient le nodeld du ConnectionPoint représentant la connexion entre un appareil et un réseau physique au sein du Modèle d'Information.                                                                                                           |
| OPERATION               | La valeur d'argument indique le sens du transfert de données. Les valeurs autorisées sont «READ» et «WRITE».                                                                                                                                                            |
| SLOT                    | Le nom de l'argument doit concorder avec la COMMAND correspondante – nom d'attribut SLOT. La valeur d'argument doit provenir de la valeur d'attribut de COMMAND – attribut SLOT de la COMMAND correspondante qui doit être traitée.                                     |
| SUBSLOT                 | Le nom d'argument doit concorder avec la COMMAND correspondante – nom d'attribut SUBSLOT. La valeur d'argument doit provenir de la valeur d'attribut de COMMAND – attribut SUBSLOT de la COMMAND correspondante qui doit être traitée.                                  |
| INDEX                   | Le nom d'argument doit concorder avec la COMMAND correspondante – nom d'attribut INDEX. La valeur d'argument doit provenir de la valeur d'attribut de COMMAND – attribut INDEX de la COMMAND correspondante qui doit être traitée.                                      |
| API                     | L'argument n'est pas pris en charge par la description actuelle de COMMAND. La valeur par défaut pour cet argument est 0.                                                                                                                                               |
| REQUEST                 | Le nom d'argument doit concorder avec le nom de sous-élément REQUEST de la COMMAND correspondante. Le train d'octets présenté à travers l'argument est créé à partir des définitions fournies par l'élément REQUEST de la COMMAND correspondante qui doit être traitée. |
| REPLY                   | Le nom d'argument doit concorder avec le nom de sous-élément REPLY de la COMMAND correspondante. Le train d'octets retourné par l'argument s'applique aux définitions fournies par l'élément REPLY de la COMMAND correspondante qui doit être traitée.                  |
| RESPONSE_CODES          | Le nom d'argument doit concorder avec le nom de sous-élément RESPONSE_CODES de la COMMAND. La valeur d'argument achemine les octets de réponse du service de communication spécifique à PROFINET.                                                                       |

| Argument     | Description                                                                                                                                                                                                                                                                                                                                           |
|--------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| ServiceError | 0: OK/exécution terminée<br>-1: échec du transfert/annulé par l'appelant<br>-3: échec du transfert/aucune relation de communication existante<br>-4: échec du transfert/identifiant de relation de communication non valide<br>-5: échec du transfert/contenu sendData non valide<br>-6: échec du transfert/format Profinet de receiveData non valide |

#### 4.6.1.5 GetPublishedData

Cette méthode n'est pas prise en charge par PROFINET IO.

#### 4.6.1.6 SetAddress

##### Signature

```
SetAddress (
    [in]  byte[6]  MAC,
    [in]  byte[4]  IP,
    [in]  String   DNSNAME,
    [in]  byte[4]  SubnetMask,
    [in]  byte[4]  Gateway,
    [out] Int32     ServiceError);
```

Le Tableau 13 donne la description des arguments.

**Tableau 13 – Arguments de la Méthode SetAddress**

| Argument     | Description                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
|--------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| MAC          | La valeur d'argument contient l'identificateur unique d'un appareil. Le nom d'argument concorde avec le nom des éléments de Topologie. La propriété ConnectionPoint MAC est définie dans le Tableau 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
| IP           | La valeur d'argument contient la nouvelle adresse IP d'un appareil. Le nom d'argument concorde avec le nom des éléments de Topologie. La propriété ConnectionPoint IP est définie dans le Tableau 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| DNSNAME      | La valeur d'argument contient le nouvel attribut DNSNAME (nom de station) d'un appareil. Le nom d'argument concorde avec le nom des éléments de Topologie. La propriété ConnectionPoint DNSNAME est définie dans le Tableau 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| SubnetMask   | La valeur d'argument contient le nouvel attribut SubnetMask (nom de station) d'un appareil. Le nom d'argument concorde avec le nom des éléments de Topologie. La propriété ConnectionPoint SubnetMask est définie dans le Tableau 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| Gateway      | La valeur d'argument contient le nouvel attribut Gateway (nom de station) d'un appareil. Le nom d'argument concorde avec le nom des éléments de Topologie. La propriété ConnectionPoint Gateway est définie dans le Tableau 9.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| ServiceError | 0: OK/exécution terminée avec succès<br>-1: échec de SetAddress/annulé par l'appelant<br>-3: échec de SetAddress/non initialisé<br>-4: échec de SetAddress/non connecté à un réseau<br>-5: échec de SetAddress/aucun appareil correspondant à MAC n'a été trouvé<br>-6: échec de SetAddress/erreur d'adresse en doublon<br>-7: échec de SetAddress/l'appareil n'a pas accepté la nouvelle adresse<br>-8: échec de SetAddress/argument MAC non valide<br>-9: échec de SetAddress/argument IP non valide<br>-10: échec de SetAddress/argument DNSNAME non valide<br>-11: échec de SetAddress/argument SubnetMask non valide<br>-12: échec de SetAddress/argument Gateway non valide<br>-13: échec de SetAddress/impossible à l'état connecté |

Le service SetAddress correspond au service Set de l'élément de service application (ASE, Application Service Element) DCP spécifié par l'IEC 61158-5-10.

#### 4.6.1.7 Scan

La signature de la méthode spécifiée dans l'IEC 62769-7 s'applique. Le schéma topologyScanResult correspondant est spécifié à l'Annexe A. Le service de balayage se mappe au service Identify spécifié comme ASE DCP PROFINET IO conformément à l'IEC 61158-5-10.

#### 4.6.1.8 ResetScan

La signature de la méthode spécifiée dans l'IEC 62769-7 s'applique.

### 4.6.2 Méthodes pour les Passerelles

#### 4.6.2.1 Généralités

Les signatures de méthode définies en 4.6.2 doivent s'appliquer. Les méthodes doivent être mises en œuvre dans l'élément EDD (voir l'IEC 62769-4) contenu dans un Paquetage FDI relatif à une Passerelle contenant les définitions d'appareils de communication.

#### 4.6.2.2 Connect

Le Paragraphe 4.6.2.2 décrit la mise en œuvre spécifique à une Passerelle PROFINET du service Connect spécifié dans l'IEC 62769-7.

```
METHOD BeginConnect(
    DD_STRING      CommunicationRelationId,
    DD_STRING      DNSNAME,
    unsigned int    DeviceID,
    unsigned int    VendorID,
    unsigned long   ServiceID,
    unsigned long   &DelayForNextCall,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD EndConnect(
    DD_STRING      CommunicationRelationId,
    unsigned long   ServiceID,
    unsigned long   &DelayForNextCall,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}

METHOD CancelConnect(
    DD_STRING      CommunicationRelationId,
    unsigned long   ServiceID,
    long           &ServiceError)
{
    ACCESS ONLINE;
    DEFINITION{<Gateway specific implementation>}
}
```

Le Tableau 14 donne la description des arguments.

**Tableau 14 – Arguments de la Méthode Connect**

| Argument                | Description                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|-------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CommunicationRelationId | La valeur d'argument contient le nodeId du ConnectionPoint qui représente la connexion entre un appareil et un réseau physique directement connecté au matériel du serveur de communication. Le nodeId permet de trouver la relation directe parent-enfant.                                                                                                                                                                                                                    |
| DNSNAME                 | Le nom d'argument doit concorder avec le nom d'attribut correspondant défini pour le ConnectionPoint qui est décrit par un élément EDD correspondant spécifié en 4.5. La valeur d'argument contient l'adresse réseau de l'appareil.                                                                                                                                                                                                                                            |
| DeviceId                | La valeur d'argument contient le numéro d'identification d'appareil défini par le fabricant (voir GSDML, «Attributs de l'élément DeviceIdentity»).                                                                                                                                                                                                                                                                                                                             |
| VendorID                | La valeur d'argument contient le numéro d'identification du fabricant défini par PROFIBUS Nutzerorganisation, ou PNO (voir GSDML, «Attributs de l'élément DeviceIdentity»).                                                                                                                                                                                                                                                                                                    |
| ServiceId               | Le code de transaction de service établit la relation entre la demande de service et la réponse correspondante.                                                                                                                                                                                                                                                                                                                                                                |
| DelayForNextCall        | La valeur spécifie un délai, en ms, pour limiter le cycle d'invocation EndConnect, qui ne doit pas être inférieur à la valeur spécifiée dans la valeur d'argument.                                                                                                                                                                                                                                                                                                             |
| ServiceError            | 1: OK/fonction démarrée de façon asynchrone, le résultat doit être interrogé avec EndConnect<br>0: OK/exécution terminée, connexion établie avec succès<br>-1: échec de la connexion/annulée par l'appelant<br>-2: échec de l'appel/ID de service inconnu<br>-3: échec de la connexion/appareil introuvable<br>-4: échec de la connexion/adresse d'appareil non valide<br>-5: échec de la connexion/DeviceId non valide<br>-6: échec de la connexion/ManufacturerID non valide |

#### 4.6.2.3 Disconnect

Le Paragraphe 4.6.2.3 décrit la mise en œuvre spécifique à PROFINET du service Disconnect spécifié dans l'IEC 62769-7.

```

METHOD Disconnect(
    DD_STRING    CommunicationRelationId,
    long         &ServiceError)
{
    ACCESS ONLINE,
    DEFINITION{<Gateway specific implementation>}
}
    
```

Tous les arguments de la méthode Disconnect sont décrits dans le Tableau 11.

#### 4.6.2.4 Transfer

Le Paragraphe 4.6.2.4 décrit la mise en œuvre spécifique à PROFINET du service Transfer spécifié dans l'IEC 62769-7.

```

METHOD BeginTransfer(
    DD_STRING    CommunicationRelationId,
    DD_STRING    OPERATION,
    unsigned short    SLOT,
    unsigned short    SUBSLOT,
    unsigned short    INDEX,
    unsigned long     API,
    DD_STRING    REQUEST,
    DD_STRING    &REPLY,
    DD_STRING    &RESPONSE_CODES,
    unsigned long    ServiceId,
    unsigned long    &DelayForNextCall,
    )
    
```