

NFPA 231C

Rack Storage of Materials

1991 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

3. Scope of License Grant — The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

MORGAN TECHNICAL LIBRARY
NATIONAL FIRE PROTECTION ASSN.
BATTERYMARCH PARK
QUINCY, MA 02269

231C-1

Copyright © 1991 NFPA, All Rights Reserved

NFPA 231C
Standard for
Rack Storage of Materials

1991 Edition

This edition of NFPA 231C, *Standard for Rack Storage of Materials*, was prepared by the Technical Committee on Rack Storage, released by the Correlating Committee on Storage, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 12-14, 1990 in Miami, FL. It was issued by the Standards Council on January 11, 1991, with an effective date of February 8, 1991, and supersedes all previous editions.

The 1991 edition of this document has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 231C

In August of 1967, representatives of the rack manufacturers, the fire protection equipment field, the insurance community, and industrial users met and organized the Rack Storage Fire Protection Committee. This Committee developed, and financially sponsored, a program of full-scale fire tests for the storage of combustible materials in racks.

In 1968 the NFPA Committee on Rack Storage of Materials was organized. All of the data developed by the Rack Storage Fire Protection Committee was subsequently turned over to the NFPA Committee. Thus, it was possible for the NFPA Committee to write a standard supported entirely by actual fire test data. NFPA 231C was first adopted at the Annual Meeting in May 1971.

In 1972 revisions included making some former recommendations mandatory, and new material was added to the Appendix. In 1973 it was further revised to include storage for heights above 25 ft, and the relocation of advisory material to the Appendix. In 1974 the entire format was revised, editorial changes were made, and new material was added.

In 1975, new test data permitted the introduction of new material. The 1980 edition included partial revisions to the standard, in particular the tables and figures in Chapter 6. Revisions made in 1986 included expanded protection criteria for plastic commodity.

The 1991 edition has incorporated a variety of changes that include editorial improvements as well as numerous substantive changes. Technically important changes for 1991 include permission to utilize intermediate and high temperature sprinklers for plastic commodity. In addition, a series of figures have been included that show relative positions of in-rack sprinklers for rack storage of Group A plastics. The previously issued TIA on ESFR sprinklers has now been incorporated as a new chapter in the 1991 edition.

NFPA 231C

Rack Storage of Materials

1991 Edition

Reference: 5-13.2, Table 6-13.2, 8-1.5.3, 8-1.5.4, Figures 8-2(b), (c), (d), (e), (f), Table 8-2.1

The Committee on Rack Storage notes the following errors in the 1991 edition of *Standard for Rack Storage of Materials*, NFPA 231C:

1. *Change second line of 5-13.2 to read:*

“... shelf in single, double or multiple row racks ...”

2. *Change title of Table 6-13.2 to read:*

Multiple-Row Racks. Rack Depth Over 16 ft or Aisles Narrower than 8 ft, Storage Height up to 25 ft.

3. *Change heading of 8-1.5.3 to read:*

“In-Rack Sprinkler Water Shields.”

4. *Insert heading for 8-1.5.4 as follows:*

“In-Rack Sprinkler Clearance.”

5. In Figure 8-2(b), for the .30/2000 ceiling criteria, change reference to Figure 8-2(g).

6. In Figure 8-2(c), for the .45/2000 ceiling criteria, change reference to Figure 8-2(g); for the .30/2000 ceiling criteria, change reference to Figure 8-2(h).

7. *In Figure 8-2(d), change the reference figures as follows:*

.45/2000 criteria, Note 2, Figure 8-2(g)

.30/2000 criteria, Note 4, Figure 8-2(i)

.30/2000 criteria, Note 4, Figure 8-2(i)

.30/2000 criteria, Note 3, Figure 8-2(h)

8. *In Figure 8-2(e), change the reference figures as follows:*

.45/2000 criteria, Note 3, Figure 8-2(h)

.30/2000 criteria, Note 4, Figure 8-2(i)

(Continued)

9. In Figure 8-2(f), change the reference to Figure 8-2(i).

10. Delete Table 8-2.1 in its entirety.

Issue Date: May, 1991

Copyright © 1991 All Rights Reserved
NATIONAL FIRE PROTECTION ASSOCIATION

Committee on Storage

Correlating Committee

E. J. Schiffhauer, *Chairman*
Eastman Kodak Co.

J. S. Barrett, Eastham, MA
Rep. IRI
Wm. George Clark, MacMillan Bloedel Ltd.

Thomas Goonan, Tom Goonan Associates
Stephen R. Hoover, Kemper Group
W. P. Thomas, Jr., Kemper Group

Nonvoting

Richard A. Comstock, Fire Prevention & Engineering Bureau of Texas
Rep. T/C on Marine Terminals

Technical Committee on Rack Storage

J. S. Barrett, *Chairman*
Eastham, MA
(Rep. IRI)

Charles B. Barnett, ASCOA Fire Systems
Rep. NFSA
Philip R. Belisle, Speedrack Products Group,
Ltd.
Rep. RMI
E. Bertram Berkley, Tension Envelope Corp.
Rep. EMA
William M. Carey, Underwriters Laboratories
Inc.
Ralph E. Collins, R. E. Collins Associates
Robert B. Combs, Johnson & Higgins of WA
Inc.
Frank J. Dahn, Navy Public Works Center
Code 422
Rep. NFEC
Casimir J. Drygas, Jr., M & M Protection Con-
sultants
Robert C. Everson, Calabash, NC
William W. Glassmyer, St. Onge Ruff & Assoc.
Inc.
Robert J. Gray, Fire Spec Inc.
Rep. AFSA

Anthony C. Gumkowski, Travelers Insurance
Cos.
Joseph B. Hankins, Factory Mutual Research
Corp.
Richard S. Johnson, Hilton Head, SC
Rep. T/C on General Storage
Novell Liston, Eaton-Kenway Inc.
Rep. MHI/ASRS
Navin D. Mehta, Defense Logistics Agency
(WIR)
Andy Miller, Hallmark Cards Inc.
Rep. NFPA/IFPS
E. J. Schiffhauer, Eastman Kodak Co.
Chester W. Schirmer, Schirmer Engineering
Corp.
Jack Thacker, Allan Automatic Sprinkler Co.
Rep. NFSA
W. P. Thomas, Jr., Kemper Group
Rep. AAI
William A. Webb, Rolf Jensen & Assoc. Inc.
Donald P. Yuellig, Cincinnati, OH
Rep. FMANA

Alternates

Herbert N. Davidson, Liberty Mutual Insur-
ance Co.
(Alternate to W. P. Thomas, Jr.)
Russell P. Fleming, Nat'l Fire Sprinkler Assoc.
(Alternate to J. Thacker)

Leo W. Fleury, Jr., Grinnell Corp.
Rep. NFSA
(Alternate to C. B. Barnett)
Raymond A. Grill, Rolf Jensen & Assoc. Inc.
(Alternate to W. A. Webb)

John T. Higgins, Dow Corning Corp.

Rep. NFPA/IFPS

(Alternate to A. Miller)

James M. Ingalls, Industrial Risk Insurers

(Alternate to J. S. Barritt)

Herb Klein, Unarco Industries, Inc.

(Alternate to P. R. Belisle)

Keith C. Kremkow, Johnson & Higgins of WA

Inc.

(Alternate to R. B. Combs)

George E. Laverick, Underwriters Laboratories Inc.

(Alternate to W. M. Carey)

James N. Macdonald, Travelers Insurance Cos.

(Alternate to A. C. Gumkowski)

Aaron McCarthy, Factory Mutual Research Corp.

(Alternate to J. B. Hankins)

Raymond Trandel, Marsh & McLennan, Inc.

(Alternate to C. J. Drygas)

Richard P. Bielen, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 Introduction	231C- 7
1-1 Application and Scope	231C- 7
1-2 Definitions	231C- 7
Chapter 2 Classification of Storage	231C- 9
2-1 Commodity Classifications	231C- 9
Chapter 3 Building Construction	231C-10
3-1 Construction	231C-10
3-2 Fire Protection of Steel	231C-10
3-3 Vents and Draft Curtains	231C-10
Chapter 4 Storage Arrangements	231C-10
4-1 Rack Structure	231C-10
4-2 Rack Loading	231C-10
4-3 Flue Space	231C-10
4-4 Aisle Widths	231C-11
4-5 Storage Heights	231C-11
4-6 Commodity Clearances	231C-11
4-7 Storage of Idle Combustible Pallets	231C-11
Chapter 5 Fire Protection — General	231C-11
5-1 Protection Systems	231C-11
5-2 Ceiling Sprinklers	231C-11
5-3 Ceiling Sprinkler Spacing	231C-11
5-4 In-Rack Sprinkler System Size	231C-11
5-5 In-Rack Sprinkler System Control Valves	231C-11
5-6 In-Rack Sprinkler Water Demand	231C-11
5-7 Sprinkler Waterflow Alarm	231C-11
5-8 Hose Connections	231C-11
5-9 Hose Demand	231C-11
5-10 Duration of Water Supplies	231C-11
5-11 High Expansion Foam	231C-12
5-12 Detectors for High Expansion Foam Systems	231C-12
5-13 Solid and Slatted Shelves	231C-12
5-14 Open-Top Combustible Containers	231C-12
5-15 Movable Racks	231C-12
Chapter 6 Fire Protection — Storage up to and Including	
25 Feet (7.62 m) in Height	231C-12
Part A General	231C-12
6-1 In-Rack Sprinkler Type	231C-12
6-2 In-Rack Sprinkler Pipe Size	231C-12
6-3 In-Rack Sprinkler Water Shields	231C-12
6-4 In-Rack Sprinkler Location	231C-12
6-5 In-Rack Sprinkler Spacing	231C-12
6-6 In-Rack Sprinkler Discharge Pressure	231C-12
6-7 In-Rack Sprinkler Water Demand	231C-12
6-8 Ceiling Sprinkler Water Demand	231C-13
6-9 High Expansion Foam Submergence	231C-14
6-10 High Expansion Foam Ceiling Sprinkler Density	231C-14
Part B Double and Single Row Racks	231C-14
6-11 Ceiling Sprinkler Water Demand	231C-14
6-12 In-Rack Sprinkler Location	231C-14

Part C	Multiple Row Racks	231C-14
6-13	In-Rack Sprinkler Location	231C-14
6-14	Ceiling Sprinkler Water Demand	231C-20
Chapter 7	Fire Protection — Storage over 25 Feet (7.62 m) in Height	231C-20
Part A	General	231C-20
7-1	In-Rack Sprinkler Type	231C-20
7-2	In-Rack Sprinkler Spacing	231C-20
7-3	In-Rack Sprinkler Pipe Size	231C-20
7-4	In-Rack Sprinkler Water Shields	231C-20
7-5	In-Rack Sprinkler Location	231C-21
7-6	In-Rack Sprinkler Discharge Pressure	231C-21
7-7	In-Rack Sprinkler Water Demand	231C-21
7-8	High Expansion Foam Submergence	231C-21
7-9	High Expansion Foam—Ceiling Sprinkler Water Demand	231C-21
Part B	Double and Single Row Racks	231C-21
7-10	In-Rack Sprinkler Location	231C-21
7-11	In-Rack Sprinkler Horizontal Barriers	231C-21
7-12	Ceiling Sprinkler Water Demand	231C-21
Part C	Multiple Row Racks	231C-29
7-13	In-Rack Sprinkler Location	231C-29
7-14	In-Rack Sprinkler Spacing	231C-29
7-15	Ceiling Sprinkler Water Demand	231C-29
Chapter 8	Plastics	231C-33
8-1	General	231C-33
8-2	Single, Double, and Multi-Row Racks	231C-33
8-3	Single and Double Row Racks — Storage over 25 Ft (7.7 m) in Height	231C-38
Chapter 9	Large-Drop Sprinklers	231C-41
9-1	General	231C-41
Chapter 10	Early Suppression Fast Response (ESFR) Sprinklers	231C-41
10-1	General	231C-41
10-2	Sprinkler System Design	231C-42
10-3	Water Demand	231C-42
Chapter 11	Equipment	231C-42
11-1	Mechanical Handling Equipment	231C-42
Chapter 12	Building Maintenance and Operation	231C-42
12-1	Building Operations Other than Storage	231C-42
12-2	Waste Disposal	231C-42
12-3	Smoking	231C-42
12-4	Maintenance	231C-42
12-5	Plant Emergency Organization	231C-42
12-6	General Fire Protection	231C-42
Chapter 13	Referenced Publications	231C-42
Appendix A		231C-43
Appendix B		231C-49
Appendix C	Referenced Publications	231C-55
Index		231C-55

NFPA 231C
Standard for
Rack Storage of Materials
1991 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph or section in the text indicates explanatory material on that paragraph or section in Appendix A.

A dagger (†) following the number or letter designating a paragraph or section in the text indicates explanatory test data and procedures in regard to that paragraph or section in Appendix B.

Information on referenced publications can be found in Chapter 13 and Appendix C.

Chapter 1 Introduction

1-1† Application and Scope. This standard applies to storage of materials representing the broad range of combustibles stored over 12 ft (3.66 m) in height on racks. For storage height of 12 ft (3.66 m) or less, see NFPA 13, *Standard for the Installation of Sprinkler Systems*.

Storage on plastic pallets or plastic shelves is outside the scope of this standard.

Storage of high hazard materials such as tires, roll paper stored on end, and flammable liquids is outside the scope of this standard. Storage of such commodities shall be protected in accordance with the provisions of NFPA 30, *Flammable and Combustible Liquids Code*; NFPA 40, *Standard for the Storage and Handling of Cellulose Nitrate Motion Picture Film*; NFPA 490, *Code for the Storage of Ammonium Nitrate*; NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*; NFPA 81, *Standard for Fur Storage, Fumigation and Cleaning*; NFPA 231, *Standard for General Storage*; NFPA 231D, *Standard for Storage of Rubber Tires*; NFPA 231E, *Recommended Practice for the Storage of Baled Cotton*; NFPA 231F, *Standard for the Storage of Roll Paper*; and NFPA 232, *Standard for the Protection of Records*, as applicable.

Bin storage and shelf storage are outside the scope of this standard.

1-2 Definitions. Unless expressly stated elsewhere, the following terms shall, for the purpose of this standard, have the meanings indicated below.

Aisle Width. The horizontal dimension between the face of the loads in racks under consideration. (See Figure 1-2-1.)

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate

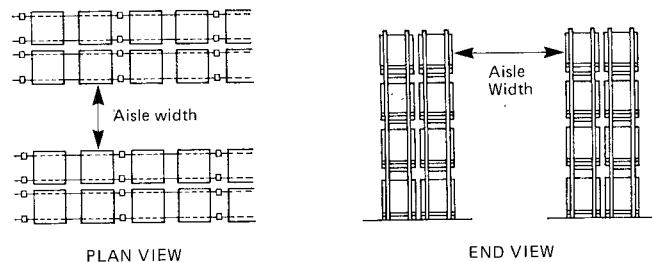


Figure 1-2-1 Illustration of Aisle Width.

testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Bulkhead. A vertical barrier across the rack.

Clearance. Clearance is the distance from the top of storage to the ceiling sprinkler deflectors.

Commodity. Designates combinations of product, packing material, and container upon which commodity classification is based.

Conventional Pallets. A material handling aid designed to support a unit load with openings to provide access for material handling devices (see Figure 1-2-2).

Encapsulated. A method of packaging consisting of a plastic sheet completely enclosing the sides and top of a pallet load containing a combustible commodity or a combustible package or a group of combustible commodities or combustible packages. Totally noncombustible commodities on wood pallets enclosed only by a plastic sheet as described are not considered to fall under this definition. Banding, i.e., stretch wrapping around the sides only of a pallet load, is not considered to be encapsulated. The term encapsulated does not apply to individual plastic-enclosed items inside a large nonplastic enclosed container.

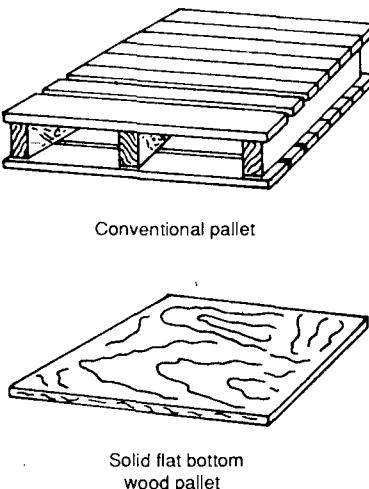


Figure 1-2.2 Typical Pallets.

ESFR. See NFPA 13, *Standard for the Installation of Sprinkler Systems*.

Face Sprinklers. Standard sprinklers located in transverse flue spaces along the aisle or in the rack, within 18 in. (0.46 m) of the aisle face of storage to oppose vertical development of fire on the external face of storage.

Free-Flowing Plastic Materials. Those plastics which will fall out of their containers in a fire condition, fill flue spaces, and create a smothering effect on the fire. Example: powder, pellets, flakes, or random packed small objects [razor blade dispensers, 1-2 oz (30-59 ml) bottles, etc.].

Horizontal Barrier. A solid barrier in the horizontal position covering the entire rack, including all flue spaces at certain height increments, to prevent vertical fire spread.

Labeled. Equipment or materials to which has been attached a label, symbol or other identifying mark of an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

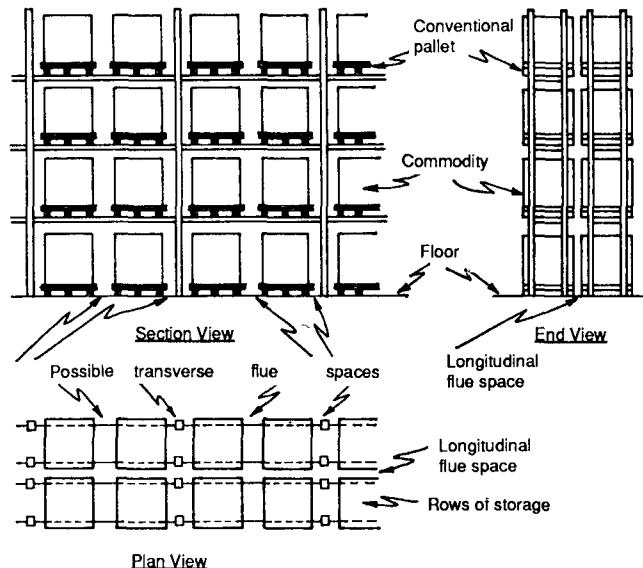


Figure 1-2.3 Typical Double Row (Back-to-Back) Rack Arrangement.

Longitudinal Flue Space. The space between rows of storage perpendicular to the direction of loading (see Figure 1-2.3).

Rack. Any combination of vertical, horizontal, and diagonal members that support stored materials. Some rack structures use solid shelves. Racks may be fixed, portable, or movable [see Figures A-4-1(a) through (k)]. Loading may be either manual, using lift trucks, stacker cranes, or hand placement; or automatic, using machine controlled storage and retrieval systems.

Single Row Racks. Single row racks are racks with no longitudinal flue space and having a width up to 6 ft (1.8 m) with aisles at least 3.5 ft (1.1 m) from other storage.

Double Row Racks. Double row racks are two single row racks placed back to back, having a combined width up to 12 ft (3.7 m) with aisles at least 3.5 ft (1.1 m) on each side.

Multi-Row Racks. Multi-row racks are racks greater than 12 ft (3.7 m) wide or single or double row racks separated by aisles less than 3.5 ft (1.1 m) wide having an overall width greater than 12 ft (3.7 m).

Portable Racks. Portable racks are racks that are not fixed in place. They can be arranged in any number of configurations.

Movable Racks. Movable racks are racks on fixed rails or guides. They can be moved back and forth only in a horizontal two-dimensional plane. A moving aisle is created as abutting racks are either loaded or unloaded, then moved across the aisle to abut other racks. Rack arrangements generally result in the same protection needs as for multi-row racks.

Shall. Indicates a mandatory requirement.

Shelf Storage. Storage in structures usually less than 30 in. (0.76 m) deep, seldom more than 2 ft (0.61 m) between shelves and seldom higher than 12 ft (3.66 m).

Should. Indicates a recommendation or that which is advised but not required.

Slave Pallet. A special pallet captive to a material handling system (see Figure 1-2.2).

Solid Shelving. Solid shelving is solid, slatted, or other types of shelves located within racks that obstruct sprinkler water penetration down through the racks.

Transverse Flue Space. The space between rows of storage parallel to the direction of loading (see Figure 1-2.3).

Chapter 2 Classification of Storage

2-1† Commodity Classifications.

2-1.1 Class I commodity is defined as essentially noncombustible products on wood pallets, or in ordinary corrugated cartons with or without single thickness dividers, or in ordinary paper wrappings, all on wood pallets. Such products are permitted to have a negligible amount of plastic trim, such as knobs or handles.

Examples of Class I products are:

Metal Products. Metal desks with plastic tops and trim, electrical coils, electrical devices in their metal enclosures, pots and pans, electrical motors, dry cell batteries, metal parts, empty cans, stoves, washers, dryers, and metal cabinets.

Glass Products. Glass bottles, empty or filled with noncombustible liquids; mirrors.

Foods. Foods in noncombustible containers; frozen foods; meat; fresh fruits and vegetables in nonplastic trays or containers; dairy products in nonwax-coated paper containers; beer or wine, up to 20 percent alcohol, in metal, glass, or ceramic containers.

Others. Oil-filled and other types of distribution transformers, cement in bags, electrical insulators, gypsum board, inert pigments, and dry insecticides.

2-1.2 Class II commodity is defined as Class I products in slatted wooden crates, solid wooden boxes, multi-wall corrugated cartons, or equivalent combustible packaging material on wood pallets.

Examples of Class II products are: thinly coated fine wire such as radio coil wire on reels or in cartons; incandescent or fluorescent light bulbs; beer or wine, up to 20 percent alcohol, in wood containers; and Class I products, if in small cartons or small packages placed in ordinary corrugated cartons.

2-1.3 Class III commodity is defined as wood, paper, natural fiber cloth, Group C plastics, or products thereof; on wood pallets. Products are permitted to contain a limited amount of Group A or B plastics. Wood dressers with plastic drawer glides, handles, and trim are examples of a commodity with a limited amount of plastic.

Examples of Class III products are:

Paper Products. Books, magazines, newspapers; stationery; plastic-coated paper food containers; paper or cardboard games; tissue products; rolled paper on side or steel banded on end; and regenerated cellulosics (cellophane).

Leather Products. Shoes, jackets, gloves, and luggage.

Wood Products. Doors, windows, door and window frames, combustible fiberboard, wood cabinets, furniture, and other wood products.

Textiles. Natural fiber upholstered nonplastic furniture; wood or metal furniture with plastic padded and covered armrests; mattresses without expanded plastic or rubber; absorbent cotton in cartons; natural fiber and viscose yarns, thread, and products; and natural fiber clothing or textile products.

Others. Tobacco products in paperboard cartons; nonflammable liquids such as soaps, detergent and bleaches, and nonflammable pharmaceuticals in plastic containers; combustible foods or cereal products; and nonnegative-producing film packs in sealed metal foil wrappers in paperboard packages.

2-1.4 Class IV commodity is defined as Class I, II, or III products containing an appreciable amount of Group A plastics in a paperboard carton or Class I, II, or III products with Group A plastic packing in paperboard cartons on wood pallets. Group B plastics and free-flowing Group A plastics are also included in this class. (See Section 1-1.)

Examples of Class IV products are: small appliances, typewriters, and cameras with plastic parts; plastic-backed tapes and synthetic fabrics or clothing. An example of packing material is a metal product in a foamed plastic cocoon in a corrugated carton.

Class IV commodities also include:

Textiles. Synthetic thread and yarn except viscose, and nonviscose synthetic fabrics or clothing.

Others. Vinyl floor tile, wood or metal frame upholstered furniture or mattresses with plastic covering and/or padding, and plastic-padded metal dashboards or metal bumpers.

2-1.5 Classification of Plastics, Elastomers, and Rubber.

Note: The following categories are based on unmodified plastic materials. The use of fire or flame-retarding modifiers or the physical form of the material may change the classification.

Group A

ABS (Acrylonitrile-Butadiene-Styrene Copolymer)

Acetal (Polyformaldehyde)

Acrylic (Polymethyl Methacrylate)

Butyl Rubber

EPDM (Ethylene-Propylene Rubber)

FRP (Fiberglass Reinforced Polyester)

Natural Rubber

Nitrile Rubber (Acrylonitrile-Butadiene Rubber)

PET (Thermoplastic Polyester)

Polybutadiene

Polycarbonate

Polyester Elastomer

Polyethylene

Polypropylene
 Polystyrene
 Polyurethane
 PVC (Polyvinyl Chloride — highly plasticized, e.g., coated fabric, unsupported film)
 SAN (Styrene Acrylonitrile)
 SBR (Styrene-Butadiene Rubber)

Group B

Cellulosics (Cellulose Acetate, Cellulose Acetate Butyrate, Ethyl Cellulose)
 Chloroprene Rubber
 Fluoroplastics (ECTFE — Ethylene-Chlorotrifluoroethylene Copolymer; ETFE — Ethylene-Tetrafluoroethylene Copolymer; FEP — Fluorinated Ethylene-Propylene Copolymer)
 Nylon (Nylon 6, Nylon 6/6)
 Silicon Rubber

Group C

Fluoroplastics (PCTFE — Polychlorotrifluoroethylene; PTFE — Polytetrafluoroethylene)
 Melamine (Melamine Formaldehyde)
 Phenolic
 PVC (Polyvinyl Chloride — rigid or lightly plasticized, e.g., pipe, pipe fittings)
 PVDC (Polyvinylidene Chloride)
 PVDF (Polyvinylidene Fluoride)
 PVF (Polyvinyl Fluoride)
 Urea (Urea Formaldehyde)

Chapter 3 Building Construction

3-1 Construction. Buildings used for the rack storage of materials that are protected in accordance with this standard shall be of any of the types described in NFPA 220, *Standard on Types of Building Construction*.

3-2 Fire Protection of Steel.

3-2.1† With sprinkler systems installed in accordance with Chapters 6, 7, 8, 9, and 10, fire protection of roof steel is not required.

3-2.2† Where ceiling sprinklers and sprinklers in racks are installed in accordance with Chapters 5, 6, 7, and 8; fire protection of steel building columns is not required.

3-2.3† Where storage height exceeds 15 ft (4.57 m) and ceiling sprinklers only are installed, fire protection by one of the following methods is required for all types of steel building columns located within the racks or for vertical rack members that support the building:

(a) One-hr fire proofing.

(b) Side wall sprinklers at the 15-ft (4.57-m) elevation, pointed toward one side of the steel column.

(c) For storage heights above 15 ft (4.57 m), up to and including 20 ft (6.1 m), provision of ceiling sprinkler density for a minimum of 2000 sq ft (185.9 m²) with 165°F (74°C) or 286°F (141°C) temperature-rated sprinklers as shown in Table 3-2.3.

(d) Provision of large drop or ESFR ceiling sprinkler protection in accordance with Chapters 9 and 10, respectively.

Table 3-2.3

Commodity Class	Aisle	
	4 ft (1.22 m)	8 ft (2.44 m)
I	0.37	0.33
II	0.44	0.37
III	0.49	0.42
IV and Plastics	0.68	0.57

NOTE: For aisle widths between 4 ft and 8 ft (1.22 m – 2.44 m), a direct linear interpolation between densities may be made.

3-3† Vents and Draft Curtains. Design curves are based upon roof vents and draft curtains not being used.

Chapter 4 Storage Arrangements

4-1* Rack Structure. Rack configurations shall be of a generally accepted arrangement.

4-2* Rack Loading. Racks shall not be loaded beyond their design capacity.

4-3 Flue Space.

4-3.1† In double row racks with height of storage up to and including 25 ft (7.62 m), and without solid shelves, a longitudinal flue space (back-to-back clearance) is not necessary. Nominal 6-in. (152.4-mm) transverse flue space between loads or at rack uprights shall be maintained. Random variations in the width of the flue spaces or in their vertical alignment shall be permitted. (See Figure 4-3.1.)

Exception: A longitudinal flue space is necessary when ESFR sprinkler protection is provided.

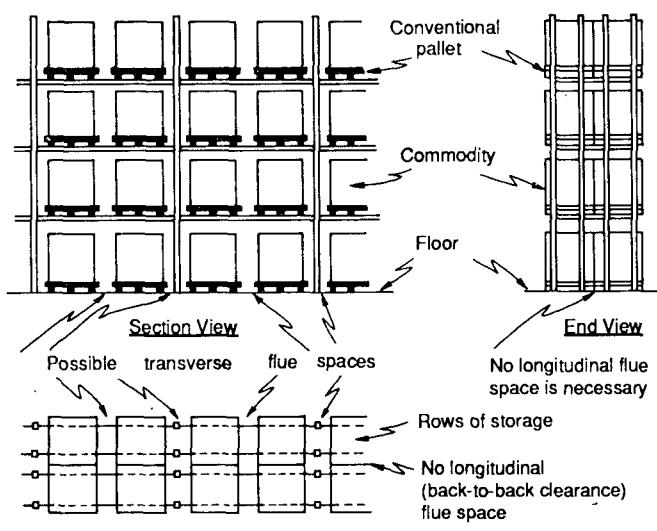


Figure 4-3.1 Typical Double Row Rack with Back-to-Back Loads.

4-3.2 In double row racks with height of storage over 25 ft (7.62 m), a minimum longitudinal flue space of (nominal) 6 in. (152.4 mm) shall be provided.

4-4* Aisle Widths.

4-4.1 Aisle widths and depth of racks are determined by material handling methods. Width of aisles shall be considered in the design of the protection system (see Chapters 5, 6, and 7).

4-4.2 This standard contemplates that aisle widths will be maintained either by fixed rack structures or control in placing of portable racks. Any decrease in aisle width shall require a review of the adequacy of the protective system.

4-5*† Storage Heights. The distance from the top of the pile to the ceiling sprinkler deflectors shall be not less than 18 in. (0.46 m).

Exception: When large-drop or ESFR sprinkler protection is used, the distance from top of storage to the ceiling sprinkler deflectors shall be not less than 36 in. (0.91 m).

4-6 Commodity Clearances.

4-6.1* Commodity clearances shall be maintained in accordance with NFPA 91, *Standard for the Installation of Blower and Exhaust Systems for Dust, Stock and Vapor Removal or Conveying*.

4-6.2* Incandescent Light Fixtures.

4-7*† Storage of Idle Combustible Pallets. Bulk storage of idle combustible pallets shall be in accordance with NFPA 231, *Standard for General Storage*.

Chapter 5 Fire Protection — General

5-1 Protection Systems.

5-1.1 Protection systems that are provided for rack storage facilities shall be in accordance with the provisions of this chapter.

5-1.2 The densities and areas provided in the tables and curves in Chapters 6, 7, and 8 are based on fire tests using standard response; standard orifice [1/2 in. (12.7 mm)] and large orifice [17/32 in. (13.5 mm)] sprinklers. For the use of large-drop and ESFR sprinklers, see Chapters 9 and 10, respectively.

5-2 Ceiling Sprinklers.

5-2.1* Where automatic sprinkler systems are installed, they shall be in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, except as modified by this standard.

5-2.2* In buildings that are occupied in part for rack storage of commodities, the ceiling sprinkler system design within 15 ft (4.57 m) of the racks shall be the same as that provided over the rack storage area.

5-3† Ceiling Sprinkler Spacing. For the purpose of selecting sprinkler spacings in hydraulically designed sprinkler systems, to obtain a stipulated density, 60 psi (413.7 kPa) shall be the maximum discharge pressure used at the calculation starting point.

5-4 In-Rack Sprinkler System Size. The area protected by a single system of sprinklers in racks (in-rack sprinklers) shall not exceed 40,000 sq ft (3716 m²) of floor area occupied by the racks, including aisles, regardless of the number of intermediate sprinkler levels.

5-5* In-Rack Sprinkler System Control Valves.

5-5.1* When sprinklers are installed in racks, separate indicating control valves and drains shall be provided for ceiling sprinklers and sprinklers in racks.

Exception No. 1: In-rack installations of 20 or less sprinklers.

Exception No. 2: The separate indicating valves may be arranged as sectional control valves when the racks occupy only a portion of the area protected by the ceiling sprinklers. (See 5-2.2.)

5-6 In-Rack Sprinkler Water Demand. Water demand of sprinklers installed in racks shall be added to ceiling sprinkler water demand at the point of connection. The demand shall be balanced to the higher pressure.

5-7*† Sprinkler Waterflow Alarm.

5-8† Hose Connections. For first aid fire fighting and for mop-up operations, small [1 1/2 in. (38.1 mm)] hose lines shall be available to cover all areas of the rack structure. Such small hose shall be supplied from:

- (a) Outside hydrants
- (b) A separate piping system for small hose stations
- (c) Valved hose connections on sprinkler risers where such connections are made upstream of all sprinkler control valves
- (d) Adjacent sprinkler systems.

Exception: When separately controlled in-rack sprinklers are provided, the ceiling sprinkler system in the same area shall be permitted to be used.

5-9 Hose Demand.

5-9.1 For inside hose streams an allowance of at least 100 gpm (378 L/min) shall be added to sprinkler water demand for Class I, II, III, IV, or plastic commodities.

5-9.2 For combined inside and outside hose streams, an allowance of at least 500 gpm (1893 L/min) shall be added to sprinkler water demand for Class I, II, III, IV, or plastic commodities.

5-10† Duration of Water Supplies. For double row racks the water supply duration shall be at least 1 1/2 hr for Class I, II, and III commodities and at least 2 hr for Class IV and Group A plastic commodities. For multiple row racks the water supply duration shall be at least 2 hr for all classifications of commodities.

5-11 High Expansion Foam.

5-11.1* When high expansion foam systems are installed, they shall be in accordance with NFPA 11A, *Standard for Medium- and High-Expansion Foam Systems*, except as modified by this standard, and they shall be automatic in operation.

5-11.2 When high expansion foam systems are used in combination with ceiling sprinklers, in-rack sprinklers shall not be required.

5-12 Detectors for High Expansion Foam Systems.

5-12.1 Detectors shall be listed and shall be installed:

(a) At the ceiling only if installed at one-half listed linear spacing [e.g., 15 ft \times 15 ft (4.57 m \times 4.57 m) instead of 30 ft \times 30 ft (9.15 m \times 9.15 m)].

Exception: Ceiling detectors only should not be used when clearance from the top of storage exceeds 10 ft (3.05 m) or height of storage exceeds 25 ft (7.62 m).

or,

(b) At the ceiling at listed spacing and in racks at alternate levels, or

(c) When listed for rack storage installation and installed in accordance with their listing to provide response within one min after ignition using ignition source equal to that used on the rack storage testing program.

5-13 Solid and Slatted Shelves.

5-13.1* Slatted shelves shall be considered the same as solid shelves.

5-13.2† Sprinklers shall be installed at the ceiling and beneath each shelf in double or multiple row racks with solid shelves that obstruct both longitudinal and transverse flue spaces. Design curves for combined ceiling and in-rack sprinklers shall be used with this storage configuration.

5-14† Open-Top Combustible Containers.

5-15 Movable Racks.

5-15.1 Rack storage in movable racks shall be protected in the same manner as multiple row racks.

Chapter 6 Fire Protection — Storage up to and Including 25 Feet (7.62 m) in Height

Part A General

NOTE: See also Chapter 5.

6-1 In-Rack Sprinkler Type. Sprinklers in racks shall be ordinary temperature classification with nominal $\frac{1}{2}$ -in. (12.7-mm) orifice size pendent or upright. Sprinklers with 212°F (100°C) and 286°F (141°C) temperature ratings shall be used near heat sources as required by NFPA 13.

6-2 In-Rack Sprinkler Pipe Size. The number of sprinklers and the pipe sizing on a line of sprinklers in racks is restricted only by hydraulic calculations and not by any piping schedule.

6-3† In-Rack Sprinkler Water Shields. Water shields shall be provided directly above in-rack sprinklers, or listed sprinklers equipped with water shields shall be used when there is more than one level, if not shielded by horizontal barriers.

6-4 In-Rack Sprinkler Location.

6-4.1*† The elevation of in-rack sprinkler deflectors with respect to storage shall not be a consideration in single or double rack storage up to and including 20 ft (6.1 m) high.

6-4.2* In single or double row racks without solid shelves with height of storage over 20 ft (6.1 m), or in multiple row racks, or in single or double row racks with solid shelves and height of storage up to and including 25 ft (7.62 m), a minimum of 6 in. (152.4 mm) vertical clear space shall be maintained between the sprinkler deflectors and the top of a tier of storage. Sprinkler discharge shall not be obstructed by horizontal rack members.

6-4.3 In-rack sprinklers at one level only for storage up to and including 25 ft (7.62 m) high in single or double row racks shall be located at the first tier level at or above one-half of the storage height.

6-4.4 In-rack sprinklers at two levels only for storage up to and including 25 ft (7.62 m) high shall be located at the first tier level at or above one-third and two-thirds of the storage height.

6-5 In-Rack Sprinkler Spacing.

6-5.1* Maximum horizontal spacing of sprinklers in single or double row racks with nonencapsulated storage up to and including 25 ft (7.62 m) in height shall be in accordance with the following table:

Commodity Class			
Aisle Widths	I & II	III	IV
8 ft	12 ft	12 ft	8 ft
4 ft	12 ft	8 ft	8 ft

For SI Units: 1 ft = 0.3048 m

For encapsulated storage, maximum horizontal spacing is 8 ft (2.44 m).

6-5.2† Sprinklers installed in racks shall be spaced without regard to rack uprights.

6-6† In-Rack Sprinkler Discharge Pressure. Sprinklers in racks shall discharge at not less than 15 psi (103.4 kPa) for all classes of commodity.

6-7† In-Rack Sprinkler Water Demand. Water demand for sprinklers installed in racks shall be based on simultaneous operation of the most hydraulically remote:

(a) Six sprinklers when only one level is installed in racks with Class I, II, or III commodity.

(b) Eight sprinklers when only one level is installed in racks with Class IV commodity.

(c) Ten sprinklers (five on each two top levels) when more than one level is installed in racks with Class I, II, or III commodity.

(d) Fourteen sprinklers (seven on each two top levels) when more than one level is installed in racks with Class IV commodity.


6-8 Ceiling Sprinkler Water Demand.

6-8.1*† Design curves in Figures 6-11.1(a) through (g) apply to nominal 20-ft (6.1-m) height of storage.

6-8.1.1 The design curves indicate water demands for nominal 165°F (74°C) and nominal 286°F (141°C) sprinklers at the ceiling. The 165°F (74°C) design curves shall be used for sprinklers with ordinary and intermediate temperature classification but not less than 160°F (71°C). The 286°F (141°C) design curve shall be used for sprinklers with high temperature classification.

6-8.2 For height of storage up to and including 25 ft (7.62 m) protected with ceiling sprinklers only, and for height of storage up to and including 20 ft (6.1 m) protected with ceiling sprinklers and minimum acceptable in-rack sprinklers, densities given in design curves shall be adjusted according to Figure 6-8.2.

6-8.3 For height of storage over 20 ft (6.1 m) up to and including 25 ft (7.62) protected with ceiling sprinklers and minimum acceptable in-rack sprinklers, densities given in design curves shall be used. Densities shall not be adjusted per Figure 6-8.2.

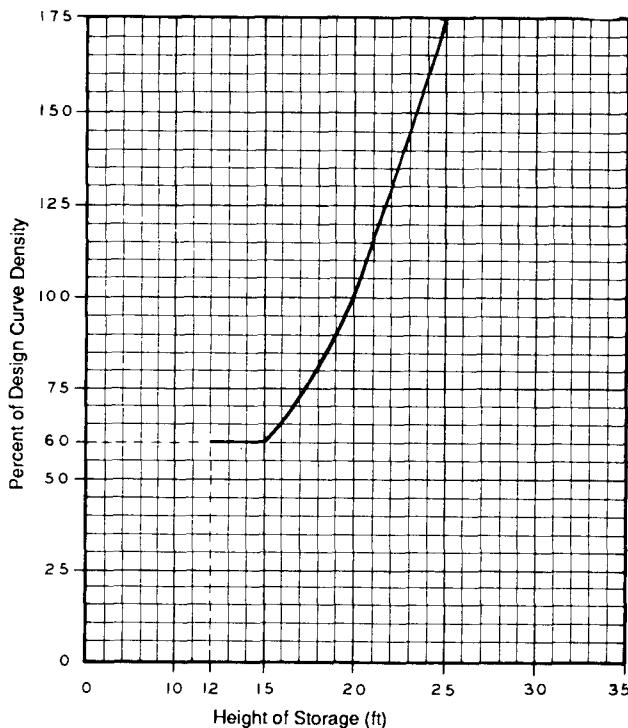

For SI Units: 1 ft = 0.3048 m

Figure 6-8.2 Ceiling Sprinkler Density versus Storage Height.

Table 6-8.2 Adjustment to Ceiling Sprinkler Density for Storage Height and In-Rack Sprinklers

Stge. Height (ft)	In-Rack Sprinklers	Apply Fig. 6-8.2	Permitted Ceiling Sprinklers Density Adjustments
Over 12 Ft Through 25 Ft	None	Yes	None
	Minimum Acceptable	Yes	None
	More than Minimum but Not In Every Tier	Yes	Reduce Density 20% from that for Minimum In-Rack Sprinklers
Over 20 Ft Through 25 Ft	In Every Tier	Yes	Reduce Density 40% from that for Minimum In-Rack Sprinklers
	Minimum Acceptable	No	None
	More than Minimum but Not In Every Tier	No	Reduce Density 20% from that for Minimum In-Rack Sprinklers
Over 20 Ft Through 25 Ft	In Every Tier	No	Reduce Density 40% from that for Minimum In-Rack Sprinklers

For SI Units: 1 ft = 0.3048 m

6-8.4 For height of storage up to and including 20 ft (6.1 m) protected with ceiling sprinklers and with more than one level of in-rack sprinklers, but not in every tier, densities given in design curves and adjusted according to Figure 6-8.2 shall be permitted to be reduced an additional 20 percent.


6-8.5 For height of storage over 20 ft (6.1 m) up to and including 25 ft (7.62 m) protected with ceiling sprinklers, and with more than the minimum acceptable level of in-rack sprinklers, but not in every tier, densities given in design curves shall be permitted to be reduced 20 percent. Densities shall not be adjusted per Figure 6-8.2.

6-8.6 For height of storage up to and including 20 ft (6.1 m) protected with ceiling sprinklers and in-rack sprinklers at each tier, densities given in design curves and adjusted according to Figure 6-8.2 shall be permitted to be reduced an additional 40 percent.

6-8.7 For height of storage over 20 ft (6.1 m) up to and including 25 ft (7.62 m) protected with ceiling sprinklers and in-rack sprinklers at each tier, densities given in design curves shall be permitted to be reduced 40 percent. Densities shall not be adjusted per Figure 6-8.2.

6-8.8† When clearance from top of storage to ceiling is less than 4½ ft (1.37 m) (see Section 4-5), the sprinkler operating area indicated in curves E, F, G, and H in Figures 6-11.1(a), (b), (c), (d), and (e) shall be permitted to be reduced as indicated in Figure 6-8.8, but not less than 2,000 sq ft (185.8 m²) (see 6-8.9).

6-8.9 When clearance from ceiling to top of Class I or II encapsulated storage is 1½ to 3 ft (0.46 m to 0.91 m), sprinkler operating area indicated in curve F only of Figure 6-11.1(e) shall be permitted to be reduced by 50 percent but to not less than 2,000 sq ft (185.8 m²).

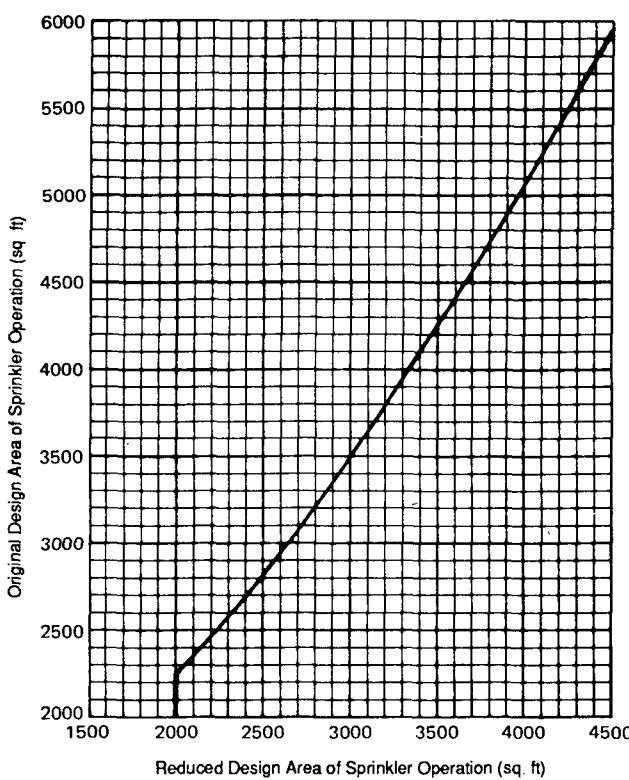

For SI Units: 1 ft = 0.0929 m²

Figure 6-8.8 Adjustment of Design Area of Sprinkler Operation for Clearance from Top of Storage to Ceiling.

6-8.10 Where solid flat bottom wood pallets are used, with height of storage up to and including 25 ft (7.62 m), the densities indicated in the design curves, based on conventional pallets, shall be increased 20 percent for the given area. This percentage shall be applied to the density resulting from the application of Figure 6-8.2. This increase shall not apply when in-rack sprinklers are installed.

6-9 High Expansion Foam Submergence.

6-9.1* When high expansion foam systems are used without sprinklers, the maximum submergence time shall be 5 min for Class I, II, or III commodities and 4 min for Class IV commodities.

6-9.2 When high expansion foam systems are used in combination with ceiling sprinklers, the maximum submergence time shall be 7 min for Class I, II, or III commodities and 5 min for Class IV commodities.

6-10 High Expansion Foam Ceiling Sprinkler Density. When high expansion foam systems are used in combination with ceiling sprinklers, the minimum ceiling sprinkler design shall be a density of 0.2 gpm per sq ft [(8.15 L/min)/m²] for Class I, II, or III commodities or 0.25 gpm per sq ft [(10.2 L/min)/m²] for Class IV commodities for the most hydraulically remote 2,000-sq ft (185.8-m²) operating area.

Part B Double and Single Row Racks

NOTE: See also Chapter 5.

6-11 Ceiling Sprinkler Water Demand.

6-11.1* For Class I, II, III, or IV commodities encapsulated or nonencapsulated in single or double row racks, ceiling sprinkler water demand in terms of density (gpm per sq ft) and area of sprinkler operation (sq ft of ceiling or roof) shall be selected from curves given in Figures 6-11.1(a) through (g). The curves in Figures 6-11.1(a) through (g) shall also apply to portable racks arranged in the same manner as single or double row racks or multiple row racks. The design shall be sufficient to satisfy a single point on the appropriate curve related to the storage configuration and commodity class. It shall not be necessary to meet all points on the selected curve. Figure 6-8.2 shall be used to adjust density for storage height unless otherwise specified.

6-11.2† Design curves for single and double row racks shall be selected corresponding to aisle width. For aisle widths between 4 ft (1.22 m) and 8 ft (2.44 m), a direct linear interpolation between curves shall be made. Density given for 8-ft (2.44-m) wide aisles shall be applied to aisles wider than 8 ft (2.44 m). Density given for 4-ft (1.22-m) wide aisles shall be applied to aisles narrower than 4 ft (1.22 m) down to 3 1/2 ft (1.07 m). When aisles are narrower than 3 1/2 ft (1.07 m), racks shall be considered as multiple row racks.

6-12 In-Rack Sprinkler Location. In single or double row racks without solid shelves, in-rack sprinklers shall be installed as indicated in Table 6-11.1.

Part C Multiple Row Racks

NOTE: See also Chapter 5.

6-13 In-Rack Sprinkler Location.

6-13.1† For encapsulated or nonencapsulated storage in multiple row racks no deeper than 16 ft (4.88 m) with aisles no narrower than 8 ft (2.44 m), in-rack sprinklers shall be installed as indicated in Table 6-13.1.

6-13.2 For encapsulated or nonencapsulated storage in multiple row racks deeper than 16 ft (4.88 m), or with aisles less than 8 ft (2.44 m) wide, in-rack sprinklers shall be installed as indicated in Table 6-13.2.


6-13.3* Maximum horizontal spacing of sprinklers on branch lines, in multiple row racks with encapsulated or nonencapsulated storage up to and including 25 ft (7.62 m) in height, shall not exceed 12 ft (3.66 m) for Class I, II, or III commodities and 8 ft (2.44 m) for Class IV commodities, with area limitations of 100 sq ft (9.29 m²) per sprinkler for Class I, II, or III commodities and 80 sq ft (7.43 m²) per sprinkler for Class IV commodities. The rack plan view shall be considered in determining area covered by each sprinkler. The aisles are not to be included in area calculations.

6-13.4 A minimum of 6 in. (152.4 mm) shall be maintained between the sprinkler deflector and top of a tier of storage.

Height	Commodity Class	Encap-sulated	Aisles (Ft) (4-4.1) (B-6-11.2)	Sprinklers Mandatory In-Rack	Ceiling Sprinkler Water Demand					
					With In-Rack Sprinklers			Without In-Rack Sprinklers		
					Fig.	Curves	Apply Fig. 6-8.2	Fig.	Curves	Apply Fig. 6-8.2
Over 12 Ft, Up Thru 20 Ft	I	No	4 8	No	6-11.1(a)	C&D A&B	Yes	6-11.1(a)	G&H E&F	Yes
		Yes	4 8	No	6-11.1(e)	C&D A&B		6-11.1(e)	G&H E&F	Yes
	II	No	4 8	No	6-11.1(b)	C&D A&B		6-11.1(b)	G&H E&F	Yes
		Yes	4 8	No	6-11.1(e)	C&D A&B		6-11.1(e)	G&H E&F	Yes
	III	No	4 8	No	6-11.1(c)	C&D A&B		6-11.1(c)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(f)	C&D A&B				
	IV	No	4 8	No	6-11.1(d)	C&D A&B		6-11.1(d)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(g)	C&D A&B				
Over 20 Ft, Up Thru 22 Ft	I	No	4 8	No	6-11.1(a)	C&D A&B	No	6-11.1(a)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(e)	C&D A&B				
	II	No	4 8	No	6-11.1(b)	C&D A&B		6-11.1(b)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(e)	C&D A&B				
	III	No	4 8	No	6-11.1(c)	C&D A&B		6-11.1(c)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(f)	C&D A&B				
	IV	No	4 8	No	6-11.1(d)	C&D A&B		6-11.1(d)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(g)	C&D A&B				
Over 22 Ft, Up Thru 25 Ft	I	No	4 8	No	6-11.1(a)	C&D A&B	No	6-11.1(a)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(e)	C&D A&B				
	II	No	4 8	No	6-11.1(b)	C&D A&B		6-11.1(b)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(e)	C&D A&B				
	III	No	4 8	No	6-11.1(c)	C&D A&B		6-11.1(c)	G&H E&F	Yes
		Yes	4 8	1 Level	6-11.1(f)	C&D A&B				
	IV	No	4 8	1 Level	6-11.1(d)	C&D A&B				
		Yes	4 8		6-11.1(g)	C&D A&B				

For SI Units: 1 ft = 0.3048 m


Table 6-11.1 Single or Double Row Racks. Height of Storage up to and Including 25 Ft, Aisles Wider than 4 Ft, without Solid Shelves.

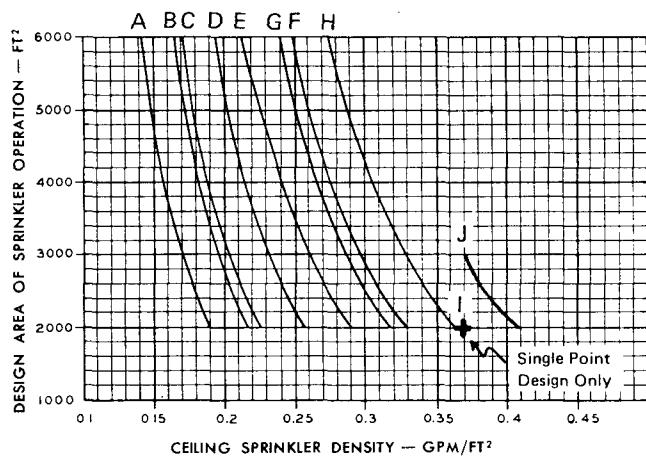

For SI Units: 1 ft = 0.3048 m; C = $\frac{\pi}{9}$ (F-32); 1 gpm/ft² = 40.746 (L/min)/m²

Figure 6-11.1(a) Sprinkler System Design Curves — 20-Ft High Rack Storage — Class I Nonencapsulated Commodities — Conventional Pallets.


Curve	Legend	Curve	Legend
A	Single or double row racks with 8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	E	Single or double row racks with 8-ft aisles and 286°F ceiling sprinklers.
B	Single or double row racks with 8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	F	Single or double row racks with 8-ft aisles and 165°F ceiling sprinklers.
C	Single or double row racks with 4-ft aisles or multiple row racks with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	G	Single or double row racks with 4-ft aisles and 286°F ceiling sprinklers.
D	Single or double row racks with 4-ft aisles or multiple row racks with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	H	Single or double row racks with 4-ft aisles and 165°F ceiling sprinklers.
I	Multiple row racks with 8-ft or wider aisles and 286°F ceiling sprinklers.	I	Multiple row racks with 8-ft or wider aisles and 286°F ceiling sprinklers.
J	Multiple row racks with 8-ft or wider aisles and 165°F ceiling sprinklers.		

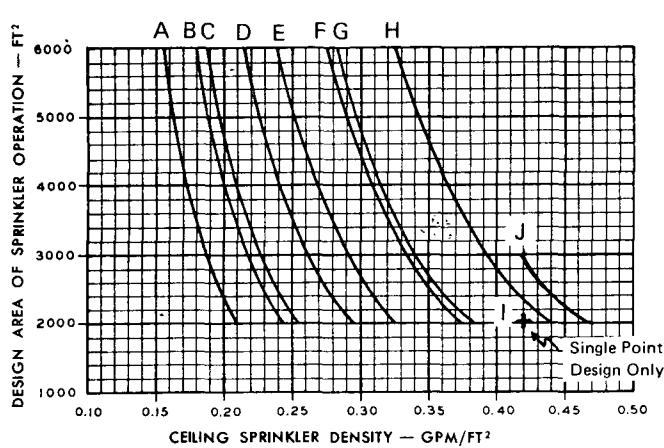

For SI Units: 1 ft = 0.3048 m; C = $\frac{\pi}{9}$ (F-32); 1 gpm/ft² = 40.746 (L/min)/m²

Figure 6-11.1(b) Sprinkler System Design Curves — 20-Ft High Rack Storage — Class II Nonencapsulated Commodities — Conventional Pallets.


Curve	Legend	Curve	Legend
A	Single or double row racks with 8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	E	Single or double row racks with 8-ft aisles and 286°F ceiling sprinklers.
B	Single or double row racks with 8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	F	Single or double row racks with 8-ft aisles and 165°F ceiling sprinklers.
C	Single or double row racks with 4-ft aisles or multiple row racks with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	G	Single or double row racks with 4-ft aisles and 286°F ceiling sprinklers.
D	Single or double row racks with 4-ft aisles or multiple row racks with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	H	Single or double row racks with 4-ft aisles and 165°F ceiling sprinklers.
I	Multiple row racks with 8-ft or wider aisles and 286°F ceiling sprinklers.	I	Multiple row racks with 8-ft or wider aisles and 286°F ceiling sprinklers.
J	Multiple row racks with 8-ft or wider aisles and 165°F ceiling sprinklers.		

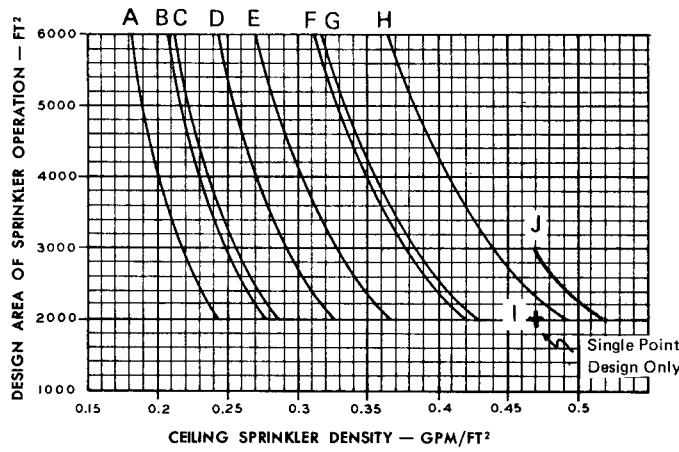

Curve	Legend	Curve	Legend
A	Single or double row racks with 8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	E	Single or double row racks with 8-ft aisles and 286°F ceiling sprinklers.
B	Single or double row racks with 8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	F	Single or double row racks with 8-ft aisles and 165°F ceiling sprinklers.
C	Single or double row racks with 4-ft aisles or multiple row racks with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	G	Single or double row racks with 4-ft aisles and 286°F ceiling sprinklers.
D	Single or double row racks with 4-ft aisles or multiple row racks with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	H	Single or double row racks with 4-ft aisles and 165°F ceiling sprinklers.
I	Multiple row racks with 8-ft or wider aisles and 286°F ceiling sprinklers.		
J	Multiple row racks with 8-ft or wider aisles and 165°F ceiling sprinklers.		

For SI Units: 1 ft = 0.3048 m; C = $\frac{7}{9}$ (F-32); 1 gpm/ft² = 40.746 (L/min)/m²

Figure 6-11.1(c) Sprinkler System Design Curves — 20-Ft High Rack Storage — Class III Nonencapsulated Commodities — Conventional Pallets.

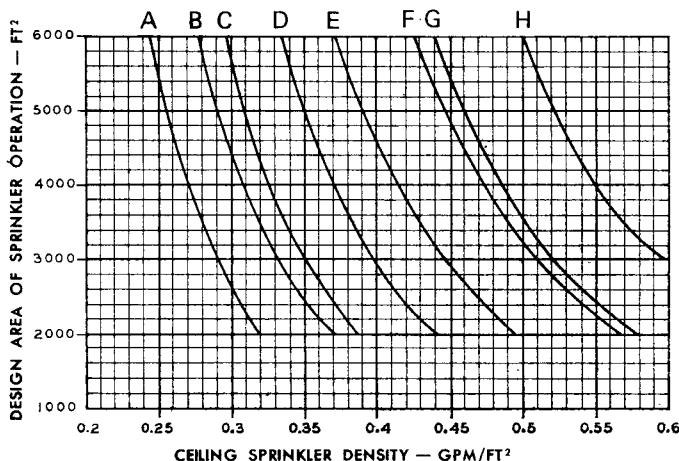


Curve	Legend	Curve	Legend
A	Single or double row racks with 8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	E	Single or double row racks with 8-ft aisles and 286°F ceiling sprinklers.
B	Single or double row racks with 8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	F	Single or double row racks with 8-ft aisles and 165°F ceiling sprinklers.
C	Single or double row racks with 4-ft aisles or multiple row racks with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	G	Single or double row racks with 4-ft aisles and 286°F ceiling sprinklers.
D	Single or double row racks with 4-ft aisles or multiple row racks with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	H	Single or double row racks with 4-ft aisles and 165°F ceiling sprinklers.

Note: Curves C and D also apply to ceiling sprinklers only for multiple row racks up to and including 15 ft (4.2 m) high, and Figure 6-8.2 shall not be applied.

For SI Units: 1 ft = 0.3048 m; C = $\frac{7}{9}$ (F-32); 1 gpm/ft² = 40.746 (L/min)/m²


Figure 6-11.1(d) Sprinkler System Design Curves — 20-Ft High Rack Storage — Class IV Nonencapsulated Commodities — Conventional Pallets.

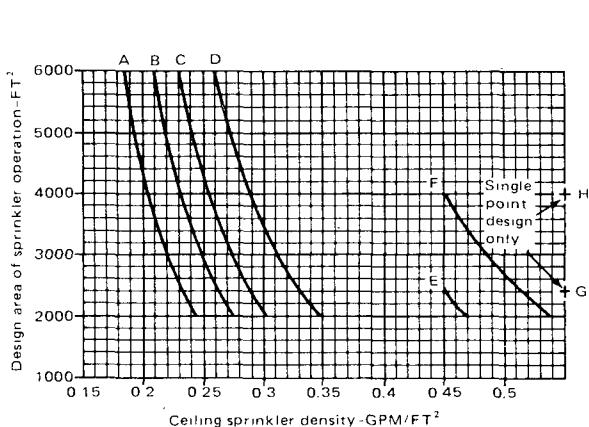

Curve	Legend	Curve	Legend
A	8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	E	8-ft aisles with 286°F ceiling sprinklers.
B	8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	F	8-ft aisles with 165°F ceiling sprinklers.
C	4-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	G	4-ft aisles with 286°F ceiling sprinklers.
D	4-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	H	4-ft aisles with 165°F ceiling sprinklers.

For SI Units: 1 ft = 0.3048 m; C = γ_9 (F-32); 1 gpm/ft² = 40.746 (L/min)/m²


Figure 6-11.1(e) Single or Double Row Racks — 20-Ft High Rack Storage — Sprinkler System Design Curves — Class I & II Encapsulated Commodities — Conventional Pallets.

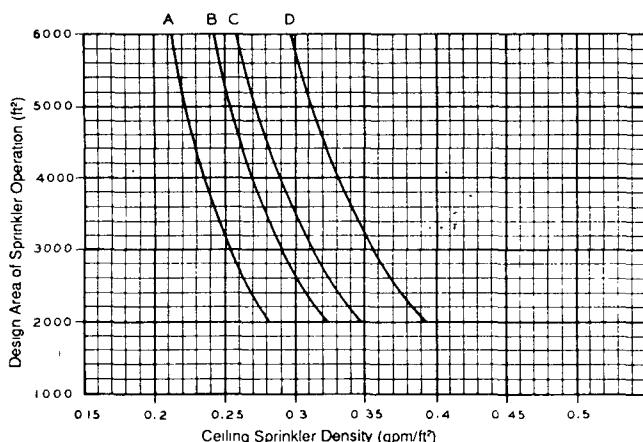

Curve	Legend	Curve	Legend
A	8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	C	4-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.
B	8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	D	4-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.

For SI Units: 1 ft = 0.3048 m; C = γ_9 (F-32); 1 gpm/ft² = 40.746 (L/min)/m²

Figure 6-11.1(f) Single or Double Row Racks — 20-Ft High Rack Storage — Sprinkler System Design Curves — Class III Encapsulated Commodities — Conventional Pallets.

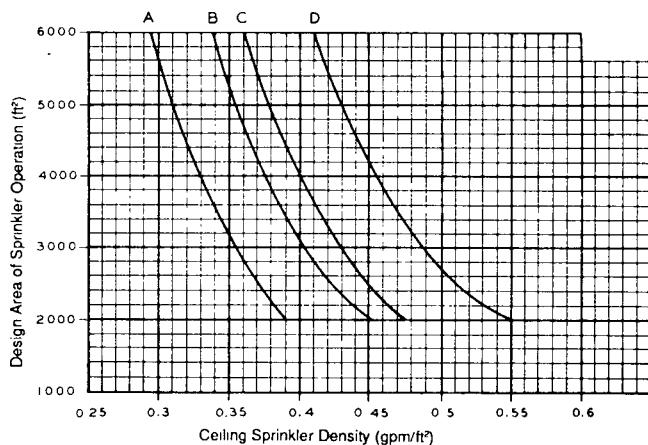

Curve	Legend	Curve	Legend
A	8-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.	C	4-ft aisles with 286°F ceiling sprinklers and 165°F in-rack sprinklers.
B	8-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.	D	4-ft aisles with 165°F ceiling sprinklers and 165°F in-rack sprinklers.

For SI Units: 1 ft = 0.3048 m; C = $\frac{5}{9}$ (F-32); 1 gpm/ft² = 40.746 (L/min)/m²

Figure 6-11.1(g) Single or Double Row Racks — 20-Ft High Rack Storage — Sprinkler System Design Curves — Class IV Encapsulated Commodities — Conventional Pallets.

Table 6-13.1 Multiple-Row Racks, Rack Depth up to 16 Ft, Aisles Wider than 8 Ft, Storage Height up to 25 Ft.

Height	Commodity Class	Encapsulated	Sprinklers Mandatory In-Racks	Ceiling Sprinkler Water Demand								
				With In-Rack Sprinklers				Without In-Rack Sprinklers				
				Fig. No.	Curves	Apply Fig. 6-8.2	1.25 x Density	Fig. No.	Curves	Apply Fig. 6-8.2	1.25 x Density	
Over 12 Ft Up Thru 15 Ft	I	No	No	6-11.1(a)	C&D	Yes	No	6-11.1(a)	I&J	Yes	No	
		Yes		6-11.1(a)			Yes	6-11.1(a)	I&J		Yes	
	II	No		6-11.1(b)			No	6-11.1(b)	I&J	Yes	No	
		Yes		6-11.1(b)			Yes	6-11.1(b)	I&J		Yes	
	III	No	No	6-11.1(c)			No	6-11.1(c)	I&J	Yes	No	
		Yes	1 Level	6-11.1(c)			Yes					
	IV	No	No	6-11.1(d)			No	6-11.1(d)	C&D	No	No	
		Yes	1 Level	6-11.1(d)	A&B		1.50 x Density					
Over 15 Ft Up Thru 20 Ft	I	No	No	6-11.1(a)	C&D	Yes	No	6-11.1(a)	I&J	Yes	No	
		Yes		6-11.1(a)			Yes	6-11.1(a)	I&J		Yes	
	II	No		6-11.1(b)			No	6-11.1(b)	I&J	Yes	No	
		Yes		6-11.1(b)			Yes	6-11.1(b)	I&J		Yes	
	III	No	No	6-11.1(c)			No	6-11.1(c)	I&J	Yes	No	
		Yes	1 Level	6-11.1(c)			Yes					
	IV	No	1 Level	6-11.1(d)			No					
		Yes		6-11.1(d)	A&B		1.50 x Density					
Over 20 Ft Up Thru 25 Ft	I	No	6-11.1(a)	C&D	No	No	6-11.1(a)	I&J	Yes	No		
		Yes	1 Level			Yes						
	II	No	6-11.1(b)			No						
		Yes	6-11.1(b)			Yes						
	III	No	6-11.1(c)			No						
		Yes	6-11.1(c)			Yes						
	IV	No	6-11.1(d)	A&B			No					
		Yes	6-11.1(d)				1.50 x Density					

For SI Units: 1 ft = .3048 m

Table 6-13.2 Multiple-Row Racks. Rack Depth up to 16 Ft or Aisles Narrower than 8 Ft, Storage Height up to 25 Ft.

Height	Commodity Class	Encapsulated	Sprinklers Mandatory In-Racks	Ceiling Sprinkler Water Demand							
				With In-Rack Sprinklers				Without In-Rack Sprinklers			
				Fig. No.	Curves	Apply Fig. 6-8.2	1.25 x Density	Fig. No.	Curves	Apply Fig. 6-8.2	1.25 x Density
Over 12 Ft Up Thru 15 Ft	I	No	No	6-11.1(a)	C&D	Yes	No	6-11.1(a)	I&J	Yes	No
		Yes		6-11.1(a)			Yes	6-11.1(a)	I&J		Yes
	II	No		6-11.1(b)			No	6-11.1(b)	I&J	Yes	No
		Yes		6-11.1(b)			Yes	6-11.1(b)	I&J		Yes
	III	No		6-11.1(c)			No	6-11.1(c)	I&J	Yes	No
		Yes		1 Level			Yes				
	IV	No		6-11.1(d)			No	6-11.1(d)	C&D	No	No
		Yes		1 Level			1.50 x Density				
Over 15 Ft Up Thru 20 Ft	I	No	1 Level	6-11.1(a)	C&D	Yes	No			Yes	
		Yes		6-11.1(a)			Yes				
	II	No		6-11.1(b)			No			Yes	
		Yes		6-11.1(b)			Yes				
	III	No		6-11.1(c)			No			Yes	
		Yes		6-11.1(c)			Yes				
	IV	No		6-11.1(d)			No			Yes	
		Yes		6-11.1(d)			1.50 x Density				
Over 20 Ft Up Thru 25 Ft	I	No	1 Level	6-11.1(a)	C&D	No	No			Yes	
		Yes		6-11.1(a)			Yes				
	II	No		6-11.1(b)			No			Yes	
		Yes		6-11.1(b)			Yes				
	III	No		6-11.1(c)			No			Yes	
		Yes		6-11.1(c)			Yes				
	IV	No	2 Levels	6-11.1(d)	C&D	No	No			Yes	
		Yes		6-11.1(d)			1.50 x Density				

For SI Units: 1 ft = .3048 m

6-14 Ceiling Sprinkler Water Demand.

6-14.1 For nonencapsulated Class I, II, III, or IV commodities, ceiling sprinkler water demand in terms of density (gpm per sq ft) and area of sprinkler operation (sq ft of ceiling or roof) shall be selected from curves given in Figures 6-11.1(a) through (d). The curves in Figures 6-11.1(a) through (d) also apply to portable racks arranged in the same manner as single, double, or multiple row racks. The design shall be sufficient to satisfy a single point on the appropriate curve related to the storage configuration and commodity class. It shall not be necessary to meet all points on the selected curve. Figure 6-8.2 shall be used to adjust density for storage height unless otherwise specified. (See *A-6-5.1* and *A-6-11.1*.)

6-14.2 For encapsulated Class I, II, or III commodities with height of storage up to and including 25 ft (7.62 m) on multiple row racks, ceiling sprinkler density shall be 25 percent greater than for nonencapsulated commodities on multiple row racks.

6-14.3 For encapsulated Class IV commodities with height of storage up to and including 25 ft (7.62 m) on multiple row racks, ceiling sprinkler density shall be 50 percent greater than for nonencapsulated commodities on double row racks.

Chapter 7 Fire Protection — Storage over 25 Feet (7.62 m) in Height

Part A General

7-1 In-Rack Sprinkler Type. Sprinklers in racks shall be ordinary temperature classification with nominal 1/2-in. (12.7-mm) orifice size, pendent or upright. Sprinklers with 212°F (100°C) and 286°F (141°C) temperature ratings shall be used near heat sources as required in NFPA 13.

7-2 In-Rack Sprinkler Spacing. In-rack sprinklers shall be staggered horizontally and vertically when installed as indicated in Table 7-10.1, Figures 7-10.1(a) through (j), and Figures 7-10.3(a) through (e).

7-3 In-Rack Sprinkler Pipe Size. The number of sprinklers and the pipe sizing on a line of sprinklers in racks is restricted only by hydraulic calculations and not by any piping schedule.

7-4 In-Rack Sprinkler Water Shields. Water shields shall be provided directly above in-rack sprinklers, or listed sprinklers equipped with water shields shall be provided when there is more than one level, if not shielded by horizontal barriers (see *Appendix B-6-3*).

7-5 In-Rack Sprinkler Location. In double row or multiple row racks, a minimum 6 in. (152.4 mm) vertical clear space shall be maintained between the sprinkler deflectors and the top of a tier of storage. Face sprinklers in such racks shall be located a minimum of 3 in. (76.2 mm) from rack uprights and no more than 18 in. (0.46 m) from the aisle face of storage. Other sprinklers in racks shall be located a minimum of 2 ft (0.61 m) from rack uprights.

Exception: When the distance between uprights is less than 4 ft (1.22 m), sprinklers shall be centered between uprights.

7-6 In-Rack Sprinkler Discharge Pressure. Sprinklers in racks shall discharge at not less than 30 psi (206.8 kPa) for all classes of commodity (see Appendix B-6-7).

7-7 In-Rack Sprinkler Water Demand.

7-7.1 Water demand for sprinklers installed in racks shall be based on simultaneous operation of the most hydraulically remote:

- (a) Six sprinklers when only one level is installed in racks with Class I, II, or III commodity.
- (b) Eight sprinklers when only one level is installed in racks with Class IV commodity.
- (c) Ten sprinklers (five on each two top levels) when more than one level is installed in racks with Class I, II, or III commodity.
- (d) Fourteen sprinklers (seven on each two top levels) when more than one level is installed in racks with Class IV commodity.

7-8 High Expansion Foam Submergence. When high expansion foam systems are used for storage over 25 ft (7.62 m) high, up to and including 35 ft (10.67 m) high, they shall be used in combination with ceiling sprinklers. The maximum submergence time for the high expansion foam shall be 5 min for Class I, II, or III commodities and 4 min for Class IV commodities.

7-9 High Expansion Foam—Ceiling Sprinkler Water Demand. When high expansion foam is used in combination with ceiling sprinklers, the sprinkler design shall be 0.2 gpm per sq ft [(8.15 L/min)/m²] for Class I, II, or III commodities and 0.25 gpm per sq ft [(10.19 L/min)/m²] for Class IV commodities, over the most hydraulically remote 2,000-sq ft (185.8-m²) area.

Part B Double and Single Row Racks

7-10 In-Rack Sprinkler Location.

7-10.1 In double row racks without solid shelves and with a maximum of 10 ft (3.05 m) between top of storage and ceiling, in-rack sprinklers shall be installed as indicated in Table 7-10.1 and Figures 7-10.1(a) through (j). The highest level of in-rack sprinklers shall be not more than 10 ft (3.05 m) below top of storage (see Section 7-11).

7-10.2 In-rack sprinklers for storage higher than 25 ft (7.62 m) in double row racks shall be spaced horizontally and located in horizontal space nearest the vertical intervals indicated in Table 7-10.1, Figures 7-10.1(a) through (j).

7-10.3* In single row racks without solid shelves with height of storage over 25 ft (7.62 m) and a maximum of 10 ft (3.05 m) between top of storage and ceiling, sprinklers shall be installed as indicated in Figures 7-10.3(a) through (e).

7-11* In-Rack Sprinkler Horizontal Barriers. Horizontal barriers used in conjunction with in-rack sprinklers to impede vertical fire development shall be constructed of sheet metal, wood, or similar material and shall extend the full length and width of the rack. Barriers shall be fitted within 2-in. (50.8-mm) horizontally around rack uprights [see Table 7-10.1, Figures 7-10.1(a), (g), and (j), and Figures 7-10.3(c) and (e)].

7-12 Ceiling Sprinkler Water Demand.

7-12.1†* Water demand for nonencapsulated storage on racks without solid shelves separated by aisles at least 4-ft (1.22-m) wide and with not more than 10 ft (3.05 m) between top of storage and sprinklers shall be based on sprinklers in a 2,000 sq ft (185.8 m²) operating area, discharging a minimum of 0.25 gpm per sq ft [(10.18 L/min)/m²] for Class I commodities, 0.3 gpm per sq ft [(12.2 L/min)/m²] for Class II and III commodities, and 0.35 gpm per sq ft [(14.26 L/min)/m²] for Class IV commodities, for 165°F (74°C) sprinklers; or a minimum of 0.35 gpm per sq ft [(14.26 L/min)/m²] for Class I commodities, 0.40 gpm per sq ft [(16.3 L/min)/m²] for Class II and III commodities, and 0.45 gpm per sq ft [(18.3 L/min)/m²] for Class IV commodities, for 286°F (141°C) sprinklers (see Table 7-10.1).

7-12.2 Where storage as described in 7-12.1 is encapsulated, ceiling sprinkler density shall be 25 percent greater than for nonencapsulated.

Table 7-10.1 Double-Row Racks without Solid Shelves, Storage Higher than 25 Ft, Aisles Wider than 4 Ft

Commodity Class	In-rack sprinklers — approximate vertical spacing at tier nearest the vertical distance and maximum horizontal spacing ⁽¹⁾⁽²⁾			Fig. No.	Maximum Storage Height	Stagger	Ceiling Sprinkler Operating Area	Ceiling Sprinkler Density (gpm/sq ft) ⁽⁶⁾							
	Longitudinal Flue ⁽³⁾		Face ⁽⁴⁾⁽⁸⁾					Clearance ⁽⁵⁾ Up to 10 ft ⁽⁷⁾							
	165°	286°													
I	Vertical 20 ft	None	7-10.1(a)	30 ft	No	2000 sq ft	0.25	0.35							
	Horizontal 10 ft under horizontal Barriers								0.25						
I, II, & III	Vertical 20 ft	Vertical 20 ft	7-10.1(b)	Higher than 25 ft	Yes	2000 sq ft	0.25	0.35							
	Horizontal 10 ft	Horizontal 10 ft													
	Vertical 10 ft or at 15 ft & 25 ft	None	7-10.1(c)		Yes		0.30	0.40							
	Horizontal 10 ft														
	Vertical 10 ft	Vertical 30 ft	7-10.1(d)		Yes		0.30	0.40							
	Horizontal 10 ft	Horizontal 10 ft													
I, II, III, & IV	Vertical 20 ft	Vertical 20 ft	7-10.1(e)	Higher than 25 ft	Yes	2000 sq ft	0.30	0.40							
	Horizontal 10 ft	Horizontal 5 ft													
	Vertical 25 ft	Vertical 25 ft	7-10.1(f)		No		0.30	0.40							
	Horizontal 5 ft	Horizontal 5 ft													
	Horizontal barriers at 20 ft. Vertical intervals-2 lines of sprinklers under barriers-maximum horizontal spacing 10 ft staggered.				Yes		0.30	0.40							
	7-10.1(g)														
I, II, III, & IV	Vertical 15 ft	Vertical 20 ft	7-10.1(h)	Higher than 25 ft	Yes	2000 sq ft	0.35	0.45							
	Horizontal 10 ft	Horizontal 10 ft													
	Vertical 20 ft	Vertical 20 ft	7-10.1(i)		No		0.35	0.45							
	Horizontal 5 ft	Horizontal 5 ft			Yes		0.35	0.45							
	Horizontal barriers at 15 ft. Vertical intervals-2 lines of sprinkler under barriers-maximum horizontal spacing 10 ft staggered														
	7-10.1(j)														

For SI Units: 1 ft = 0.3048 m

Footnotes to Table 7-10.1

¹Minimum in-rack sprinkler pressure, 30 psi (2.1 bar) (Section 7-6).

²Water shields required (Section 6-3 and Section 7-4).

³Install sprinklers at least 2 ft (0.61 m) from uprights (A-6-4.1).

⁴Install sprinklers at least 3 in. (76.2 mm) from uprights (Section 7-5).

⁵Clearance is distance between top of storage and ceiling.

⁶For encapsulated commodity, increase density 25 percent (7-12.1).

⁷See A-7-10.3, A-7-11, and A-7-12.1 for protection suggestions when clearance is greater than 10 ft (3.05 m).

⁸Face sprinklers are not mandatory for a Class I commodity consisting of noncombustible products on wood pallets (without combustible containers) except for arrays shown in Figure 7-10.1(g) and Figure 7-10.1(j).

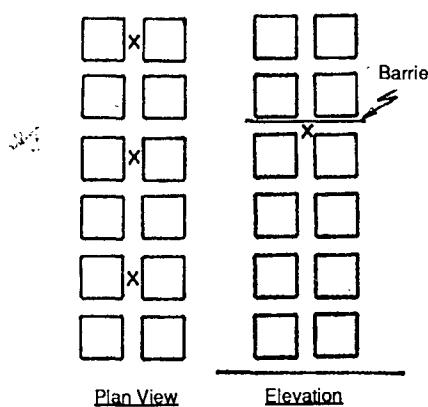


Figure 7-10.1(a) In-Rack Sprinkler Arrangement, Class I Commodity, Maximum Height of Storage 25 Ft (7.62 m) to 30 Ft (9.15 m).

NOTES:

1. Symbol X indicates in-rack sprinklers.

2. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

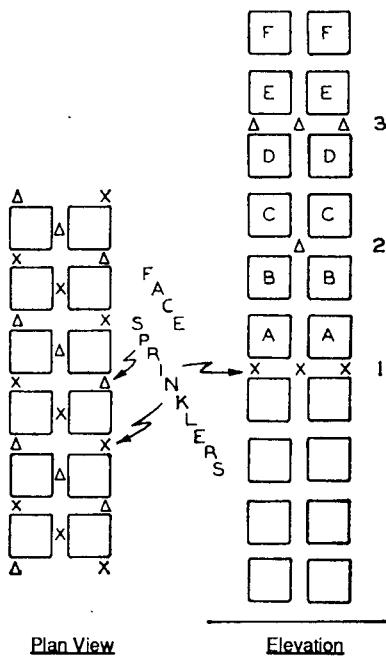


Figure 7-10.1(b) In-Rack Sprinkler Arrangement, Class I Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled C or D represent top of storage.
3. Sprinklers labeled 1 and 3 required when loads labeled E or F represent top of storage.
4. For storage higher than represented by loads labeled F, the cycle defined by notes 2 and 3 is repeated WITH STAGGER AS INDICATED.
5. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
6. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

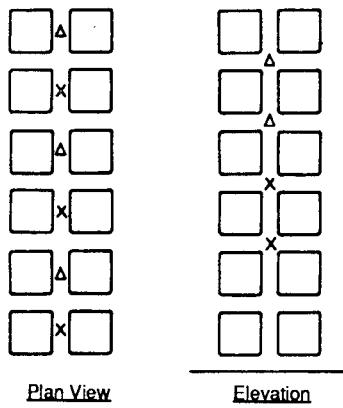


Figure 7-10.1(c) In-Rack Sprinkler Arrangement, Class I, II, or III Commodity, Maximum Height of Storage 25 Ft (7.62 m) to 30 Ft (9.15 m).

NOTES:

1. Alternate location of in-rack sprinklers. Sprinklers may be installed at the second and fourth or the third and fifth tiers.
2. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
3. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

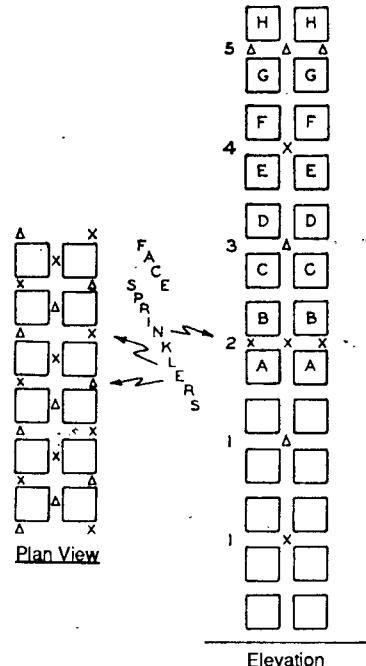


Figure 7-10.1(d) In-Rack Sprinkler Arrangement, Class I, II, or III Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers labeled 1 required when loads labeled A represent the top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled B or C represent top of storage.
3. Sprinklers labeled 1, 2, and 3 required when loads labeled D or E represent top of storage.
4. Sprinklers labeled 1, 2, 3, and 4 required when loads labeled F or G represent top of storage.
5. Sprinklers labeled 1, 2, 3, 4, and 5 required when loads labeled H represent top of storage.
6. For storage higher than represented by loads labeled H, the cycle defined by notes 3, 4, and 5 is repeated with stagger as indicated.
7. The indicated face sprinklers may be omitted when commodity consists of unwrapped or unpackaged metal parts on wood pallets.
8. Symbols A or X indicate sprinklers on vertical or horizontal stagger.
9. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

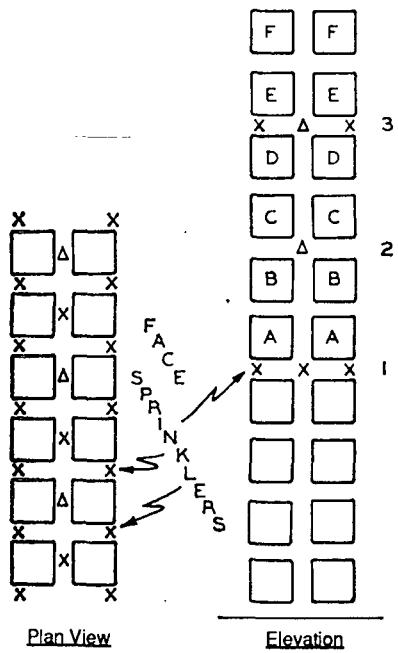


Figure 7-10.1(e) In-Rack Sprinkler Arrangement, Class I, II, or III Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled C or D represent top of storage.
3. Sprinklers labeled 1 and 3 required when loads labeled E or F represent top of storage.
4. For storage higher than represented by loads labeled F, the cycle defined by notes 2 and 3 is repeated, with stagger as indicated.
5. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
6. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

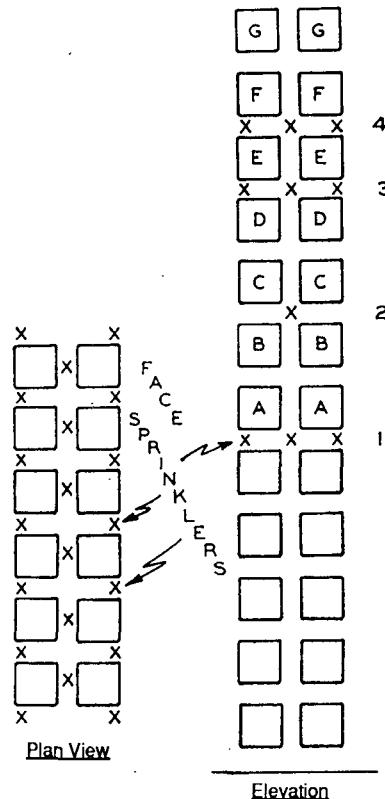


Figure 7-10.1(f) In-Rack Sprinkler Arrangement, Class I, II, or III Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled C or D represent top of storage.
3. Sprinklers labeled 1 and 3 required when loads labeled E represent top of storage.
4. Sprinklers labeled 1 and 4 required when loads labeled F or G represent top of storage.
5. For storage higher than represented by loads labeled G, the cycle defined by notes 2, 3, and 4 is repeated.
6. Symbol X indicates face and in-rack sprinklers.
7. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

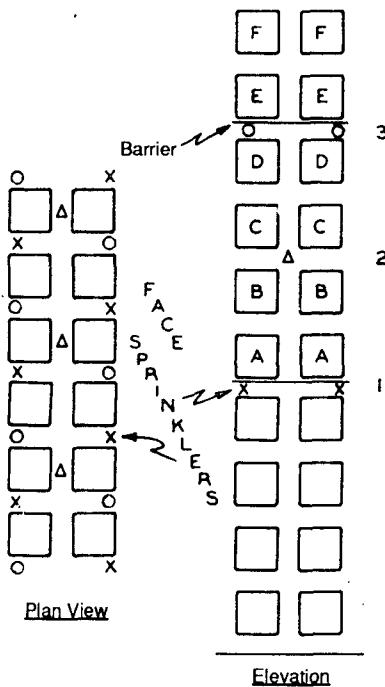


Figure 7-10.1(g) In-Rack Sprinkler Arrangement, Class I, II, or III Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled C or D represent top of storage.
3. Sprinklers labeled 1 and 3 required when loads labeled E or F represent top of storage.
4. For storage higher than represented by loads labeled F, the cycle defined by notes 2 and 3 is repeated.
5. Symbols O, Δ, or X indicate sprinklers on vertical or horizontal stagger.
6. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

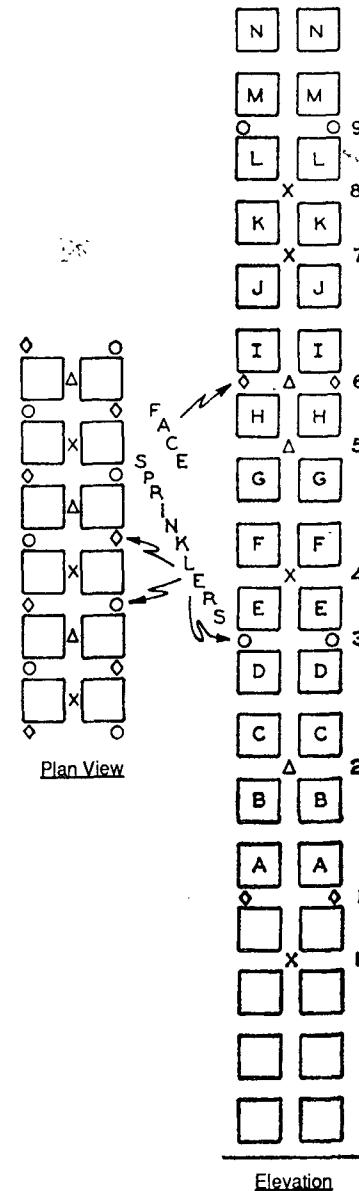


Figure 7-10.1(h) In-Rack Sprinkler Arrangement, Class I, II, III, or IV Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES to Figure 7-10.1(h):

1. Sprinklers labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled C or D represent top of storage.
3. Sprinklers labeled 1, 2, and 3 required when loads labeled E or F represent top of storage.
4. Sprinklers labeled 1, 2, 3, and 4 required when loads labeled G represent top of storage.
5. Sprinklers labeled 1, 2, 3, 4, and 5 required when loads labeled H represent top of storage.
6. Sprinklers labeled 1, 2, 3, 4, and 6 (not 5) required when loads labeled I or J represent top of storage.
7. Sprinklers labeled 1, 2, 3, 4, 6, and 7 required when loads labeled K represent top of storage.
8. Sprinklers labeled 1, 2, 3, 4, 6, and 8 required when loads labeled L represent top of storage.
9. Sprinklers labeled 1, 2, 3, 4, 6, 8, and 9 required when loads labeled M or N represent top of storage.
10. For storage higher than represented by loads labeled N, the cycle defined by notes 1 through 9 is repeated, with stagger as indicated. In the cycle, loads labeled M are equivalent to loads labeled A.
11. Symbols O, X, Δ, indicate sprinklers on vertical or horizontal stagger.
12. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

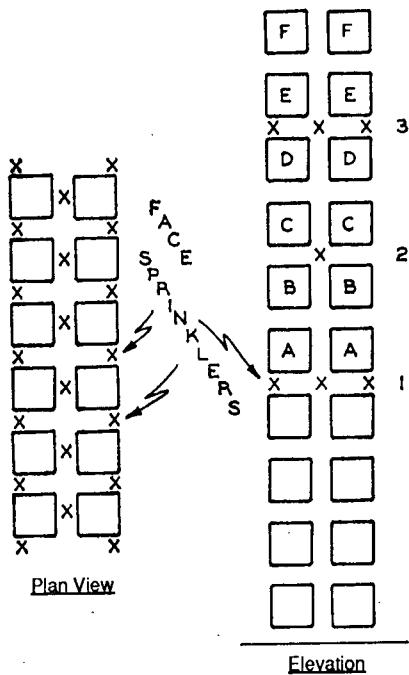


Figure 7-10.1(i) In-Rack Sprinkler Arrangement, Class I, II, III, or IV Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads labeled C or D represent top of storage.
3. Sprinklers labeled 1 and 3 required when loads labeled E or F represent top of storage.
4. For storage higher than represented by loads labeled F, the cycle defined by notes 2 and 3 is repeated.
5. Symbol X indicates face and in-rack sprinklers.
6. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

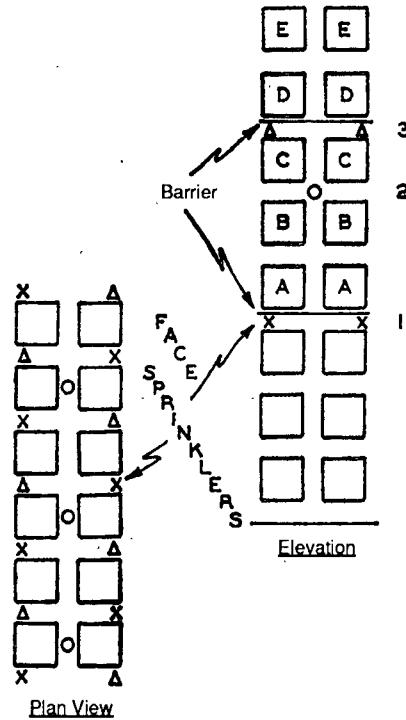


Figure 7-10.1(j) In-Rack Sprinkler Arrangement, Class I, II, III, or IV Commodity, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. Sprinklers and barrier labeled 1 (the selected array from Table 7-10.1) required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 and barrier labeled 1 required when loads labeled C represent top of storage.
3. Sprinklers and barriers labeled 1 and 3 required when loads labeled D or E represent top of storage.
4. For storage higher than represented by loads labeled E, the cycle defined by notes 2 and 3 is repeated.
5. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
6. Symbol O indicates longitudinal flue space sprinklers.
7. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

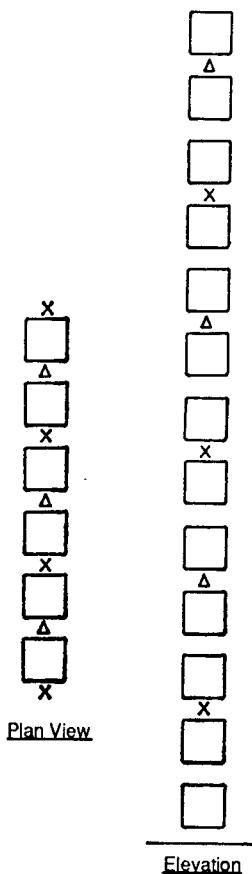


Figure 7-10.3(a) Class I, II, III, or IV. In-Rack Sprinkler Arrangement, Single Row Racks, Height of Storage over 25 Ft (7.62 m).

NOTES:

1. For all storage heights, install sprinklers in every other tier and stagger as indicated.
2. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
3. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

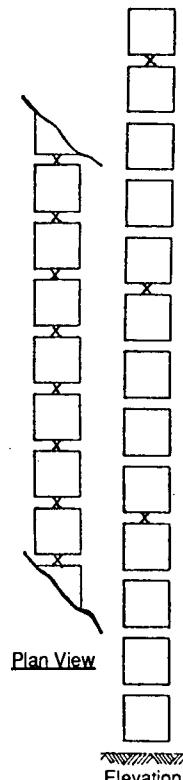


Figure 7-10.3(b) Class I, II, or III Commodity.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

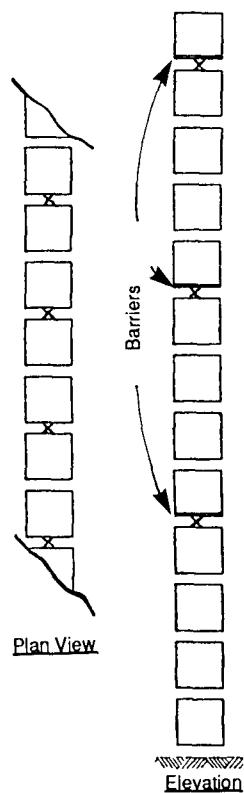


Figure 7-10.3(c) Class I, II, or III Commodity.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

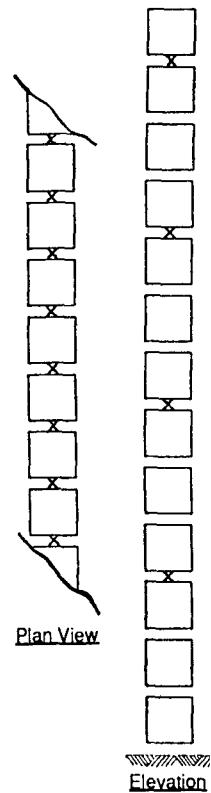


Figure 7-10.3(d) Class I, II, III, or IV Commodity.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

Part C Multiple Row Racks

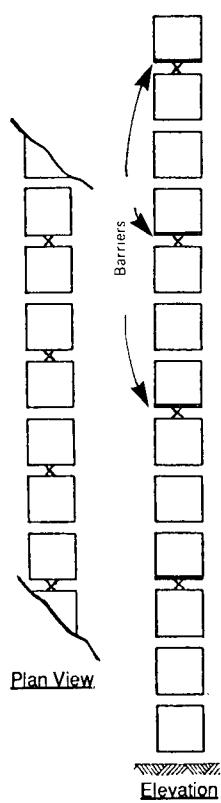


Figure 7-10.3(e) Class I, II, III, or IV Commodity.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

7-13* In-Rack Sprinkler Location. In multiple row racks with a maximum of 10 ft (3.05 m) between top of storage and ceiling, in-rack sprinklers shall be installed as indicated in Figures 7-13(a), (b), and (c). The highest level of in-rack sprinklers shall be not more than 10 ft (3.05 m) below maximum height of storage for Class I, II, or III commodities or 5 ft (1.52 m) below top of storage for Class IV commodities (see Table 7-13).

7-14 In-Rack Sprinkler Spacing. Maximum horizontal spacing of sprinklers in multiple row racks with storage higher than 25 ft (7.62 m) shall be in accordance with Figures 7-13(a), (b), and (c).

7-15 Ceiling Sprinkler Water Demand.

7-15.1 Water demand for nonencapsulated storage on racks without solid shelves separated by aisles at least 4 ft (1.22 m) wide and with not more than 10 ft (3.05 m) between top of storage and sprinklers shall be based on sprinklers in a 2,000-sq ft (185.8-m²) operating area for multiple row racks, discharging a minimum of 0.25 gpm per sq ft [(10.19 L/min)/m²] for Class I commodities, 0.3 gpm per sq ft [(12.2 L/min)/m²] for Class II and III commodities, and 0.35 gpm per sq ft [(14.26 L/min)/m²] for Class IV commodities, for 165°F (74°C) sprinklers; or a minimum of 0.35 gpm per sq ft [(14.26 L/min)/m²] for Class I commodities, 0.40 gpm per sq ft [(16.8 L/min)/m²] for Class II and III commodities, and 0.45 gpm per sq ft [(18.3 L/min)/m²] for Class IV commodities, for 286°F (141°C) sprinklers (see Table 7-13).

7-15.2 Where such storage is encapsulated, ceiling sprinkler density shall be 25 percent greater than for nonencapsulated.

Table 7-13 Multiple Row Racks. Storage Heights over 25 Ft.

Commodity Class	Encap-sulated	In-Rack Sprinklers ⁽¹⁾			Height Limit (ft)	Stagger	Fig. No.	Maximum Spacing from Top of Storage to Highest In-Rack Sprinklers (ft)	Ceiling Sprinkler Operating Area (ft ²)	Ceiling Sprinklers Density (gpm/ft ²)			
		Approximate Vertical Spacing (ft)	Maximum Horizontal Spacing In a Flue (ft)	Maximum Horizontal Spacing Across Flue (ft)						165° Rating	286° Rating		
I	No	20	12	10	None	Between adjacent flues	7.13(a)	10	2000	.25	.35		
	Yes						7-13(b)	10		.31	.44		
I, II, & III	No	15	10	10			7.13(c)	5		.30	.40		
	Yes									.37	.50		
I, II, III, & IV	No	10	10	10						.35	.45		
	Yes									.44	.56		

¹All four rack faces should be protected by sprinklers located within 18 in. of the faces, as indicated in Figs. 7-13(a), (b), and (c). It is not necessary for each sprinkler level to protect all faces (see A-7-13).

For SI Units: 1 ft = 0.3048 m; C = $\frac{5}{9}$ (F-32); 1 gpm/ft² = 40.746 (L/min)/m²

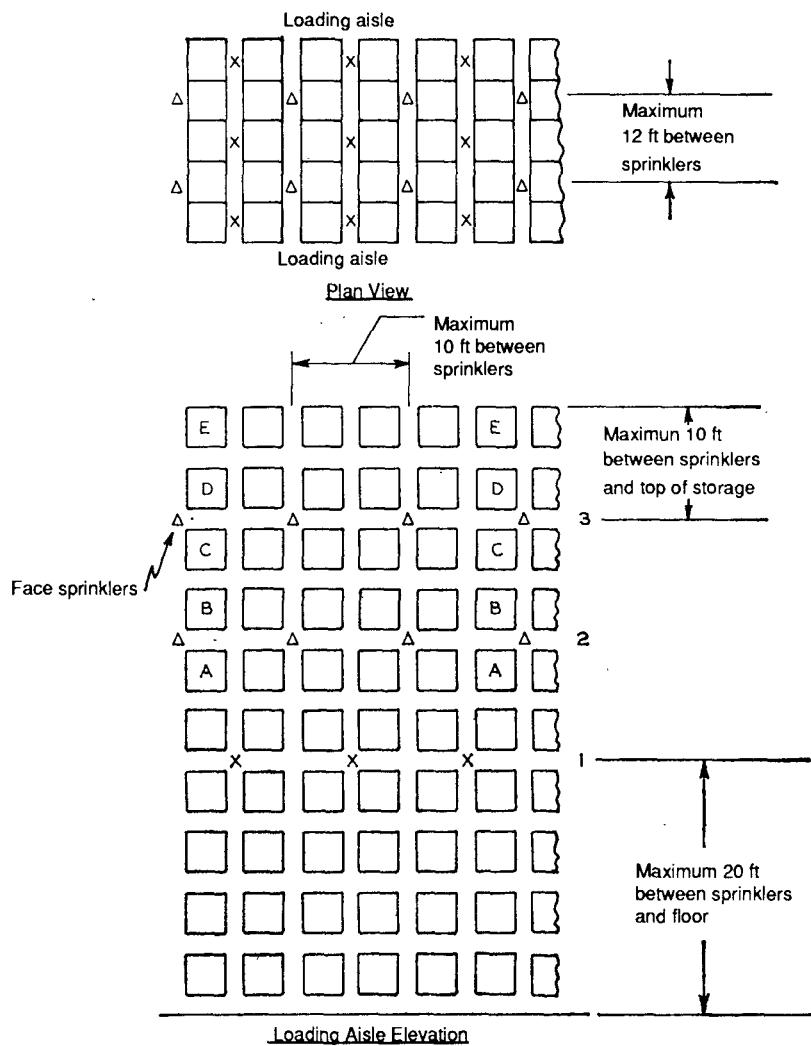


Figure 7-13(a) In-Rack Sprinkler Arrangement — Multiple Row Racks, Class I Commodity. Height of Storage over 25 Ft.

For SI Units: 1 ft = 0.3048 m

NOTES:

1. Sprinklers labeled 1 required if loads labeled A represent top of storage.
2. Sprinklers labeled 1 and 2 required if loads labeled B or C represent top of storage.
3. Sprinklers labeled 1 and 3 required if loads labeled D or E represent top of storage.

4. For storage higher than represented by loads labeled E, the cycle defined by notes 2 and 3 is repeated, with stagger as indicated.
5. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
6. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

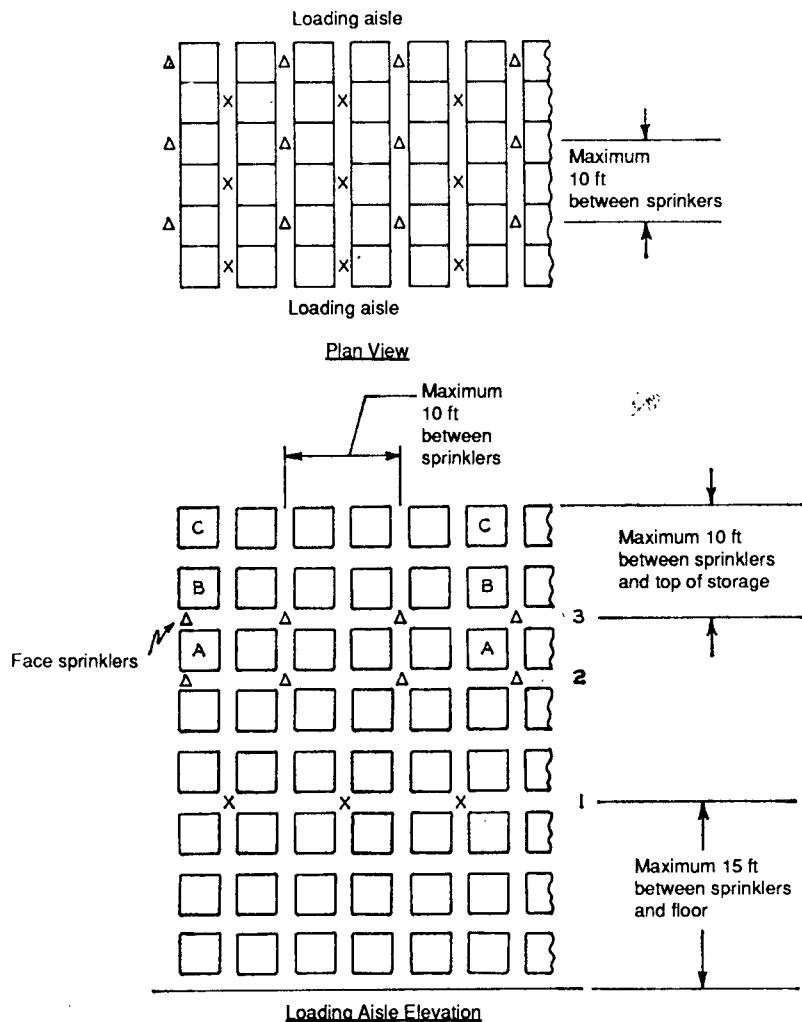


Figure 7-13(b) In-Rack Sprinkler Arrangement — Multiple Row Racks, Class I, II, or III Commodity. Height of Storage over 25 Ft.

For SI Units 1 ft = 0.3048 m

NOTES:

1. Sprinklers labeled 1 and 2 required if loads labeled A represent top of storage.
2. Sprinklers labeled 1 and 3 required if loads labeled B or C represent top of storage.

3. For storage higher than represented by loads labeled C, the cycle defined by notes 1 and 2 is repeated, with stagger as indicated.
4. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
5. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

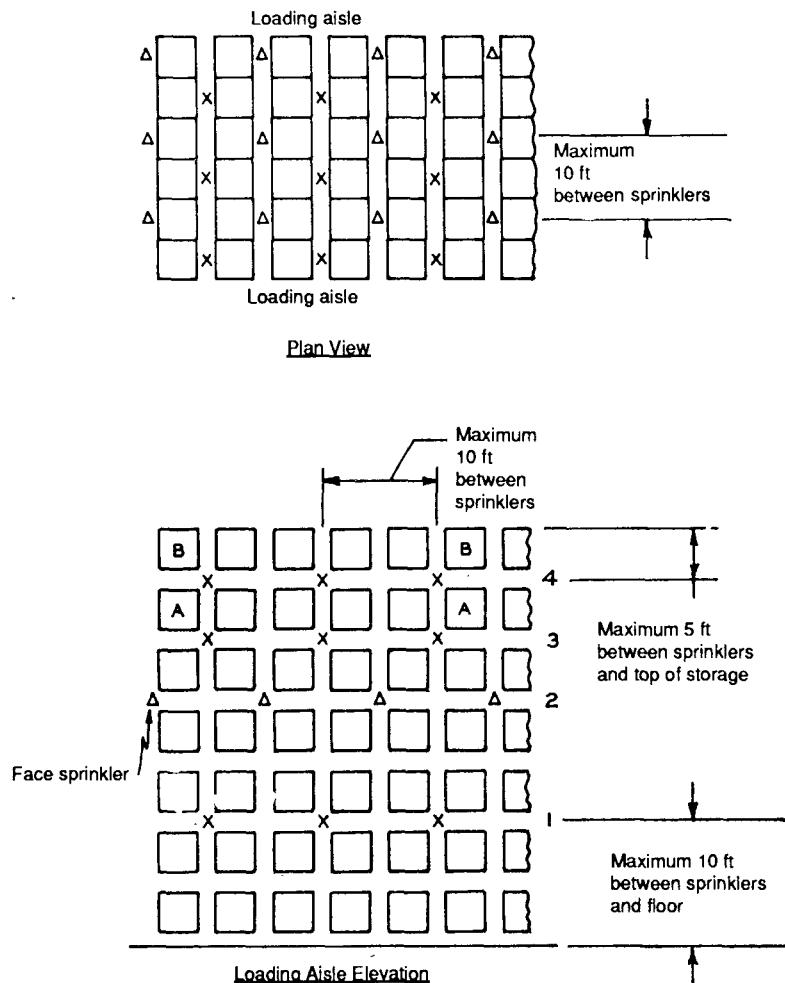


Figure 7-13(c) In-Rack Sprinkler Arrangement, Class I, II, III & IV Commodity, Multiple Row Racks. Height of Storage over 25 Ft.

For SI Units: 1 ft = 0.3048 m

NOTES:

NOTES:

1. Sprinklers labeled 1, 2, and 3 required if loads labeled A represent top of storage.
2. Sprinklers labeled 1, 2, and 4 required if loads labeled B represent top of storage.

3. For storage higher than represented by loads labeled B, the cycle defined by notes 1 and 2 is repeated, with stagger as indicated.
4. Symbols Δ or X indicate sprinklers on vertical or horizontal stagger.
5. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

Chapter 8* Plastics

8-1† General.

8-1.1 Plastics in corrugated cartons shall be protected as indicated by Figure 8-1.1. This decision tree shall also be used to determine protection for commodities that are not wholly Group A plastics but contain such quantities and arrangement of the same that they are deemed more hazardous than Class IV commodities.

8-1.2 Group B plastics and free-flowing Group A plastics shall be protected the same as Class IV commodities.

8-1.3 Group C plastics shall be protected the same as Class III commodities.

8-1.4† Ceiling sprinklers shall be large orifice [$17/32$ in. (13.5 mm)] and ordinary to high temperature rated.

Exception No. 1: Large-drop sprinklers as indicated in Chapter 9.

Exception No. 2: ESFR sprinklers as indicated in Chapter 10.

Exception No. 3: For densities of 0.30 gpm/sq ft [(12.2 L/min)/m²] or less, one-half-in. (12.7-mm) orifice sprinklers shall be permitted.

Exception No. 4: High temperature sprinklers shall be used where required by NFPA 13, Standard for the Installation of Sprinkler Systems.

8-1.5 In-Rack Sprinklers.

8-1.5.1 In-Rack Sprinkler Classification. Sprinklers in racks shall be ordinary temperature classification, except higher temperature sprinklers shall be used as specified in NFPA 13, Standard for the Installation of Sprinkler Systems.

8-1.5.2 In-Rack Sprinkler Pipe Size. The number of sprinklers and the pipe sizing on a line of sprinklers in racks are restricted only by the hydraulic calculations and not by any piping schedule.

8-1.5.3 In-Rack Storage Water Shields. If in-rack sprinklers are not shielded by horizontal barriers, water shields shall be provided above the sprinklers, or listed sprinklers equipped with water shields shall be used.

8-1.5.4 The minimum of 6 in. (152.4 mm) vertical clear space shall be maintained between the sprinkler deflectors and the top of a tier of storage.

8-1.5.5 In-Rack Sprinkler Water Demand. Water demand for sprinklers installed in racks shall be based on simultaneous operation of the most hydraulically remote:

(a) Eight sprinklers when only one level is installed in racks.

(b) Fourteen sprinklers (seven on each top two levels) when more than one level is installed in racks.

8-1.5.6 Chapters 1 through 5 apply to plastics storage.

8-2 Single, Double, and Multi-Row Racks — Storage up to and Including 25 ft (7.6 m) — Clearances up to and Including 10 ft (3 m).

8-2.1 Ceiling Sprinkler Water Demand. For Group A plastic commodities in cartons, encapsulated or nonencapsulated in single, double, and multi-row racks, ceiling sprinkler water demand in terms of density (gpm/ft²) and area of operation (ft²) shall be selected from Figures 8-2 (a) through (i). Linear interpolation of design densities and areas of application shall be permitted between storage heights with the same clearances. No interpolation between clearances shall be permitted.


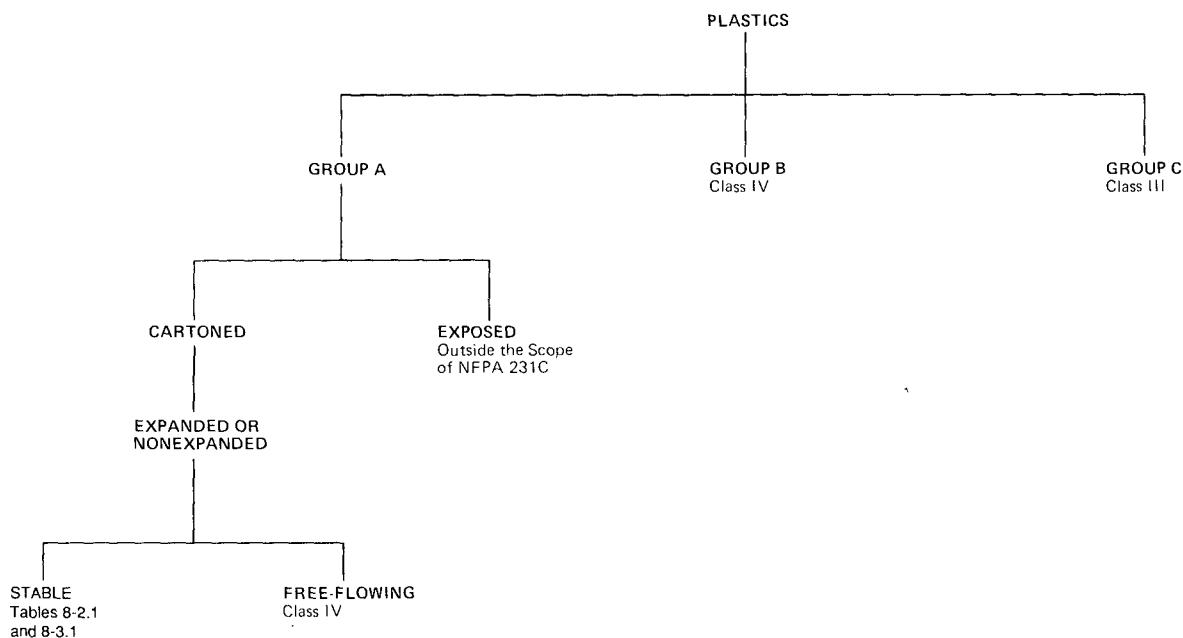


Figure 8-1.1 Decision Tree.


Strategies for Protection Rack Storage of Plastics Single Row, Double Row, & Multiple Row Rack Configurations Unexposed (Expanded and Unexpanded)
Group A Plastics

**15 Foot Storage
< 5 Foot Clearance**

.45/2000 ceiling
 See 8-2.1.1
 and 8-2.1.3

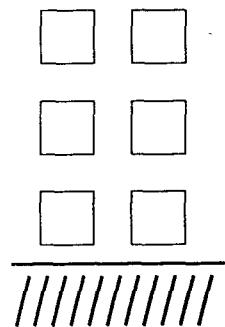


.30/2000 ceiling
 See Note 2
 and Figure 8-2(g)

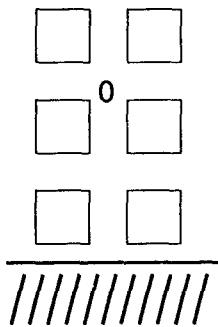

**15 Foot Storage
5 to 10 Foot Clearance**

.60/4000 ceiling
 see 8-2.1.2,
 8-2.1.2 , 8-2.1.4

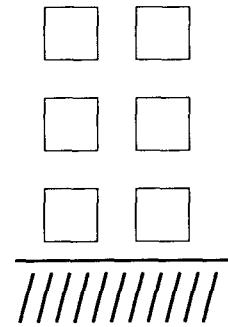

.30/2000 ceiling
 See Note 2
 and figure 8-2(h)

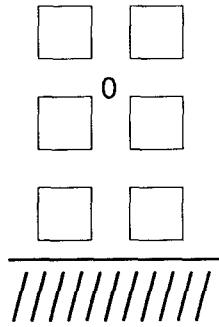


Figure 8-2(a).

Figure 8-2(b).

**20 FOOT STORAGE
< 5 FOOT CLEARANCE**

.60/4000 ceiling

See 8-2.1.2, 8-2.1.2
and 8-2.1.4



.45/2000 ceiling

See Note 2
and figure 8-2(h)



.30/2000 ceiling

See Note 3
and figure 8-2(i)



Figure 8-2(c).

**20 FOOT STORAGE
5 to 10 FOOT CLEARANCE
(See Note 5)**


.45/2000 ceiling

See Note 2
and figure 8-2(h)



.30/2000 ceiling

See Note 4
and figure 8-2(j)



.30/2000 ceiling

See Note 4
and figure 8-2(j)



.30/2000 ceiling

See Note 3
and figure 8-2(i)



Figure 8-2(d).

**25 FOOT STORAGE
< 5 FOOT CLEARANCE
(See Note 5)**

.45/2000 ceiling

See Note 3
and figure 8-2(i)


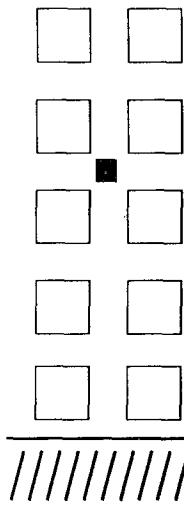


Figure 8-2(e).

.30/2000 ceiling

See Note 4
and figure 8-2(j)

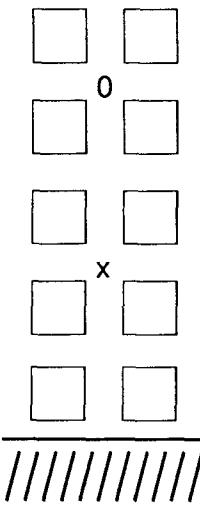

**25 FOOT STORAGE
5 to 10 FOOT CLEARANCE
(See Note 5)**

.30/2000 ceiling

See Note 4
and figure 8-2(j)

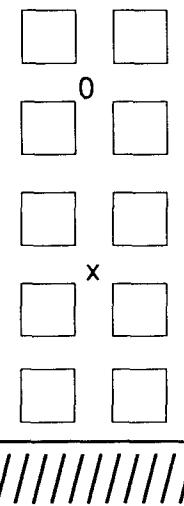



Figure 8-2(f).

**One Level of In Rack Sprinklers — Plan View
Ordinary Spacing — See Note 2**

SINGLE ROW RACK STORAGE



DOUBLE ROW RACK STORAGE

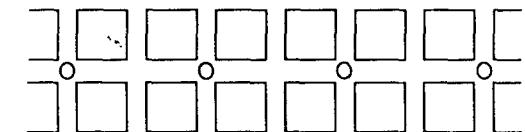

MULTI-ROW RACK STORAGE

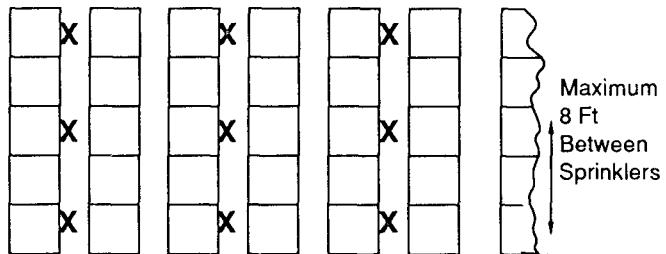


Figure 8-2(g).

One Level of In Rack Sprinklers—Plan View
Close Spacing—See Note 3

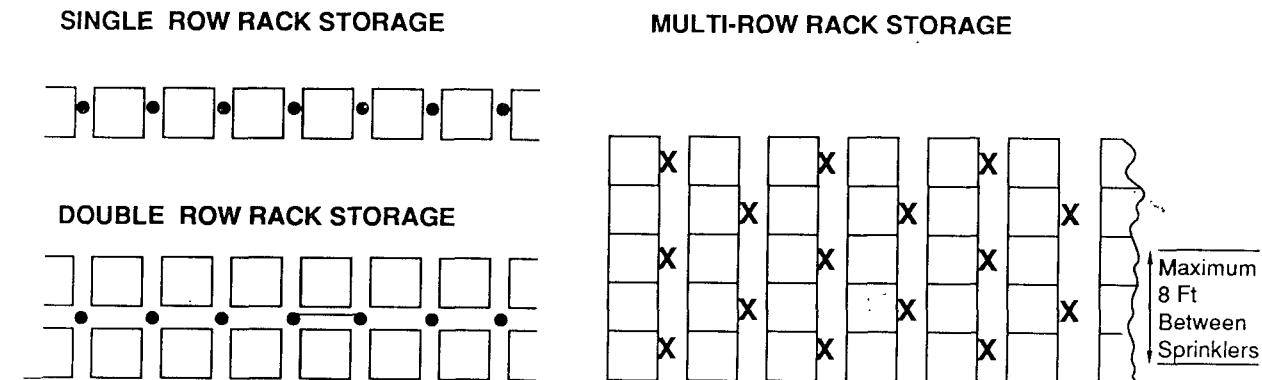


Figure 8-2(h).

Two Levels of In Rack Sprinklers – Plan View
Ordinary Spacing – See Note 4

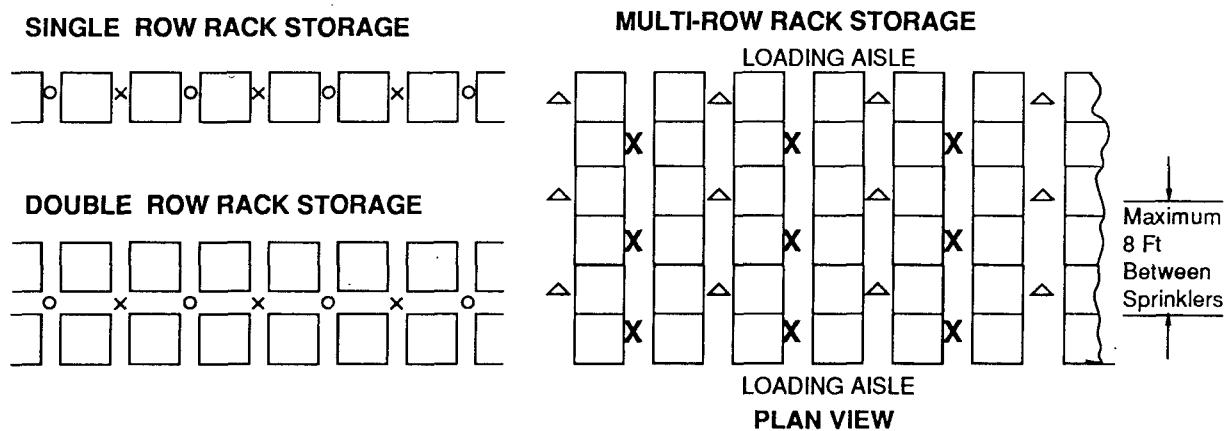


Figure 8-2(i).

Notes to Figures 8-2(a) — 8-2(i):

1. Each square in the figures represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.
2. Single level of in-rack sprinklers ($\frac{1}{2}$ or $\frac{17}{32}$ in. operating at 15 psi minimum) installed on 8- to 10-ft (2.5- to 3.12-m) spacings located, as indicated, in the transverse flue spaces.
3. Single level of in-rack sprinklers ($\frac{17}{32}$ in. operating at 15 psi minimum or $\frac{1}{2}$ in. operating at 30 psi minimum) installed on 4- to 5-ft (1.25- to 1.56-m) spacings located, as indicated, in the longitudinal flue space at the intersection of every transverse flue space.
4. Two levels of in-rack sprinklers ($\frac{1}{2}$ or $\frac{17}{32}$ in. operating at 15 psi minimum) installed on 8- to 10-ft (2.5- to 3.12-m) spacings located as indicated and staggered in the transverse flue spaces.
5. Ceiling only protection is not acceptable for this storage configuration.

Table 8-2.1 Single and Double Row Racks with 8-Ft Aisles, Height of Storage up through 25 Ft — 165°F Sprinklers.

Storage Height (ft)/ Clearance (ft)	Ceiling Density (gpm/ft ²)/ Area of Application (ft ²) (Note 2)	In-Rack Sprinklers Needed
15/3	0.45/2000 (Note 1)	None
	0.30/2000 (Note 3)	1 Level
15/10	0.60/3000	None
	0.30/2000 (Note 3)	1 Level
20/3	0.60/3000	None
	0.45/2000	1 Level
20/10 or 25/3	0.45/2000	1 Level
	0.30/2000 (Note 3)	2 Levels
25/10	0.30/2000 (Note 3)	2 Levels

NOTES:

1. For 4-ft aisles a density of 0.60 gpm/ft² and an area of application of 1500 ft² shall be used. For aisle widths between 4 ft and 8 ft a direct linear interpolation may be made between densities and areas of application.

2. Based on maximum of 5 ft of storage above the top level of in-rack sprinklers. For storage greater than 5 ft up to a maximum of 10 ft, increase density to 0.45 gpm/ft².

3. Clearance is distance between top of storage and ceiling.

For SI Units:

$$\begin{aligned}
 1 \text{ in.} &= 25.4 \text{ mm} \\
 1 \text{ ft} &= 0.3048 \text{ m} \\
 1 \text{ psi} &= 0.0689 \text{ bars} = 6.895 \text{ kPa} \\
 1 \text{ gpm} &= 3.785 \text{ L/min} \\
 1 \text{ gpm/ft}^2 &= 40.74 \text{ (L/min)/m}^2
 \end{aligned}$$

8-2.1.1 Single and Double Row Racks — 15-ft (4.6-m) Storage with Less than 5-ft (1.25-m) Clearance. The protection strategy utilizing ceiling sprinklers only as shown in Figure 8-2(a) shall be acceptable only for single and double row rack storage with 8-ft (2.4-m) aisles. For 3 1/2-ft (1-m) aisles, a density of 0.60 gpm/sq ft and an area of application of 1500 sq ft (139.5 m²) shall be used. For aisle widths between 3 1/2 ft (1 m) and 8 ft (2.4 m), a direct linear interpolation shall be permitted between densities and areas of application.

8-2.1.2 Single and Double Row Racks — 15-ft (4.6-m) Storage with 10-ft (3-m) Clearance. Twenty-ft (6-m) Storage with Less than 5-ft (1.25-m) Clearance. The protection strategies utilizing ceiling sprinklers only as shown in Figures 8-2(b) and 8-2(c) shall be acceptable only for single and double row rack storage with 8-ft (2.4-m) aisles. In-rack sprinkler protection shall be required for aisles less than 8 ft (2.4 m) in width.

When utilizing the ceiling sprinklers only strategies as shown in Figures 8-2(b) and 8-2(c), column steel shall be protected in accordance with paragraph 3-2.3(a) or (b). Roof structural steel shall be protected in such a manner as to provide a minimum of 15 min fire resistance.

8-2.1.3 Multi-Row Racks — 15 ft (4.6 m) Storage with Less than 5-ft (1.25-m) Clearance. The protection strategy utilizing ceiling sprinklers only as shown in Figure 8-2(a) shall not be acceptable for multi-row rack storage. The density to be used shall be 0.60 gpm/sq ft over 2000 sq ft (186 m²). The indicated combination of ceiling and in-rack sprinklers in Figure 8-2(a) shall be an acceptable alternative.

8-2.1.4 Multi-Row Racks — 15-ft (4.6-m) Storage with 10-ft (3-m) Clearance. Twenty-ft (6-m) Storage with Less than 5-ft (1.25-m) Clearance. The protection strategies utilizing ceiling sprinklers only as shown in Figures 8-2(b) and 8-2(c) shall not be acceptable for multi-row rack storage. Only the indicated combinations of ceiling and in-rack sprinklers shall be used.

8-2.2 In-Rack Sprinklers. In-rack sprinklers shall be installed in accordance with Figures 8-2(a) through 8-2(i).

8-3 Single and Double Row Racks — Storage over 25 Ft (7.7 m) in Height.

8-3.1 Ceiling Sprinkler Water Demand. For Group A plastic commodities in cartons, encapsulated or nonencapsulated in single and double row racks, ceiling sprinkler water demand in terms of density (gpm/ft²) and area of operation (ft²) shall be selected from Table 8-3.1.

Table 8-3.1 Single and Double Row Racks. Height of Storage over 25 Ft.

Storage Height Above Top Level In-Rack Sprinklers	Ceiling Sprinklers Density (gpm/ft ²)/Area of Application (ft ²)
5 ft or less	0.30/2000
Over 5 ft up to 10 ft	0.45/2000

NOTE: Provide in-rack sprinkler protection as per Figures 8-3.2.1(a) and (b) and Figures 8-3.2.3(a) through (c).

$$\begin{aligned}
 \text{For SI Units: } 1 \text{ ft} &= 0.3048 \text{ m} \\
 1 \text{ gpm} &= 3.785 \text{ L/min} \\
 1 \text{ gpm/ft}^2 &= 40.74 \text{ (L/min)/m}^2
 \end{aligned}$$

8-3.2 In-Rack Sprinkler Location.

8-3.2.1 In double row racks without solid shelves and with a maximum of 10 ft (3.05 m) between the top of storage and ceiling, in-rack sprinklers shall be installed as indicated in Figures 8-3.2.1(a) and (b). The highest level of in-rack sprinklers shall be not more than 10 ft (3.05 m) below the top of storage.

8-3.2.2 In-rack sprinklers for storage higher than 25 ft (7.62 m) in double row racks shall be spaced horizontally and located in the horizontal space nearest the vertical intervals indicated in Figures 8-3.2.1(a) and (b).

8-3.2.3 In single row racks without solid shelves with height of storage over 25 ft (7.62 m) and a maximum of 10 ft (3.05 m) between the top of storage and ceiling, sprinklers shall be installed as indicated in Figures 8-3.2.3(a) through (c).

8-3.3 In-Rack Sprinkler Size. Sprinklers in racks shall be 1/2-in. (12.7-mm) or 17/32-in. (13.5-mm) orifice size, pendent or upright.

8-3.4 In-Rack Sprinkler Discharge Pressure. Sprinklers in racks shall discharge at not less than 30 psi (2.07 bars).

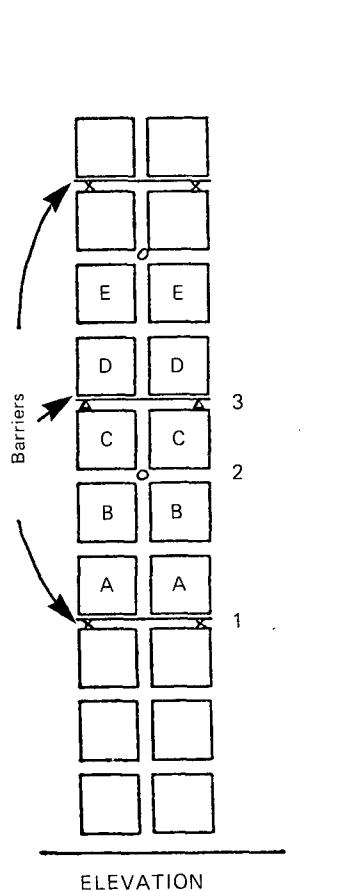


Figure 8-3.2.1(a) In-Rack Sprinkler Arrangement, Group A Plastic Commodity, Height of Storage over 25 Ft.

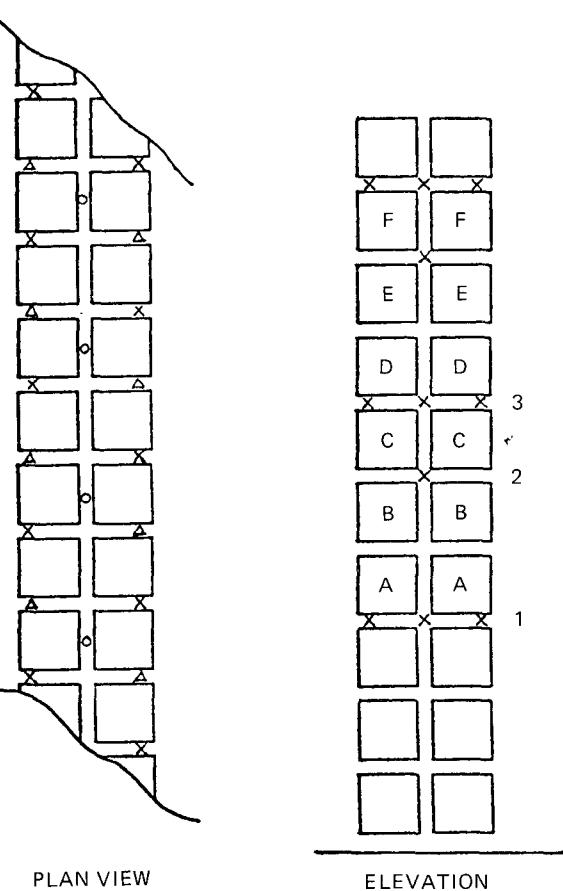


Figure 8-3.2.1(b) In-Rack Sprinkler Arrangement, Group A Plastic Commodity, Height of Storage over 25 Ft.

NOTES:

1. Sprinklers and barrier labeled 1 required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 and barrier labeled 1 required when loads labeled C represent top of storage.
3. Sprinklers and barriers labeled 1 and 3 required when loads labeled D or E represent top of storage.
4. For storage higher than represented by loads labeled E, the cycle defined by Notes 2 and 3 is repeated.
5. Symbols Δ or X indicate face sprinklers on vertical or horizontal stagger.
6. Symbol 0 indicates longitudinal flue space sprinklers.
7. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

NOTES:

1. Sprinklers labeled 1 required when loads labeled A or B represent top of storage.
2. Sprinklers labeled 1 and 2 required when loads C represent top of storage.
3. Sprinklers labeled 1 and 3 required when loads D or E represent top of storage.
4. For storage higher than loads F, the cycle defined by Notes 2 and 3 is repeated.
5. Symbol X indicates face and in-rack sprinklers.
6. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

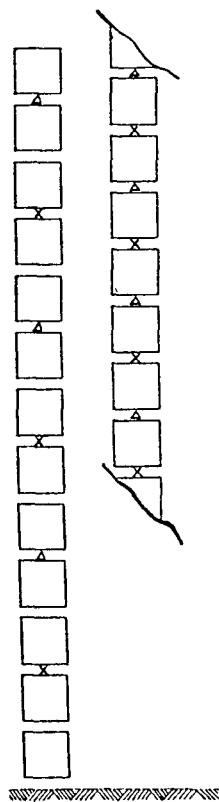


Figure 8-3.2.3(a) In-Rack Sprinkler Arrangement, Group A Plastic Commodity, Single Row Racks, Height of Storage over 25 Ft.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

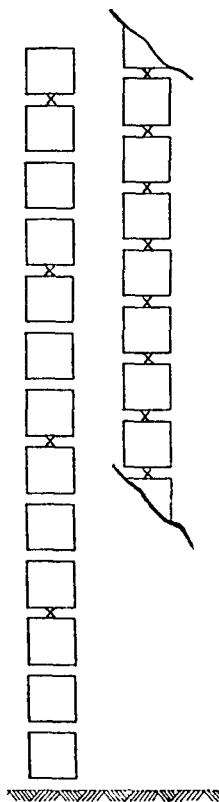


Figure 8-3.2.3(b) In-Rack Sprinkler Arrangement, Group A Plastic Commodity, Single Row Racks, Height of Storage over 25 Ft.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

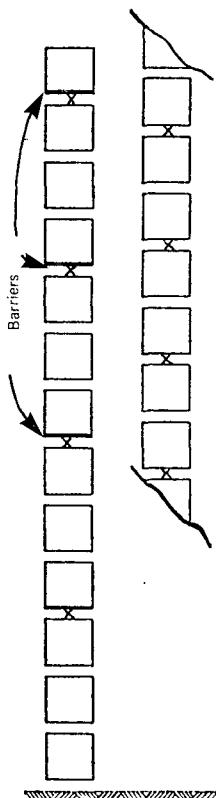


Figure 8-3.2.3(c) In-Rack Sprinkler Arrangement, Group A Plastic Commodity, Single Row Racks, Height of Storage over 25 Ft.

NOTE:

1. Each square in the figure represents a storage cube measuring 4 to 5 ft (1.25 to 1.56 m) on a side.

Chapter 9 Large-Drop Sprinklers

9-1 General.

9-1.1 Large-drop sprinklers are suitable for use with the hazards listed in Table 9-1.

Table 9-1 Pressure and Number of Design Sprinklers For Various Hazards.

Minimum Operating Pressure (Note 1)	Number Design Sprinklers			Sprinkler Temperature Rating
	@ 25 psi	@ 50 psi	@ 75 psi	
Hazard (Note 2)				
Double Row Rack Storage with Minimum 5.5-ft aisle width (Note 4) having:				
Class I and II Commodities up to 25 ft with maximum 5-ft clearance to ceiling	20	Note 3	Note 3	High
Class I, II, and III Commodities up to 20 ft with maximum 10-ft clearance to ceiling	15	Note 3	Note 3	High

Class IV Commodities up to 20 ft with maximum 10-ft clearance to ceiling	Does Not Apply	20	15	High
Non-expanded Group A plastics in corrugated cartons up to 20 ft with maximum 10-ft clearance to ceiling	Does Not Apply	30	20	High
Non-expanded Group A plastics in corrugated cartons up to 20 ft with maximum 10-ft clearance to ceiling	Does Not Apply	20	Note 3	Ordinary
Non-expanded Group A plastics in corrugated cartons up to 20 ft with maximum 5-ft clearance to ceiling	Does Not Apply	15	Note 3	High

NOTES:

1. Open Wood Joist Construction. Testing with open wood joist construction showed that each joist channel shall be fully firestopped to its full depth at intervals not exceeding 20 ft. In unfirestopped open wood joist construction, or if firestops are installed at intervals exceeding 20 ft, the minimum operating pressures shall be increased by 40 percent.
2. Building steel required no special protection for the occupancies listed. Protection requirements are based on rack storage with no solid shelves nor slave pallets.
3. The required number of design sprinklers shall not be reduced from that required for the lower pressure.
4. In addition to the transverse flue spaces required by NFPA 231C, minimum 6-in. longitudinal flue spaces shall be maintained.

For SI Units:

$$1 \text{ ft} = 0.3048 \text{ m}$$

$$1 \text{ in.} = 25.4 \text{ mm}$$

$$1 \text{ psi} = 0.0689 \text{ bars} = 6.895 \text{ kPa}$$

9-1.2 All requirements contained in NFPA 13, *Installation of Sprinkler Systems*, shall apply.

Chapter 10 Early Suppression Fast Response (ESFR) Sprinklers

10-1 General.

10-1.1* ESFR sprinklers having a nominal K factor of 14 shall be permitted for the protection of cartoned plastics (Group A, B, or C) and Class I through IV commodities in single row, double row, or multi-row racks up to a height of 25 ft (7.7 m).

Exception: ESFR protection as now defined does not apply to:

1. exposed plastics or expanded polystyrene plastics in cartons.
2. rack storage involving solid shelves.
3. rack storage involving combustible open top cartons or containers.

10-1.2* ESFR sprinklers shall be permitted for use in buildings having a maximum ceiling height of 30 ft (9.2 m) and one of the following types of roof construction:

- (a) smooth ceiling
- (b) bar joist
- (c) beam and girder
- (d) panel.

10-1.3 Roof slope shall not exceed $1/4$ in./ft (19.6 mm/m).

10-2 Sprinkler System Design.

10-2.1 ESFR sprinkler systems shall be designed to provide a minimum operating pressure of 50 psi (3.4 bars) to the twelve most hydraulically remote sprinklers, based on flowing four sprinklers in each of three branch lines.

10-2.2 Only wet pipe systems are acceptable for use with ESFR sprinklers.

10-2.3 All requirements contained in NFPA 13, *Standard for the Installation of Sprinkler Systems*, particularly Chapter 8, shall apply unless modified within this standard.

10-2.4 ESFR sprinklers shall be ordinary temperature rated sprinklers.

Exception No. 1: Those located in proximity to heat sources.

Exception No. 2: Those located under skylights.

10-3 Water Demand.

10-3.1 A minimum of 250 gpm (16 L/s) shall be added to the sprinkler demand for combined large and small hose streams.

10-3.2 Water supply duration shall be at least 1 hr.

Chapter 11 Equipment**11-1 Mechanical Handling Equipment.****11-1.1 Industrial Trucks.**

11-1.1.1 Power-operated industrial trucks shall be of the type designated in NFPA 505, *Firesafety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Maintenance, and Operation*, and their maintenance and operation shall be in accordance with Chapters 2 and 3.

11-1.1.2† Industrial trucks using LP-Gas or liquid fuel shall be refueled outside of the storage building at a location designated for that purpose.

Chapter 12 Building Maintenance and Operation

12-1* Building Operations Other than Storage. Welding, soldering, brazing, and cutting shall be permitted to be performed on rack or building components that cannot be removed, provided no storage is located below and within 25 ft (7.62 m) of the working area, and flameproof tarpaulins enclose this section. During any of these operations the sprinkler system shall be in service. Two and one-half-gal (9.45-L) water-type extinguishers and charged inside hose lines shall be located in the working area. A fire watch shall be maintained during these operations and for at least 30 additional min.

12-2* Waste Disposal. Approved-type containers for rubbish and other trash materials shall be provided.

12-3 Smoking. Smoking shall be strictly prohibited, except in locations prominently designated as smoking areas, and "No Smoking" signs shall be posted in prohibited areas.

12-4* Maintenance. Fire walls, fire doors, and floors shall be maintained in good repair at all times.

12-5* Plant Emergency Organization. A fire watch shall be maintained when the sprinkler system is not in service.

12-6* General Fire Protection.**Chapter 13 Referenced Publications**

13-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

13-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 11A, *Standard for Medium- and High-Expansion Foam Systems*, 1988 edition

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1989 edition

NFPA 30, *Flammable and Combustible Liquids Code*, 1990 edition

NFPA 40, *Standard for the Storage and Handling of Cellulose Nitrate Motion Picture Film*, 1988 edition

NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*, 1988 edition

NFPA 81, *Standard for Fur Storage, Fumigation and Cleaning*, 1986 edition

NFPA 91, *Standard for the Installation of Blower and Exhaust Systems for Dust, Stock, and Vapor Removal or Conveying*, 1990 edition

NFPA 220, *Standard on Types of Building Construction*, 1985 edition

NFPA 231, *Standard for General Storage*, 1990 edition

NFPA 231D, *Standard for Storage of Rubber Tires*, 1989 edition

NFPA 231F, *Standard for the Storage of Roll Paper*, 1987 edition

NFPA 232, *Standard for the Protection of Records*, 1991 edition

NFPA 490, *Code for the Storage of Ammonium Nitrate*, 1986 edition

NFPA 505, *Firesafety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Maintenance, and Operation*, 1987 edition

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

A-4-1 Rack storage as referred to in this standard contemplates commodity in a rack structure, usually steel. Many variations of dimensions are found. Racks may be single row, double row, or multiple row, with or without solid shelves. The standard commodity used in most of the tests was 42 in. (1.07 m) on a side. The types of racks covered in this standard are:

Double Row Racks. Pallets rest on two beams parallel to the aisle. Any number of pallets can be supported by one pair of beams [see Figures A-4-1(a), (b), (c), and (d)].

Automatic Storage-Type Rack. The pallet is supported by two rails running perpendicular to the aisle [see Figure A-4-1(e)].

Multiple Row Racks are More than Two Pallets Deep, Measured Aisle to Aisle. This includes drive-in racks, drive-through racks, flow-through racks, portable racks arranged in the same manner, and conventional or automatic racks with aisles less than 42 in. (1.07 m) [see Figures A-4-1(f) through (i)].

Movable Racks. Movable racks are racks on fixed rails or guides. They can be moved back and forth only in a horizontal two-dimensional plane. A moving aisle is created as abutting racks are either loaded or unloaded, then moved across the aisle to abut other racks. [See Figure A-4-1(k).]

Solid Shelving. Conventional pallet rack with plywood shelves on the shelf beams [see Figures A-4-1(c) and (d)]. This is a special case (see Chapter 5).

Cantilever Rack. The load is supported on arms that extend horizontally from columns. The load may rest on the arms or on shelves supported by the arms [see Figure A-4-1(j)].

Load depth in conventional or automatic racks is considered a nominal 48 in. (1.22 m) [see Figure A-4-1(b)].

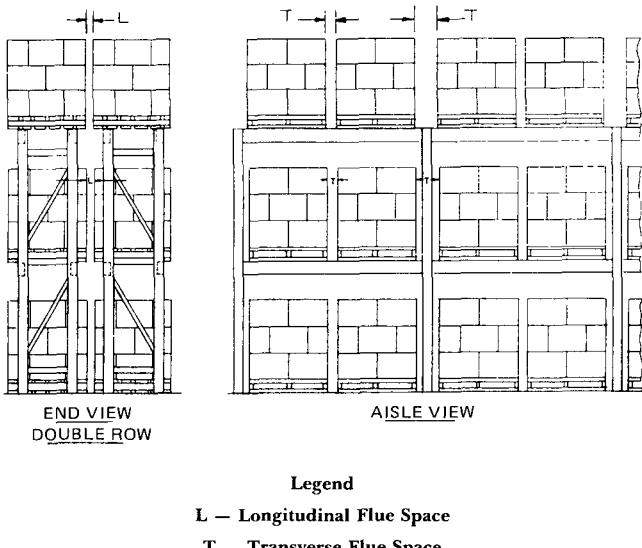


Figure A-4-1(a) Conventional Pallet Rack.

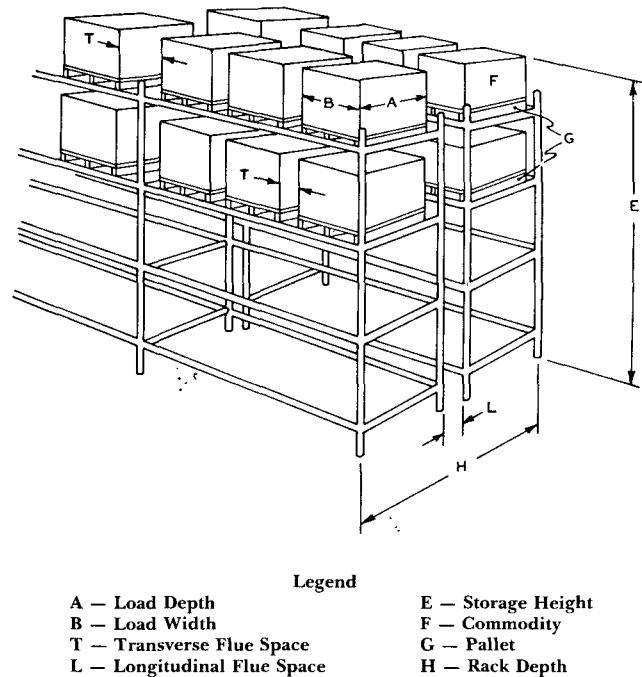


Figure A-4-1(b) Double Row Racks Without Solid or Slatted Shelves.


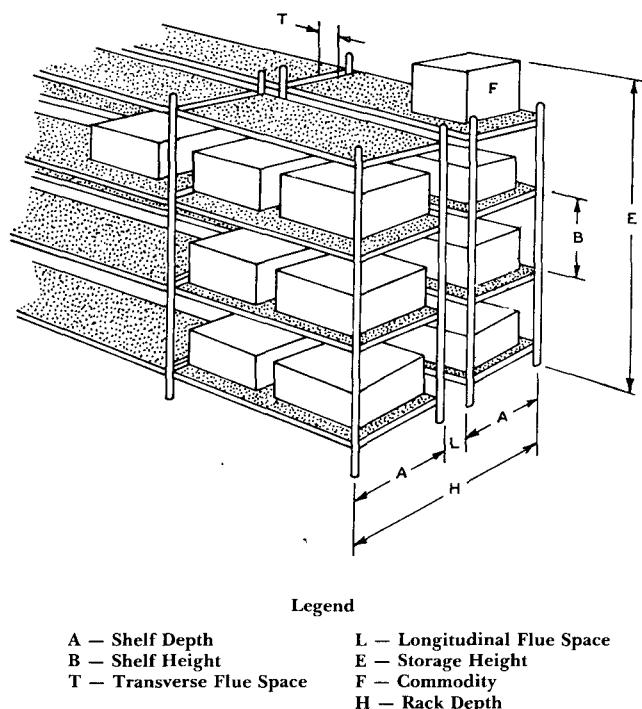



Figure A-4-1(c) Double Row Racks With Solid Shelves.

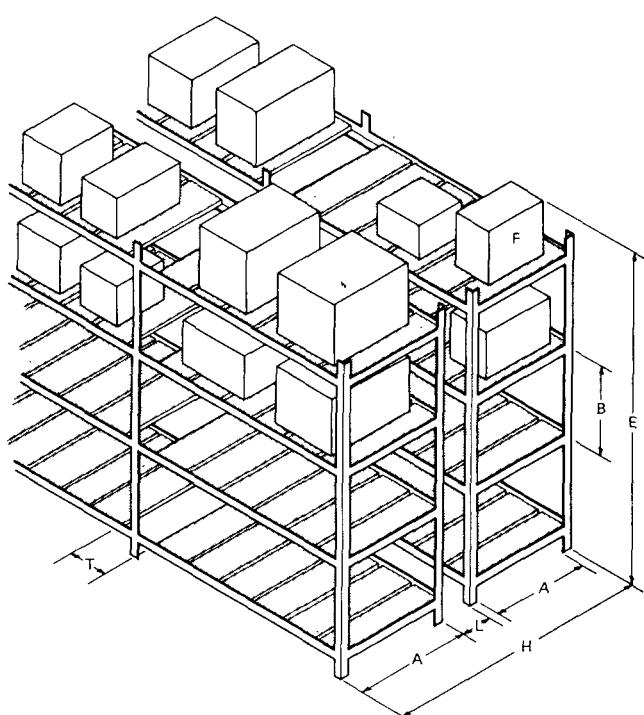

Legend

A — Shelf Depth
B — Shelf Height
H — Rack Depth
L — Longitudinal Flue Space
E — Storage Height
F — Commodity
T — Transverse Flue Space

Figure A-4-1(d) Double Row Racks With Slatted Shelves.

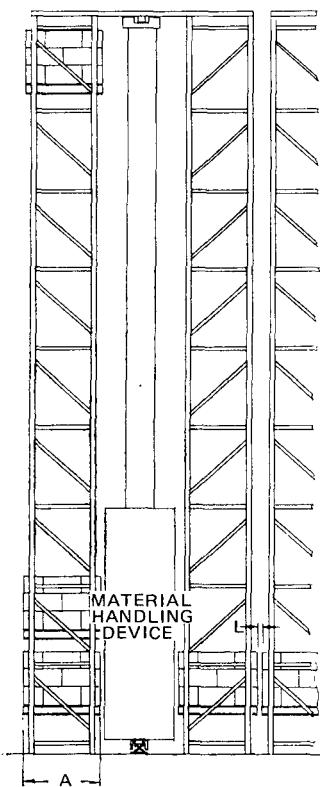


END VIEW

Legend


A — Load Depth
B — Load Width
E — Storage Height
F — Commodity
G — Pallet
L — Longitudinal Flue Space
T — Transverse Flue Space

Figure A-4-1(e) Automatic Storage-Type Rack.

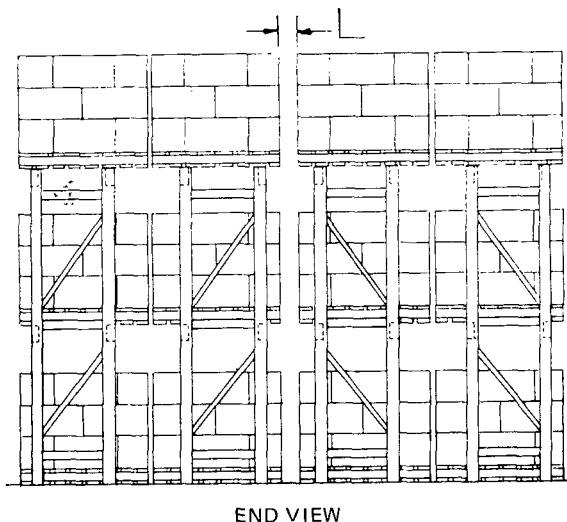


L — Longitudinal Flue Space

Figure A-4-1(f) Multi-Row Rack to be Served by a Reach Truck.

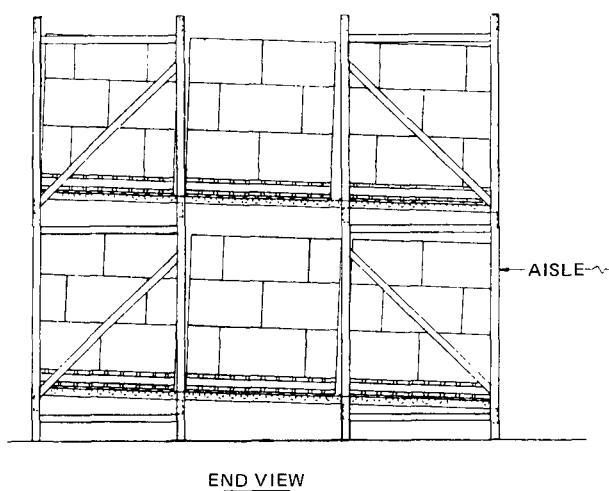


END VIEW

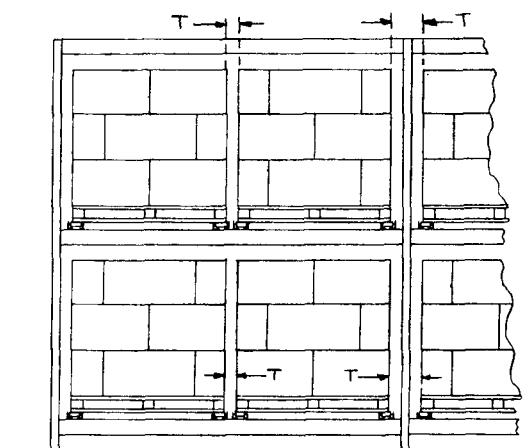


AISLE VIEW

T — Transverse Flue Space

Figure A-4-1(g) Flow-Through Pallet Rack.

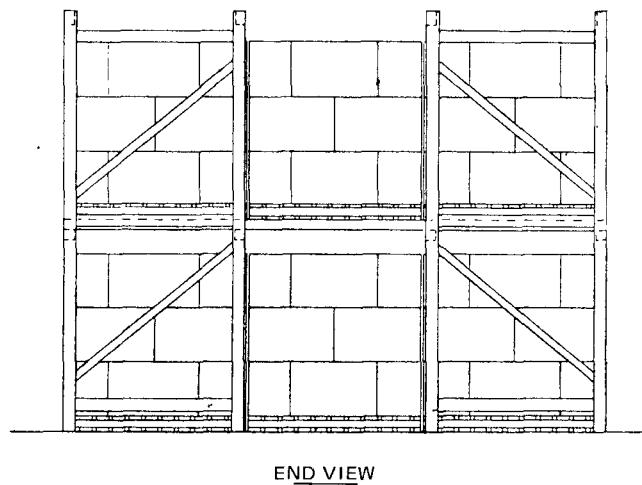

END VIEW

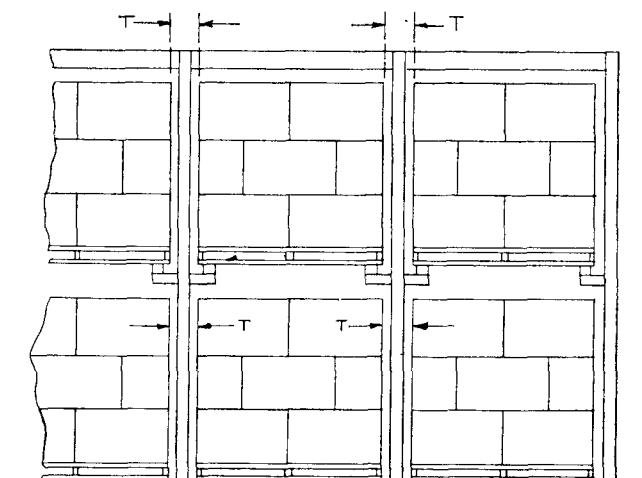


AISLE VIEW


T — Transverse Flue Space

Figure A-4-1(h) Drive-In Rack — Two or More Pallets Deep.

Fork truck drives into the rack to deposit and withdraw loads in the depth of the rack.

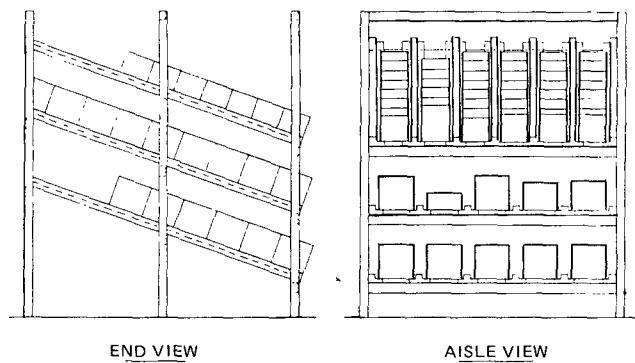

Flow-Through Rack

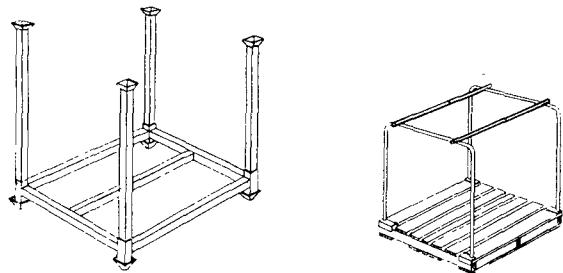

Portable Racks

Figure A-4-1(i).


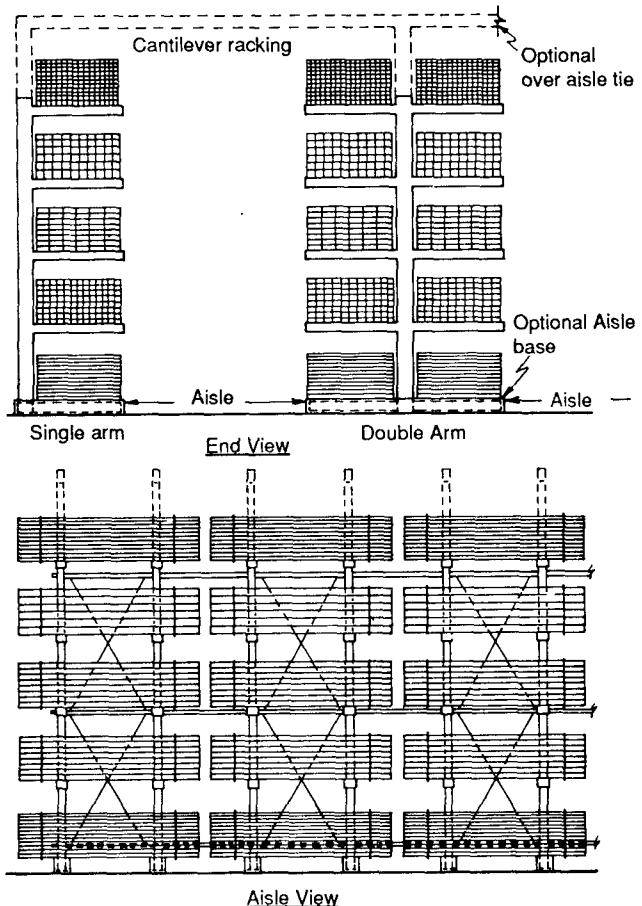


Figure A-4-1(j) Cantilever Rack.

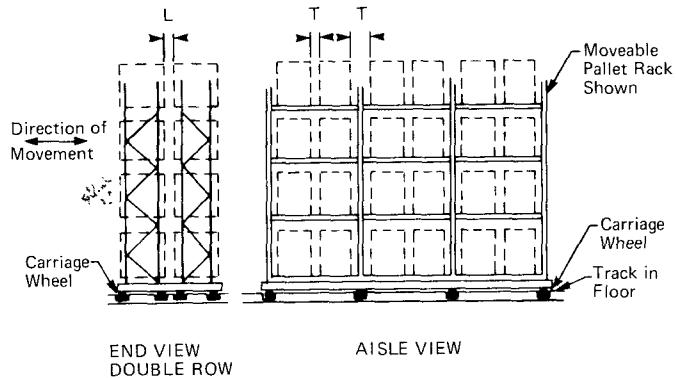

T - Transverse Flue Space
L - Longitudinal Flue Space

Figure A-4-1(k) Movable Rack.

A-4-2 Fixed rack structures should be designed to facilitate removal or repair of damaged sections without resorting to flame cutting or welding in the storage area. Where sprinklers are to be installed in racks, rack design should anticipate the additional clearances required to facilitate installation of sprinklers. The rack structure should be anchored to prevent damage to sprinkler lines and supply piping in racks.

Rack structures should be designed for seismic conditions in areas where seismic resistance of building structure is required.

A-4-3.1 Nominal 6-in. (152.4-mm) transverse flues should be provided in multiple row racks.

A-4-4 Storage in aisles may render protection ineffective and should be discouraged.

A-4-5 The fire protection system design should contemplate the maximum height of storage. For new sprinkler installations, maximum height of storage is the usable height at which commodities can be stored above the floor when the minimum required unobstructed space below sprinklers is maintained. For the evaluation of existing situations, maximum height of storage is the maximum existing if space between sprinklers and storage is equal or greater than required.

A-4-6.1 A horizontal clearance of at least 1 ft (0.30 m) should be maintained between storage and major unprotected roof structural members when storage is stored above the bottom of such members.

A-4-6.2 Incandescent light fixtures should have shades or guards to prevent ignition of commodity from hot bulbs where possibility of contact with storage exists.

A-4-7 Idle combustible pallets should not be stored in racks.

A-5-2.1 Ceiling Sprinklers. Wet systems are recommended for rack storage occupancies.

Dry systems are acceptable only where it is impractical to provide heat.

Preaction systems should be considered for rack storage occupancies that are unheated, particularly where in-rack sprinklers are installed or for those occupancies that are highly susceptible to water damage.

A-5-2.2 Where 286°F (141°C) sprinklers are installed at the ceiling, 286°F (141°C) sprinklers should also extend beyond storage in accordance with the following table:

Design Area for 286°F (141°C) Sprinklers (ft ²)	Distance Beyond Perimeter of High-Hazard Occupancy for High-Temp. Sprinklers (ft)	Distance Beyond Perimeter of High-Hazard Occupancy for High-Temp. Sprinklers (m)
2000	185.8	9.14
3000	278.7	12.2
4000	371.6	13.72
5000	464.5	15.24
6000	557.4	16.76

A-5-5 In-rack sprinklers and ceiling sprinklers selected for protection should be controlled by at least two separate indicating valves and drains.

A-5-5.1 In higher rack arrangements, consideration should be given to providing more than one in-rack control valve in order to limit the extent of any single impairment.

A-5-7 Approved supervisory alarm service should be provided for all fire detection and extinguishing systems.

Central station, auxiliary, remote station, or proprietary sprinkler waterflow alarm should be provided except that local waterflow alarm is acceptable where approved guard service is provided (see NFPA 71, *Standard for the Installation, Maintenance, and Use of Signaling Systems for Central Station Service*, and NFPA 72, *Standard for the Installation, Maintenance, and Use of Protective Signaling Systems*).

A-5-11.1 Detection systems, concentrate pumps, generators, and other system components essential to the operation of the system should have an approved standby power source.

A-5-13.1 In NFPA 13, *Standard for the Installation of Sprinkler Systems*, paragraph A-4-4.10 states: "Slatting of decks or walkways or the use of open grating as a substitute for automatic sprinkler thereunder is not acceptable."

Also when shelving of any type is employed, it is for the basic purpose of providing an intermediate support between the structural members of the rack. As a result, it becomes almost impossible to define and maintain transverse flue spaces across the rack as required in 4-3.1 and illustrated in Figure 4-3.1.

A-6-4.1 Where possible, it is preferable to locate in-rack sprinkler deflectors at least 6 in. (152.4 mm) above pallet loads.

A-6-4.2 Where possible, it is preferable to locate in-rack sprinklers away from rack uprights.

A-6-5.1 Spacing of sprinklers on branch lines in racks in the various tests indicates maximum spacing as indicated is proper.

A-6-8.1 Bulkheads are not a substitute for sprinklers in racks. Their installation does not justify reduction in sprinkler densities or design operating areas as called for in the design curves.

A-6-9.1 When high expansion foam is being contemplated as the protection media, consideration should be given to possible damage to the commodity from soaking and corrosion. Consideration should be given to the problems associated with removal of foam after discharge.

A-6-11.1 Where dry pipe systems are used, the areas of operation indicated in the design curves should be increased by 30 percent. Densities should be selected so that areas of operation, after the 30 percent increase, do not exceed 6,000 sq ft (557.4 m²).

A-6-13.3 In-rack sprinklers at one level only for storage up to and including 25 ft (7.62 m) high in multiple row racks should be located at the tier level nearest one-half to two-thirds of the storage height.

A-7-10.3 In single-row racks with more than 10 ft (3.05 m) between top of storage and ceiling, a horizontal barrier should be installed above storage with one line of sprinklers under the barrier.

A-7-11 Double row racks — height of storage over 25 ft (7.62 m) — more than 10 ft (3.05 m) between maximum height of storage and ceiling.

When the ceiling is more than 10 ft (3.05 m) above maximum height of storage, a horizontal barrier should be installed above storage with one line of sprinklers under the barrier for Class I, II, and III commodities and two lines of sprinklers under the barrier for Class IV commodities. In-rack sprinkler arrays should be installed as indicated in Table 7-10.1 and Figures 7-10.1(a) through (j).

Barriers should be of sufficient strength to avoid sagging that interferes with loading and unloading operations.

Horizontal barriers need not be provided above a Class I or Class II commodity with in-rack sprinkler arrays according to Figure 7-10.1(a) and Figure 7-10.1(b), provided one line of in-rack sprinklers is installed above the top tier of storage.

A-7-12.1 Water demand for height of storage over 25 ft (7.62 m) on racks without solid shelves separated by aisles at least 4 ft (1.22 m) wide and with more than 10 ft (3.05 m) between top of storage and sprinklers should be based on sprinklers in 2,000 sq ft (185.8 m²) operating area for double row racks and 3,000 sq ft (278.7 m²) operating area for multiple row racks discharging a minimum of 0.18 gpm per sq ft [(7.33 L/min)/m²] for Class I commodities, 0.21 gpm per sq ft [(8.56 L/min)/m²] for Class II and III commodities, and 0.25 gpm per sq ft [(10.19 L/min)/m²] for Class IV commodities, for 165°F (74°C) sprinklers; or a minimum of 0.25 gpm per sq ft [(10.19 L/min)/m²] for Class I commodities, 0.28 gpm per sq ft [(11.41 L/min)/m²] for Class II and III commodities, and 0.32 gpm per sq ft [(13.04 L/min)/m²] for Class IV commodities, for 286°F (141°C) sprinklers. (See A-7-11 and A-7-13.)

Where such storage is encapsulated, ceiling sprinkler density should be 25 percent greater than for nonencapsulated.

A-7-13 In multiple row racks with more than 10 ft (3.05 m) between maximum height of storage and ceiling, a horizontal barrier should be installed above storage with a level of sprinklers, spaced as stipulated for in-rack sprinklers, installed directly beneath the barrier. In-rack sprinklers should be installed as indicated in Figures 7-13(a), (b), and (c).

A-8 All rack fire tests of plastics were run with an approximate 10-ft (3-m) maximum clearance between the top of storage and ceiling sprinklers. Within 30-ft (9.1-m) high buildings, greater clearances above storage configurations should be compensated for by the addition of more in-rack sprinklers and/or the provision of greater areas of application.

A-10-1.1 ESFR sprinklers were designed to respond quickly to growing fires and deliver heavy discharge to "suppress" fires rather than "control" them. ESFR sprinklers cannot be relied upon to provide suppression if they are used outside these design parameters.

A-10-2.1 Design parameters were determined from a series of full-scale fire tests conducted as a joint effort between Factory Mutual and the National Fire Protection Research Foundation. (Copies of the tests report are available from the National Fire Protection Research Foundation).

A-12-1 The use of welding, cutting, soldering, or brazing torches in the storage areas introduces a severe fire hazard. The use of mechanical fastenings and mechanical saws or cutting wheels is recommended. When welding or cutting operations are absolutely necessary, the precautions contained in NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*, should be followed.

Locomotives should not be allowed to enter the storage area.

A-12-2 Containers should be emptied and contents removed from the premises at frequent intervals (see NFPA 82, *Standard on Incinerators, Waste, and Linen Handling Systems and Equipment*).

A-12-4 Periodic inspections of all fire protection equipment should be made in conjunction with regular inspections of the premises. Unsatisfactory conditions should be immediately reported and necessary corrective measures taken promptly.

The sprinkler system and the water supplies should be checked and maintained in accordance with NFPA 13A, *Recommended Practice for the Inspection, Testing and Maintenance of Sprinkler Systems*.

A-12-5 Plant Emergency Organization. Arrangements should be made, in case of fire or other emergency, to permit rapid entry into the premises of the municipal fire department, police department, or other personnel as may be summoned to deal with any emergency. A well-trained plant emergency organization should be provided to control emergency conditions that may arise.

The plant emergency organization should be instructed and trained in the following procedures:

- (a) Maintaining the security of the premises
- (b) Means of summoning outside aid immediately in an emergency
- (c) Use of hand extinguishers and hose lines on small fires and mop-up operations
- (d) Operation of sprinkler system and water supply equipment
- (e) Use of material handling equipment while sprinklers are still operating to effect final extinguishment
- (f) Supervision of sprinkler valves after system is turned off so that system can be reactivated if rekindling occurs.

Attention should be given to advance planning and training with respect to fire department response, access, and fire fighting.

A-12-6 General Fire Protection.

All fire fighting and safety personnel should realize the great danger of shutting off sprinklers once opened by heat from fire. Shutting off sprinklers to locate fire could cause a disaster. Ventilation, use of smoke masks, smoke removal equipment, and removal of material are safer ways.

Sprinkler water may be safely shut off only after the fire is extinguished or completely under control of hose streams. Even then, rekindling is a possibility. To be ready for prompt valve reopening if fire rekindles, a person stationed at the valve, a fire watch, and dependable communications between them are needed until automatic sprinkler protection is restored.

Pre-Fire Emergency Planning. It is important that such planning be done by management and fire protection personnel, and the action to be taken discussed and correlated with the local fire department personnel.

The critical time of any fire is in the incipient stage, and the action taken by fire protection personnel upon notification of fire may permit containing the fire in early stages.

Pre-emergency planning should contemplate the following:

- (a) Availability of hand fire fighting equipment for the height and type of commodity involved.
- (b) Availability of fire fighting equipment and personnel properly trained for type of storage arrangement involved.
- (c) Assurance that all automatic fire protection equipment, such as sprinkler systems, water supplies, fire pumps, hand hose, etc., is in service at all times.

Fire Department Operations. Sprinkler protection installed as recommended in this standard is expected to protect the building occupancy without supplemental fire department activity. Fires that occur in rack storage occupancies, protected in accordance with this standard, should be controlled within the limits outlined in B-1-1. No significant building damage is expected. Fire department activity can, however, minimize the extent of loss. The first fire department pumper arriving at a rack storage-type fire should immediately connect to the sprinkler siamese fire department connection and start pumping operations.

In the test series up to 25 ft (7.62 m), the average time from ignition to smoke obscuration in the test building was about 13 min. The first sprinkler operating time in these same fires averaged about 3 min. Considering response time for the waterflow device to transmit a waterflow signal, approximately 9 min remains between time of receipt of a waterflow alarm signal at fire department headquarters and time of smoke obscuration within the building as an overall average.

In the over-25-ft (7.62-m) high test series, the visibility time was extended. If the fire department or plant protection department arrives at the building in time to have suf-

ficient visibility to locate the fire, suppression activities with small hose lines should be started. (Self-contained breathing apparatus is desirable.) If, on the other hand, the fire is not readily visible, hose should be laid to exterior doors or exterior openings in the building and charged lines provided to these points ready for ultimate mop-up operations. Manual fire fighting operations in such a warehouse are not a substitute for sprinkler protection.

The sprinkler system must be kept in operation during manual fire fighting and mop-up operations.

During the testing program, the installed automatic extinguishing system was capable of controlling the fire and reducing all temperatures to ambient within 30 min of ignition. Ventilation operations and mop-up were not started until this time period had been reached. The use of smoke removal equipment is important.

Smoke removal capability should be provided. Examples of smoke removal equipment include:

- (a) Mechanical air handling systems
- (b) Powered exhaust fans
- (c) Roof mounted gravity vents
- (d) Perimeter gravity vents.

Whichever system is selected, it should be designed for manual actuation by the fire department, thus allowing them to coordinate the smoke removal (ventilation) with their mop-up operations.

Appendix B

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

Appendix B explains test data and procedures that led to the promulgation of this standard. The paragraphs bear the same number as the text of this standard to which they apply.

B-1-1 Application and Scope.

This standard uses as a basis the large-scale fire test series conducted at the Factory Mutual Research Center, West Glocester, Rhode Island.

The test building is approximately 200 ft × 250 ft [50,000 sq ft (4.65 km²) in area], of fire-resistive construction, and contains a volume of approximately 2.25 million cu ft (63,761.86 m³), the equivalent of a 100,000 sq ft (9.29 km²) building 22.5 ft (6.86 m) high. The test building has two primary heights beneath a single large ceiling. The east section is 30 ft (9.15 m) high, and the west section is 60 ft (18.29 m) high.

The 20-ft (6.10-m) test series was conducted in the 30-ft (9.15-m) section with clearances from top of storage to ceiling nominally 10 ft (3.05 m).

Doors at the lower and intermediate levels and ventilation louvers at tops of walls were kept closed during the majority of the fire tests. This minimized effect of exterior conditions.

The entire test series was fully instrumented with thermocouples in rack members, simulated building column, bar joist, and at the ceiling.

Racks were constructed of steel vertical and horizontal members designed for 4000 lb (1814 kg) loads. Vertical members were 8 ft (2.44 m) O.C. for conventional racks and 4 ft (1.22 m) O.C. for simulated automated racks. Racks were 3½ ft (1.07 m) wide with 6-in. (12.7-mm) longitudinal flue space for an overall width of 7½ ft (2.29 m). Simulated automated racks and slave pallets were used in the main central rack in the 4-ft (1.22-m) aisle test. Conventional racks and conventional pallets were used in the main central rack in the 8-ft (2.44-mm) aisle tests. The majority of the tests were conducted with 100 sq ft (9.29 m²) sprinkler spacing.

The test configuration in the 15-ft (4.57-m), 20-ft (6.10-m), and 25-ft (7.62-m) high tests covered an 1800-sq ft (167.2-m²) floor area, including aisles between racks. Tests, which were used in producing this standard, limited fire damage to this area. Maximum water damage area anticipated in the standard is 6000 sq ft (557.4 m²), the upper limit of the design curves.

The test data shows that as density is increased both the extent of fire damage and sprinkler operation are reduced. The data also indicates that with sprinklers installed in the racks a reduction is gained in the area of fire damage and sprinkler operations, or water damage.

The following table illustrates these points. Information shown is taken from the 20-ft (6.10-m) high test series using the standard commodity.

Density gpm/sq ft	Fire Damage in Test Array % sq ft	Sprinkler Operation (165°F) Area — sq ft
0.30 (Ceiling only)	22	395 4500-4800
0.375 (Ceiling only)	17	306 1800
0.45 (Ceiling only)	9	162 700
0.20 (Ceiling only)	28-36	504-648 13,100-14,000
0.20 (Sprinklers at ceiling and in racks)	8	144 4100
0.30 (Sprinklers at ceiling and in racks)	7	126 700

For SI Units: 1 ft = 0.3048 m; C = % (F-32);

1 gpm/ft² = 40.746 (L/min)/m²

These basic facts, the reduction in both fire damage and area of water application as sprinkler densities are increased or when sprinklers are installed in racks, should be considered carefully by those responsible for applying this standard to the rack storage situation.

In the 25-ft (7.62-m) high test, a density of 0.55 gpm per sq ft [(22.4 L/min)/m²] produced 42 percent, or 756 sq ft (70.26 m), fire damage in the test array and a sprinkler wetted area of 1400 sq ft (130.1 m²). Lesser densities would not be expected to achieve the same limited degree of control. Therefore, if smaller areas of fire damage are to be achieved, sprinklers in racks should be considered.

The over-25-ft (7.62-m) test series was conducted in the 60-ft (18.29-m) section of the test building with nominal clearances from top of storage to ceiling of either 30 ft (9.15 m) or 10 ft (3.05 m).

Doors at the lower and intermediate levels and ventilation louvers at the top of walls were kept closed during the fire tests. This minimized the effect of exterior wind conditions.

The purpose of the over-25-ft (7.62-m) series was to:

1. Determine the arrangement of in-rack sprinklers that can be repeated as pile height increases and that provide control of the fire.

2. Determine other protective arrangements, such as high expansion foam, that provide control of the fire.

Control was felt to be accomplished if the fire was unlikely to spread from the rack of origin to adjacent racks or spread beyond the length of the 25-ft (7.62-m) test rack. To aid in this judgment, control was considered achieved if the fire did not:

1. Jump the 4-ft (1.22-m) aisles to adjoining racks.

2. Reach the end face of the end stacks (north or south ends) of the main rack.

Control is defined as holding the fire in check through the extinguishing system until commodities initially involved are consumed, or fire is extinguished by the extinguishing system or manual aid.

The standard commodity as selected in the 20-ft (6.1-m) test series was used in the majority of over-25-ft (7.62-m) tests. Hallmark products and 3-M products described in the 20 ft (6.1 m) report were also used as representative of Class III and/or IV commodities in several tests. The result of privately sponsored tests on Hallmark products and plastic encapsulated standard commodity were also made available to the committee.

A 25-ft (7.62-m) long test array was used for the majority of over-25-ft (7.62-m) high test series. This decision was reached as it was felt that a fire in racks over 25-ft (7.62-m) high that extended to the full length of a 50-ft (15.24-m) long rack could not be considered controlled, particularly as storage heights increased.

One of the purposes of the tests was to determine arrangements of in-rack sprinklers that can be repeated as pile height increases and that provide control of the fire. The 30-ft (9.15-m) tests explored the effect of such arrays. Many of these tests, however, produced appreciable fire spread in storage in tiers above the top level of protection within the racks. (In some cases, a total burnout of the top tiers of both the main rack and the target rack occurred.) In the case of the 30-ft (9.15-m) Hallmark Test 134 on the 60-ft (18.29-m) site, the material in the top tiers of storage burned vigorously, and the fire jumped the aisle above the fourth tier. The fire then burned itself downward into the south end of the fourth tier. In the test on the floor, a nominal 30-ft (9.15-m) clearance occurred between top of storage and ceiling sprinklers, whereas on the platform this clearance was reduced to nominal 10 ft (3.05 m). In most cases the in-rack sprinklers were effective in controlling fire below the top level of protection within the racks. It has been assumed by the Test Planning Committee that, in the actual case with clearance of 10 ft (3.05 m) or less above storage, ceiling sprinklers would be expected to control damage above the top level of protection within the racks. Tests are planned to investigate lesser clearances.

Tests 114 and 128 explore the effect of changing the ignition point from the in-rack standard ignition point to a face ignition location. It should be noted, however, that both of these tests were conducted with 30-ft (9.15-m) clearance from ceiling sprinklers to top of storage and, as such, ceiling sprinklers had little effect on the fire in the top two tiers of storage. Fire spread in the three lower tiers is essentially the same. A similar change in the fire spread when the ignition point is changed was noted in Tests 126 and 127. Here again, 30-ft (9.15-m) clearance occurred between top of storage and ceiling sprinklers, and, as such, ceiling sprinklers had little effect on the face fire. Comparisons of Tests 129, 130, and 131 in the 50-ft (15.24-m) series indicate little effect of point of ignition in the particular configuration tested.

Test 125 compared with Test 133 indicates no significant difference in result between approved low profile sprinklers and standard sprinklers in the racks.

B-2-1 A review of full-scale fire tests run on the standard commodity (double tri-wall carton with metal liner); of Hallmark products and 3-M products (abrasives, pressure sensitive tapes of plastic fiber, and paper, etc.); and of the considerable number of commodity tests conducted indicates a guide for commodity classifications. This guide is not related to any other method of classification of materials; therefore, sound engineering judgment and analysis of the commodity and the packaging must be made when selecting a commodity classification.

B-3-2.1 None of the tests that were conducted with densities in accordance with the design curves produced critical temperatures in bar joists 12 ft 6 in. (3.81 m) from the ignition source. Therefore, with sprinkler systems designed in accordance with the curves, fireproofing of roof steel is not necessary.

B-3-2.2 Temperatures in the test column were maintained below 1000°F (538°C) in all tests where sprinklers in racks were used.

B-3-2.3 Temperatures in the test column were maintained below 1000°F (538°C) with densities of roof ceiling sprinklers only of 0.375 gpm per sq ft [(15.3 L/min)/m²] with 8-ft (2.44-m) aisles and 0.45 gpm per sq ft [(18.34 L/min)/m²] with 4-ft (1.22-m) aisles using the standard commodity.

B-3-3 Tests were conducted as a part of this program with eave line windows or louvers open to simulate smoke and heat venting. These tests opened 87.5 percent and 91 percent more sprinklers than did comparative tests without windows or louvers open. Venting tests that have been conducted in other programs were without the benefit of sprinkler protection, and, as such, are not considered in this report, which is dealing only with buildings protected by sprinklers. The design curves are based upon roof vents or draft curtains not being installed in the building. During mop-up operations, ventilating systems, where installed, should be capable of manual exhaust operations.

B-4-3.1 Test 80 was conducted to determine the effect of closing back-to-back longitudinal 6-in. (152.4-mm) flue space in conventional pallet racks. Test results indicated

fewer sprinklers operating than with the flue space open, and, as such, no minimum back-to-back clearance is necessary if the transverse flue space is maintained open.

Tests 145 and 146 were conducted to investigate the influence of longitudinal and transverse flue dimensions in double row racks without solid shelves. Results were compared with Tests 65 and 66. Flue dimensions in Tests 65, 66, 145, and 146 were 6 in. (152.4 mm), 6 in. (152.4 mm), 3 in. (76.2 mm), and 12 in. (0.30 m) respectively. All other conditions were the same.

In Tests 65 and 66, 45 and 48 sprinklers operate compared with 59 and 58 for Tests 145 and 146. Fire damage in Tests 145 and 146 was somewhat less than in Tests 65 and 66; 2,100 cu ft (59.51 m³) and 1,800 cu ft (51 m³) versus 2,300 cu ft (65.13 m³) and 2,300 cu ft (65.13 m³) of combustible material consumed.

Test results indicate narrow flue spaces on the order of 3 in. (76.2 mm) will allow reasonable passage of sprinkler water down through the racks.

Tests 96 and 107, on multiple row racks, had 6-in. (152.4-mm) transverse flue spaces. Water demand recommended in the standard is limited to those cases with nominal 6-in. (152.4-mm) transverse flues, in vertical alignment.

B-4-5 Most tests in the 25-ft (7.62-m) and under series were conducted with clearance of 10-ft (3.05 m) from top of storage to sprinkler deflectors, and the basic design curves in Figures 6-11.1(a) through (g) reflect this condition.

Tests 140 and 141 were conducted with 3-ft (0.91-m) clearance between the top of storage and ceiling sprinkler deflectors. In Test 140 with 0.30 density, 36 sprinklers operated compared with 45 and 48 sprinklers in tests 65 and 66 with 10-ft (3.05-m) clearance. In Test 141, 89 sprinklers operated compared with 140 sprinklers in Test 70 with 10-ft (3.05-m) clearance. Fire spread in Tests 140 and 141 was somewhat less than in Tests 65, 66, and 70.

Test 143 was conducted with 18-in. (0.46-m) clearance between the top of storage and ceiling sprinkler deflectors, and with 0.30 density. Thirty-seven sprinklers operated compared with 36 sprinklers in Test 140 with 3-ft (0.91-m) clearance and 45 and 48 sprinklers in Tests 65 and 76 with 10-ft (3.05-m) clearance. Fire spread in Test 143 with 18-in. (0.46-m) clearance was somewhat less than in tests 65, 66, and 140 with 10-ft (3.05-m) and 3-ft (0.91-m) clearance.

Privately sponsored tests, using a 0.45 ceiling sprinkler density and an encapsulated commodity, indicated 40 sprinklers operating with 10-ft (3.05-m) clearance, 11 sprinklers operating with 3-ft (0.91-m) clearance, and 10 sprinklers operating with 18-in. (0.46-m) clearance. Fire spread was less in the test with 18-in. (0.46-m) clearance than 3-ft (0.91-m) clearance, and was also less with 3-ft (0.46-m) clearance than with 10-ft (3.05-m) clearance.

B-4-7 No tests were conducted with idle pallets in racks. Such storage conceivably would introduce fire severity in excess of that contemplated by protection criteria for an individual commodity classification.